

Comhairle Chontae Uíbh Fhailí


Tel: 057 9346800 • Fax: 057 9346868

Website: www.offaly.ie

email: secretar@offalycoco.ie

## Offaly County Council

Áras an Chontae,  
Charleville Road,  
Tullamore,  
Co. Offaly.



EPA

Environmental Protection Agency  
Headquarters, PO Box 3000,  
Johnstown Castle Estate  
Co. Wexford.

MAIN FILE ☒PUBLIC FILE ☒26<sup>th</sup> June 2006EVALUATION FILE an

Attention: Ms Dorota Richards

DATE 30/6/06 go

**Re: Review of IPC Licence Reg. No.180, Glanbia Fresh Pork, Carrick Road, Edenderry.**

I refer to your correspondence of 10<sup>th</sup> May in relation to the above (Reg. No. 761).

Offaly County Council note Glanbia's Objection No.3, Schedule B.3 Emissions to Sewer.

Offaly County Council has no objection to Glanbia's revised proposal to maintain a Total Nitrogen Limit of 55mg/l, with Kjeldhal Nitrogen set at 35mg/l and Nitrate set at 20mg/l, instead of previously sought limits of 50 mg/l Kjeldhal Nitrogen and 30 mg/l Nitrate.


Therefore with reference to Schedule B.3 Emissions to the Sewer, the following limits should apply with respect to Nitrate and Kjeldahl Nitrogen.

Parameter	Emission Limit Value
Nitrate (mg/l)	20
Kjeldahl Nitrogen (mg/l)	35

All other Emission Limit Values and comments as per our letter dated 27<sup>th</sup> March 2006 still apply. Emission Limit Values are with reference to the existing municipal treatment plant in Edenderry as it is. The proposed upgrade referred to in E.G Pettits correspondence is not expected to be complete until circa mid 2007.

Yours faithfully,

Michael Roche  
Director of Services,  
Roads and Infrastructure Section.

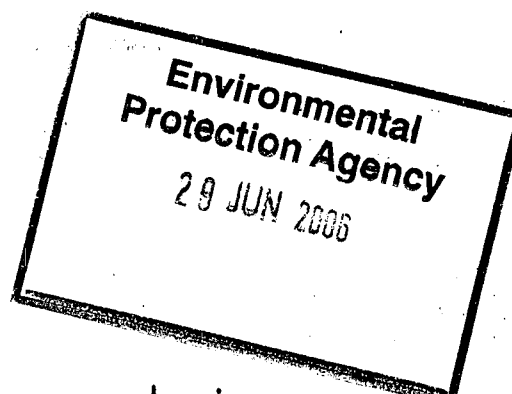

offaly.ie - your community online

**Offaly County Council** **EPA**

Comhairle Chontae Uíbh Fhailí

**FAX COVER PAGE**ROADS & WATER SERVICES  
Bóithre & Seirbhísí Uisce

MAIN FILE \_\_\_\_\_

PUBLIC FILE \_\_\_\_\_

EVALUATION FILE \_\_\_\_\_

DATE \_\_\_\_\_

Hand  
Copy Recd  
29/6/06Áras an Chontae  
Charleville Road  
Tullamore  
Co Offalyoffaly.ie - our community online  
[http:// www.offaly.ie/yourcouncil.html](http://www.offaly.ie/yourcouncil.html)Teileafón/ Phone: 0506 46800  
Roads & Water Department: 0506 46890

Chuig/ To:

Facs/ Fax:

0506 29231

Ms. Dorota Richards,  
Environmental Protection Agency  
Johnstown Castle,  
Wexford

Ó/ From:

Michael Roche  
Director of Services  
Roads and Water Services,  
Offaly County Council

Ext.: \_\_\_\_\_

Email: \_\_\_\_\_

Uimhir Facs/ Fax number:

053 916 0699

Uimhir Leathanach (ceann seo sam aireamh)  
Number of pages (inc. cover page)

2

Dáta/ Date:

29<sup>th</sup> June 2006

## TEACHTAIREACHT/ MESSAGE:

**F.A.O. DOROTA RICHARDS**

Please find attached correspondence re: IPC Licence reg. 180. Original forwarded by post.

Regards,

Michael Roche  
Director of Services  
Roads and Water Services**RECEIVED**

Time 1000

29 JUN 2006

Signature   
Environmental Protection Agency, HQ.  
P.O. Box 3000, Johnstown Castle Estate,  
Co. Wexford.

*Comhairle Chontae Uíbh Fhailí*

Tel: 057 9346800 • Fax: 057 9346868

Website: [www.offaly.ie](http://www.offaly.ie)

email: [secretar@offalycoco.ie](mailto:secretar@offalycoco.ie)

## Offaly County Council

Áras an Chontae,  
Charleville Road,  
Tullamore,  
Co. Offaly.



Environmental Protection Agency  
Headquarters, PO Box 3000,  
Johnstown Castle Estate  
Co. Wexford.

26<sup>th</sup> June 2006

Attention: Ms Dorota Richards

**Re: Review of IPC Licence Reg. No.180, Glanbia Fresh Pork, Carrick Road, Edenderry.**

I refer to your correspondence of 10<sup>th</sup> May in relation to the above (Reg. No. 761).

Offaly County Council note Glanbia's Objection No.3, Schedule B.3 Emissions to Sewer.

Offaly County Council has no objection to Glanbia's revised proposal to maintain a Total Nitrogen Limit of 55mg/l, with Kjeldhal Nitrogen set at 35mg/l and Nitrate set at 20mg/l, instead of previously sought limits of 50 mg/l Kjeldhal Nitrogen and 30 mg/l Nitrate.

Therefore with reference to Schedule B.3 Emissions to the Sewer, the following limits should apply with respect to Nitrate and Kjeldahl Nitrogen.

Parameter	Emission Limit Value
Nitrate (mg/l)	20
Kjeldahl Nitrogen (mg/l)	35

All other Emission Limit Values and comments as per our letter dated 27<sup>th</sup> March 2006 still apply. Emission Limit Values are with reference to the existing municipal treatment plant in Edenderry as it is. The proposed upgrade referred to in E G Pettits correspondence is not expected to be complete until circa mid 2007.

Yours faithfully,

Michael Roche  
Director of Services,  
Roads and Infrastructure Section.