


Post Office Box No. 27,
Áras an Chontae,
Prospect Hill,
Galway.

Mo Thag:

Do Thag.

CM/JMcG

COMHAIRLE CHONTAE NA GAILLIMHE
GALWAY COUNTY COUNCIL



Bosca Poist Uimhir 27,
Áras an Chontae,
Cnoc na Radharc,
Gaillimh.

Telephone: (091) 509000
Fax: (091) 509010
E-Mail: @galwaycoco.ie
Web: www.gaillimh.ie
www.galway.ie

Iasachtaí/Deontais Tithíochta

(091) 509 301

Housing Loans/Grants

Iarratais Tithíochta

(091) 509 300

Housing Applications

Comhshaoil

(091) 509 302

Environment

Acmhainní Daonna

(091) 509 303

Personnel

Mótarcháin

(091) 509 099

Motor Taxation

Ceadúnais Tiomána

(091) 509 305

Driving Licences

Seirbhísí Uisce

(091) 509 306

Water Services

Pobal & Fiontar

(091) 509 066

Community & Ent.

Pleanáil

(091) 509 308

Planning

Innealtóireacht

(091) 509 309

Engineering

Clár na dToghthóirí

(091) 509 310

Register of Electors

Deontais Ard Oideachais

(091) 509 310

Higher Ed. Grants

Licensing Unit
Office of Licensing and Guidance
Headquarters
PO Box 3000
Johnstown Castle Estate
Co Wexford

6th March 2007

Re: Application for an IPPC licence registration number P0816-01.
Green Isle Foods (Portumna) Ltd., Portumna, Co. Galway.

A chara,


I refer to your letter dated the 30th of January 2007 concerning the application for an IPPC licence by Green Isle Foods (Portumna) Ltd., Portumna, Co Galway. Please find enclosed the completed 'Sanitary Authority Response' form.

Additional consent conditions requested by Galway County Council are as follows:

1. Analysis of the treated effluent prior to discharge to the sewer shall be carried out by an approved accredited laboratory 4 times per year, the following parameters shall be measured and the analysis of same forwarded to the licencing authority: (a) BOD (b) COD (c) suspended solids (d) total phosphorus (e) total nitrogen and (f) fats, oils and greases. Sample must be of a composite nature.
2. A continuous flow meter shall be installed on the treatment plant to allow for the measuring and recording of the daily volume of treated effluent discharged to the sewer.
3. The licensee must comply with Galway County Councils water pricing policy.
4. If analysis show that the quality of the treated effluent exceeds the specification as outlined in *Schedule B Emission Limits to Sewer*, the Local Authority shall have the facility to charge a penal rate for every Kg of excess in all of the main parameters. The rate of charge is to be decided at a later date.

SCANNED

- 9 MAR 2007

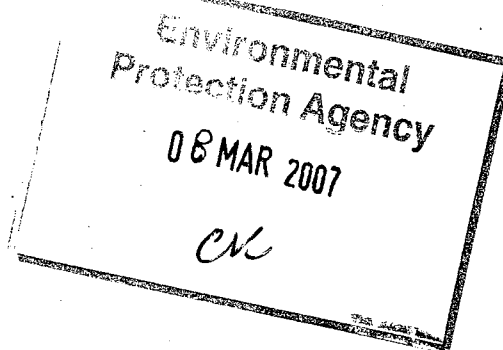

EPA

MAIN FILE ☒

PUBLIC FILE ☒


EVALUATION FILE EC

DATE 9/3/07 go



If you have any further queries please do not hesitate to contact me at 091 509302.

Mise le meas,

A handwritten signature in black ink, appearing to read 'A. Dolan', is written over a horizontal line.

Ann Dolan

A/ Senior Executive Technician

For inspection purposes only.
Consent of copyright owner required for any other use.

SANITARY AUTHORITY RESPONSE

Name of Sanitary Authority: *Galway County Council*

Address: *PO Box 27
County Hall
Prospect Hill
Galway*

Name of Facility: *Green Isle Foods Limited*

IPC Reg. No: *P0816-01*

Address: *IDA Industrial Estate
St. Joseph's Road
Portumna
County Galway*

Consent: Indicate Yes to one of the following statements:

Consent granted subject to the consent conditions outlined below.	<input checked="" type="checkbox"/>
Consent granted without conditions.	<input type="checkbox"/>
Consent refused ^{Note 1} .	<input type="checkbox"/>

Note 1 Where it is proposed to refuse permission the reasons for the refusal should be clearly outlined in the response.

GENERAL CONSENT CONDITIONS	Condition to be Included (Yes/No)
1. The licensee shall permit authorised persons, of the Agency and Sanitary Authority, to inspect, examine and test, at all reasonable times, any works and apparatus installed in connection with the process effluent and to take samples of the process effluent.	<input checked="" type="checkbox"/>
2. The licensee shall at no time discharge or permit to be discharged into the sewer any liquid matter or thing that is or may be liable to set or congeal at average sewer temperature or is capable of giving off any inflammable or explosive gas or any acid, alkali or other substance in sufficient concentration to cause corrosion to sewer pipes, penstock and sewer fittings or the general integrity of the sewer.	<input checked="" type="checkbox"/>

ADDITIONAL GENERAL CONSENT CONDITIONS In respect of discharges or emissions to sewers, in accordance with Section 99E of the Environmental Protection Agency Acts 1992 and 2003 (Specify, if required)
see letter attached

For inspection purposes only.
Consent of copyright owner required for any other use.

Limit Values for Process Effluent to Sewer

Schedule B: Emission Limits

Emission point reference no: _____

Emission to (sewer description): _____

Volume to be emitted : Maximum in any one day : 864 m³
 Maximum rate per hour : 36 m³

Parameter (delete parameters which are not applicable)	Emission Limit Value	
	Daily Mean Concentration (mg/l)	Daily Mean Loading (kg/day)
BOD	< 25 mg/l	
COD	< 125 mg/l	
Suspended Solids	< 35 mg/l	
pH	6-9 pH units	
Temperature	< 20 °C	
ADDITIONAL PARAMETERS (if required)		
Fats oils & greases	< 50 mg/l	
Total phosphorus	< 2 mg/l	
Total nitrogen	< 15 mg/l	

Frequency of Monitoring Process Effluent to Sewer

Schedule C

Emission point reference no: _____

Parameter (delete parameters which are not applicable)	Monitoring Frequency (e.g. monthly, quarterly, annually)	Sample Type (grab, composite)
Flow to sewer	continuous	
Temperature	1/4ly	
pH	"	composite
BOD	"	"
COD	"	"
Suspended Solids	"	"
ADDITIONAL PARAMETERS (if required)		
Total Phosphorus	Quarterly	composite
Total Nitrogen		"
Fats oils & greases	"	"

Signed on behalf of Sanitary Authority: C. M. [Signature]