


- NOTES**
1. Dimensions are not to be scaled from drawing. For any discrepancies found consult with the design office.
 2. This drawing is to be read in conjunction with the Specification.
 3. This drawing is to be read in conjunction with all other contract drawings.

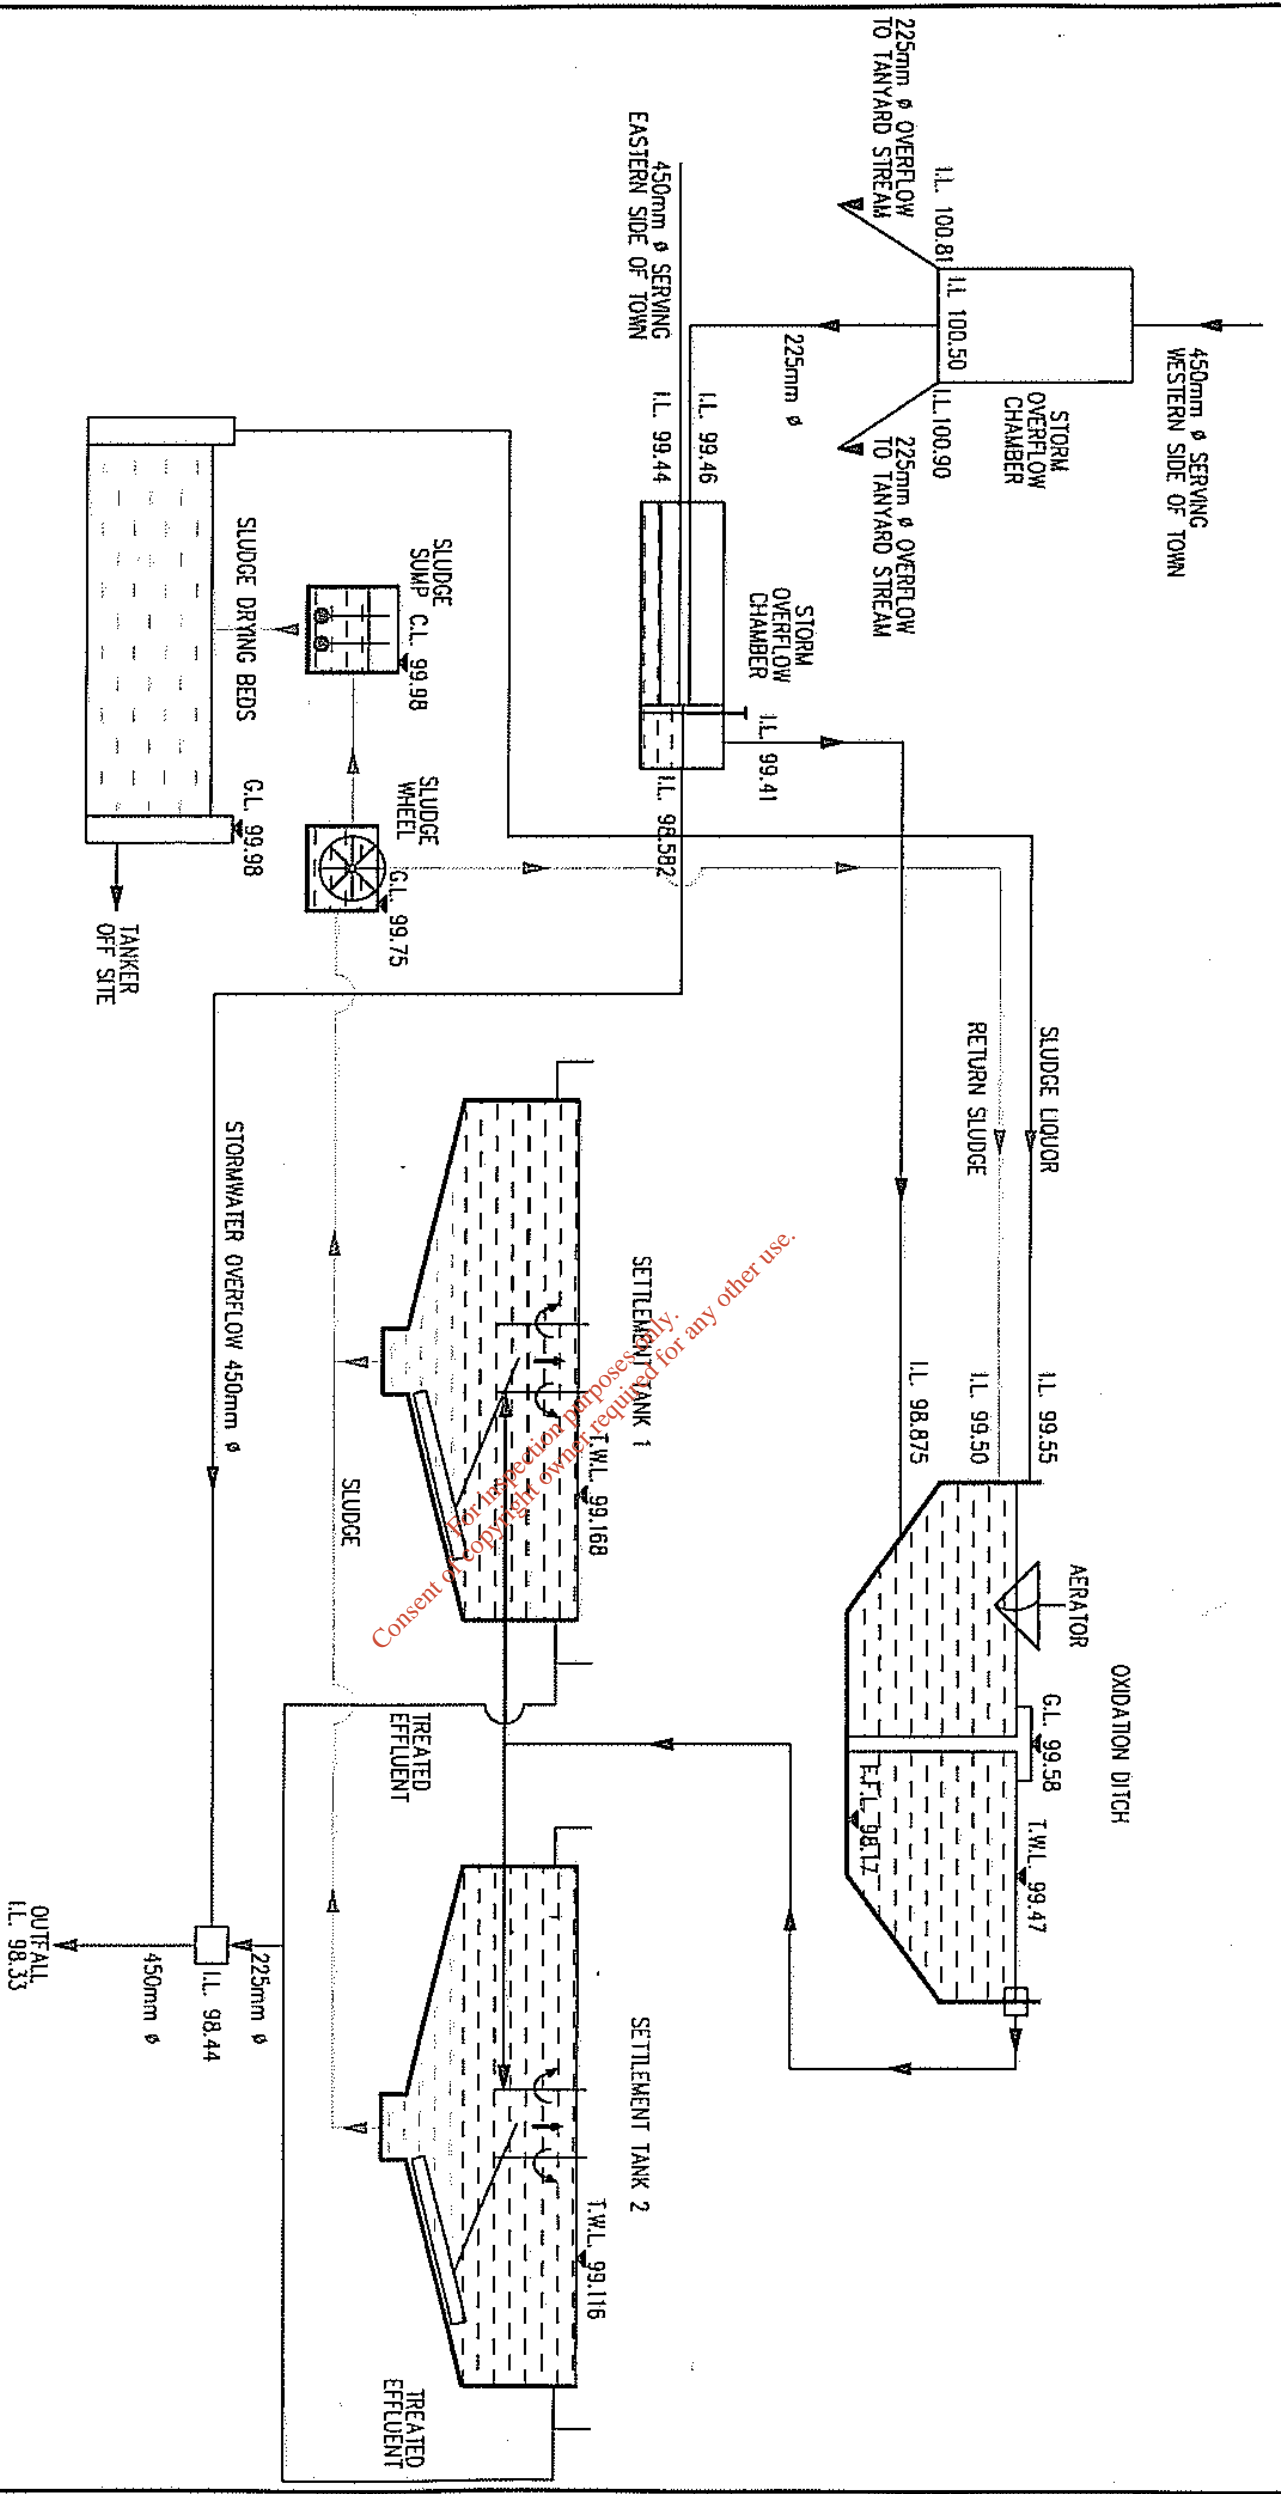

WASTEWATER
TREATED EFFLUENT
SLUDGE
SLUDGE LIQUOR/
SUPERNATANT

FIGURE 4.2 – HYDRAULIC PROFILE OF WASTEWATER TREATMENT PLANT

VALSTREET WWP, GRANGE
FIELD, CO. 18, D210
Dwg. No. A210-F012

**Cork County Council,
Northern Division.**

N. O'KEEFE, B.E.,
COUNTY ENGINEER,
COUNTY HALL,
CORK.

Job Title:
Millstreet & Environs
Waste Water Discharge
Licence Application

Drawing Title:
Schematic showing Existing
Treatment Plant Process
Attachment C1 - Drawing 1

Scale:	1:5000 @ A3	Drawn by:	D.L.
Designed by:	P.J.	Checked by:	P.C.
Drawing number:	C1 - Drawing 1	Date:	August 2008