

Sonja Smith

From: Ann Marie Donlon
Sent: 08 March 2010 16:09
To: Sonja Smith
Subject: FW: Regulation 18 - outstanding information
Attachments: Y7334-PR-002 bound_RevisionB.pdf

Reg 18 response for file.

From: Madeleine Healy [mailto:Madeleine.Healy@CorkCoCo.ie]
Sent: 08 March 2010 09:12
To: Ann Marie Donlon
Subject: RE: Regulation 18 - outstanding information

Dear Ms Donlon

With regard to the issue raised below

Unfortunately Cork Co Council do not do chemical analysis on sample wastewater from the storm holding tanks or overflow pump sumps. Therefore it is not possible to estimate the organic load lost through the overflows from the terminal pump stations. The hydraulic information already submitted is all we have available.

Regards

Madeleine Healy

From: Ann Marie Donlon [mailto:a.donlon@epa.ie]
Sent: 25 February 2010 09:37
To: Madeleine Healy
Subject: Regulation 18 - outstanding information

*For inspection purposes only.
Consent of copyright owner required for any other use.*

Dear Ms Healy

I have reviewed Cork CC response to the Regulation 18 notice and note that Cork CC provided details of the hydraulic load from SWO's. Please be advised that the request relates to organic load. For your convenience I have copied the question as follows:

- Give details of the current estimate of untreated waste water lost from the agglomeration via storm water overflows in terms of mass load or PE.

The Agency would appreciate it if you could provide information regarding this particular point as soon as possible.

Regards

Ann Marie Donlon
Office of Climate, Licensing and Resource Use
Environmental Protection Agency
Tel: 021 4875540

This email and any files transmitted with it are confidential and intended solely for the use of the individual or entity to whom they are addressed. If you have received this email in error please notify


the EPA postmaster - postmaster@epa.ie

The opinions contained within are personal to the sender and do not necessarily reflect the policy of the Environmental Protection Agency.

This email has been scanned by the MessageLabs Email Security System.
For more information please visit <http://www.messagelabs.com/email>

This email has been scanned by the MessageLabs Email Security System.
For more information please visit <http://www.messagelabs.com/email>

*For inspection purposes only.
Consent of copyright owner required for any other use.*

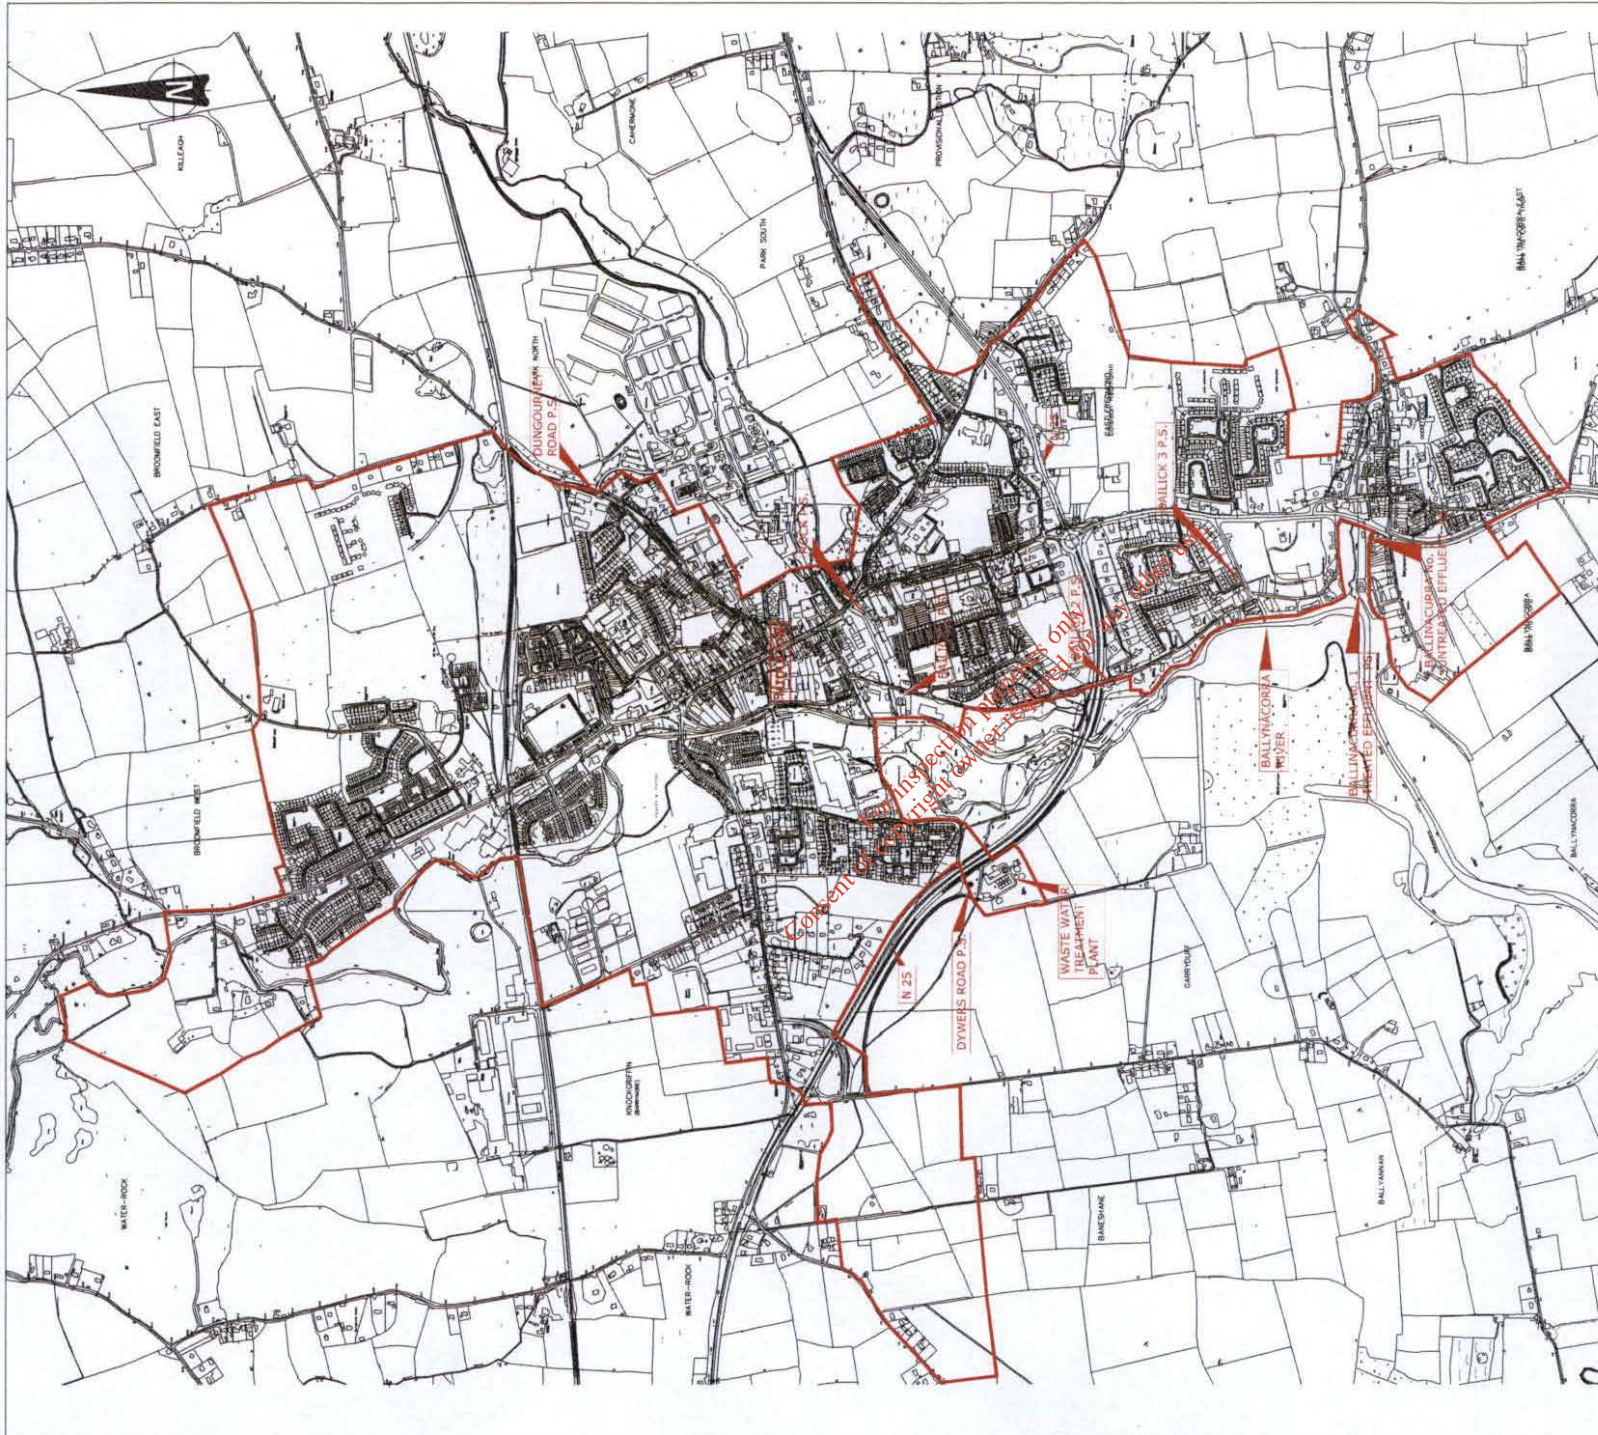

NOTES:

Figured dimensions only to be taken from this drawing.
All dimensions to be checked on site.

LEGEND:

AGGLOMERATION BOUNDARY



Rev	Description	Drawn	Chkd	Date
B	Agglom. Bndy revised to include W.W.T.P.	MM	MH	04.03.10
A	Under Construction-Removed Dwyers Road	MM	MH	08.09.09

Client: **CORK COUNTY COUNCIL**

Client Representative:

BARRY & PARTNERS
 consulting engineers
 I. B. Barry & Partners Limited
 3A East Gate Road, Kinsale,
 Little Island, Co. Cork,
 Ireland.
 Phone: 353-21-452418
 Fax: 353-21-452419
 Email: cork@barry.ie

Project: **MIDLETON WWTP EPA LICENCE APPLICATION**

Drawing Title: **ATTACHMENT B.1 (REVISED) AGGLOMERATION BOUNDARY SERVED BY WASTE WATER TREATMENT WORKS**

Drawn by: M.H. Date: 20.08.07
 Checked by: R.K. Date: 20.08.07
 Approved by: R.K. Date: 20.08.07

Scales: **1:15,000 @ A3**

Stage: **REVISED**

Drawing No.: **Y7 334 / PR / 002** Revision: **B**