

# Comhairle Contae Chorcaí Cork County Council

Annabella,  
Mallow,  
Co. Cork.

Tel: (022) 21123 • Fax: (022)21983  
Email: northcork@corkcoco.ie


Web: www.corkcoco.ie

Annabella,  
Mala,  
Co. Chorcaí.

Fón: (022) 21123 • Faics: (022) 21983  
R-phost: northcork@corkcoco.ie  
Suíomh Gréasáin: www.corkcoco.ie



Ms. Yvonne English  
Inspector,  
Environmental Protection Agency,  
Office of Climate, Licensing & Resource Use,  
Headquarters,  
PO Box 3000,  
Johnstown Castle Estate,  
County Wexford.

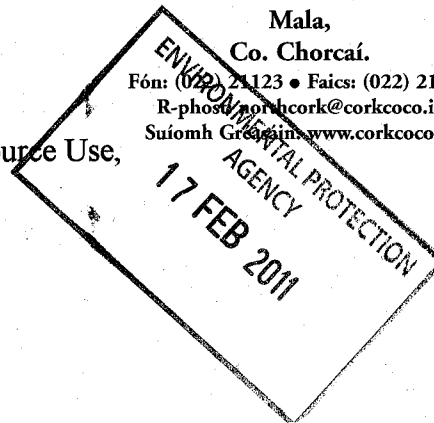

15/02/2011

A0327-01

**Re: Notices in accordance with Regulation 25(c)(ii) of the Waste Water  
Discharge (Authorisation) Regulations 2007**

Dear Ms. English,

I refer to yours relating to agglomeration named Lombardstown. Cork Co Co has engaged the services of a consulting engineer to undertake a full appropriate assessment on the impact of discharges from 47 agglomerations to the River Blackwater and its tributaries. A handover date of mid June had been agreed with the consultant at a contract initiation meeting two weeks ago. Following my phone conversation with you last week I have reverted to the consultant and advised him of the need to prioritise the certificate agglomerations and he is review his programme and he is hoping to complete the assessment relating to the Certificate Plants by the end of March.


I enclose a two revised copies of drawing showing the agglomeration boundary as requested and a copy of the requested information in electronic searchable PDF format on a CD – ROM.

Paddy O' Friel  
Substitute Senior Engineer  
Email: [paddy.ofriel@corkcoco.ie](mailto:paddy.ofriel@corkcoco.ie)



022- 30441.



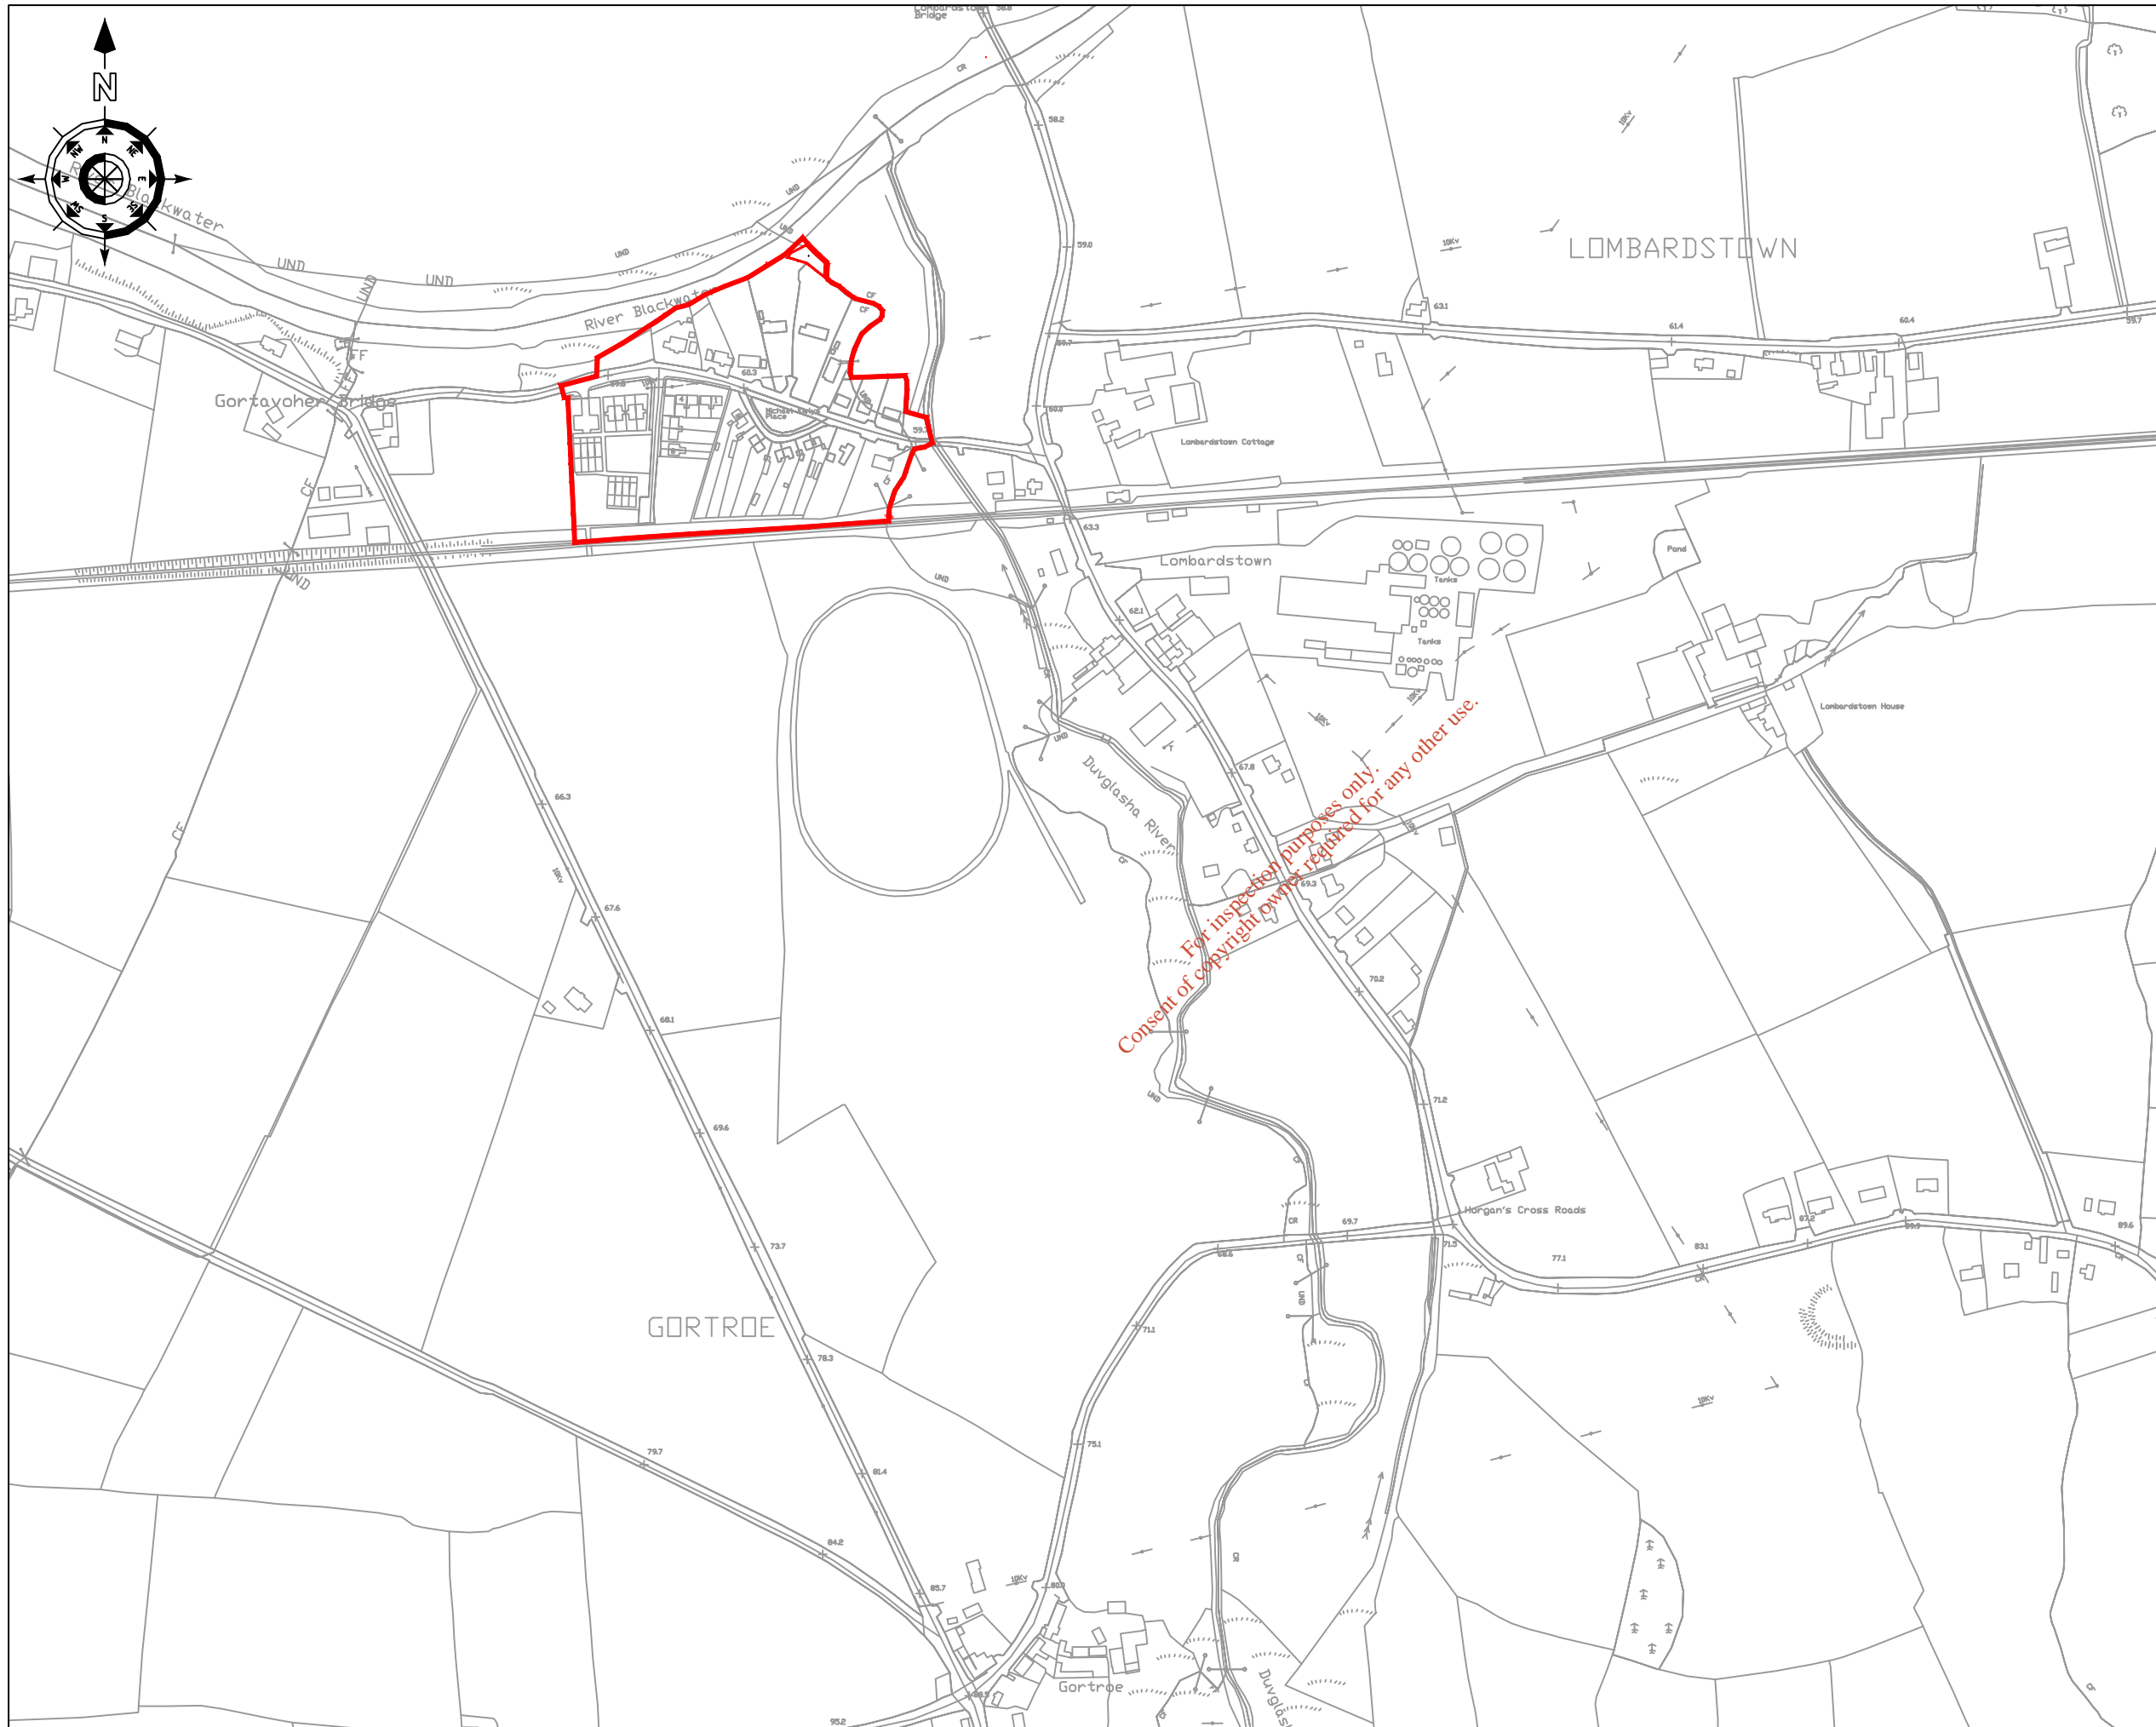

For inspection purposes only.  
Consent of copyright owner required for any other use.

**NOTES**

1. Dimensions are not to be scaled from drawing. For any discrepancies found consult with the design office.
2. This drawing is to be read in conjunction with the Specification.
3. This drawing is to be read in conjunction with all other contract drawings.

No.	Date	Drawn	Surv	Chkd	Revision Description
B	02/11	DL	DL	EM	Revision to Agglomeration Boundary
A	12/10	DL	DL	EM	Revision to Agglomeration Boundary

Cork County Council,  
Northern Division.

N. O'KEEFE, B.E.,  
COUNTY ENGINEER,  
COUNTY HALL,  
CORK.

**Job Title:**  
Lombardstown & Environs  
Waste Water Discharge  
Licence Application

**Drawing Title:**  
Agglomeration Boundary  
Attachment B1 - Map 4

<b>Scales:</b> 1:5,000 @ A3	<b>Surveyed by:</b> D.L.	<b>Drawn by:</b> D.L.
<b>Designed by:</b> E.M.	<b>Checked by:</b> P.O.F	<b>Date:</b> December 2009
<b>Drawing number:</b> B1 - Map 4		<b>Rev:</b> B

**ANNEX 1: TABLES / ATTACHMENT**

<b>Section</b>		<b>Dwg #-Rev</b>	<b>Description</b>
A1	Non-technical summary	Map 1	Location map
		Map2	Site location of WWTP
		Map3	Wastewater treatment plant- site layout
B1	Agglomeration details	Map4 - B	Agglomeration map
B2	Location of WWTP	Map 5	Layout of Waste water treatment plant
B3	Location of primary discharge	Map6	Location of primary discharge
		Map 7	Location of sampling points
B4	Location of secondary discharge	-	-
B5	Location of SWO	-	-
B6	Planning Authority	-	-
B7	Other Authorities	-	-
B8	PE of Agglomeration	-	-
B9	Capital Investment Programme	-	
B10	Significant Correspondance	-	-
B11	Foreshore licence	-	-
C1	Infrastructure and operation	Map9	Layout of WWTP
		Drq 1	Schematic of Wastewater treatment plant
D1	Discharge to surface water		Sampling results
	Discharges to Ground water	-	-
	Private WWTP	-	Details of private WWTP
D2	Discharge points	-	Excel spread sheet of discharge point data
E2	Monitoring and sampling		-
E3	Tabular data on monitoring and sampling points		-
E4	Sampling data	-	Sampling results
F1	Impact on receiving surface water or groundwater		Blackwater SAC
F2	Tabular data on drinking water abstraction points		-
G1	Compliance with Council Directives		Not Applicable
G2	Compliance with the European Communities Environmental Objectives (Surface water) regulations 2009		-
G3	Impact Mitigation		
G4	Storm water overflow		-