


**Ferric Dosing Location**

E: 152,265  
N: 046,867

**Waste Water Treatment Plant**

*For inspection purposes only.  
Consent of copyright owner required for any other use.*

Open Drain

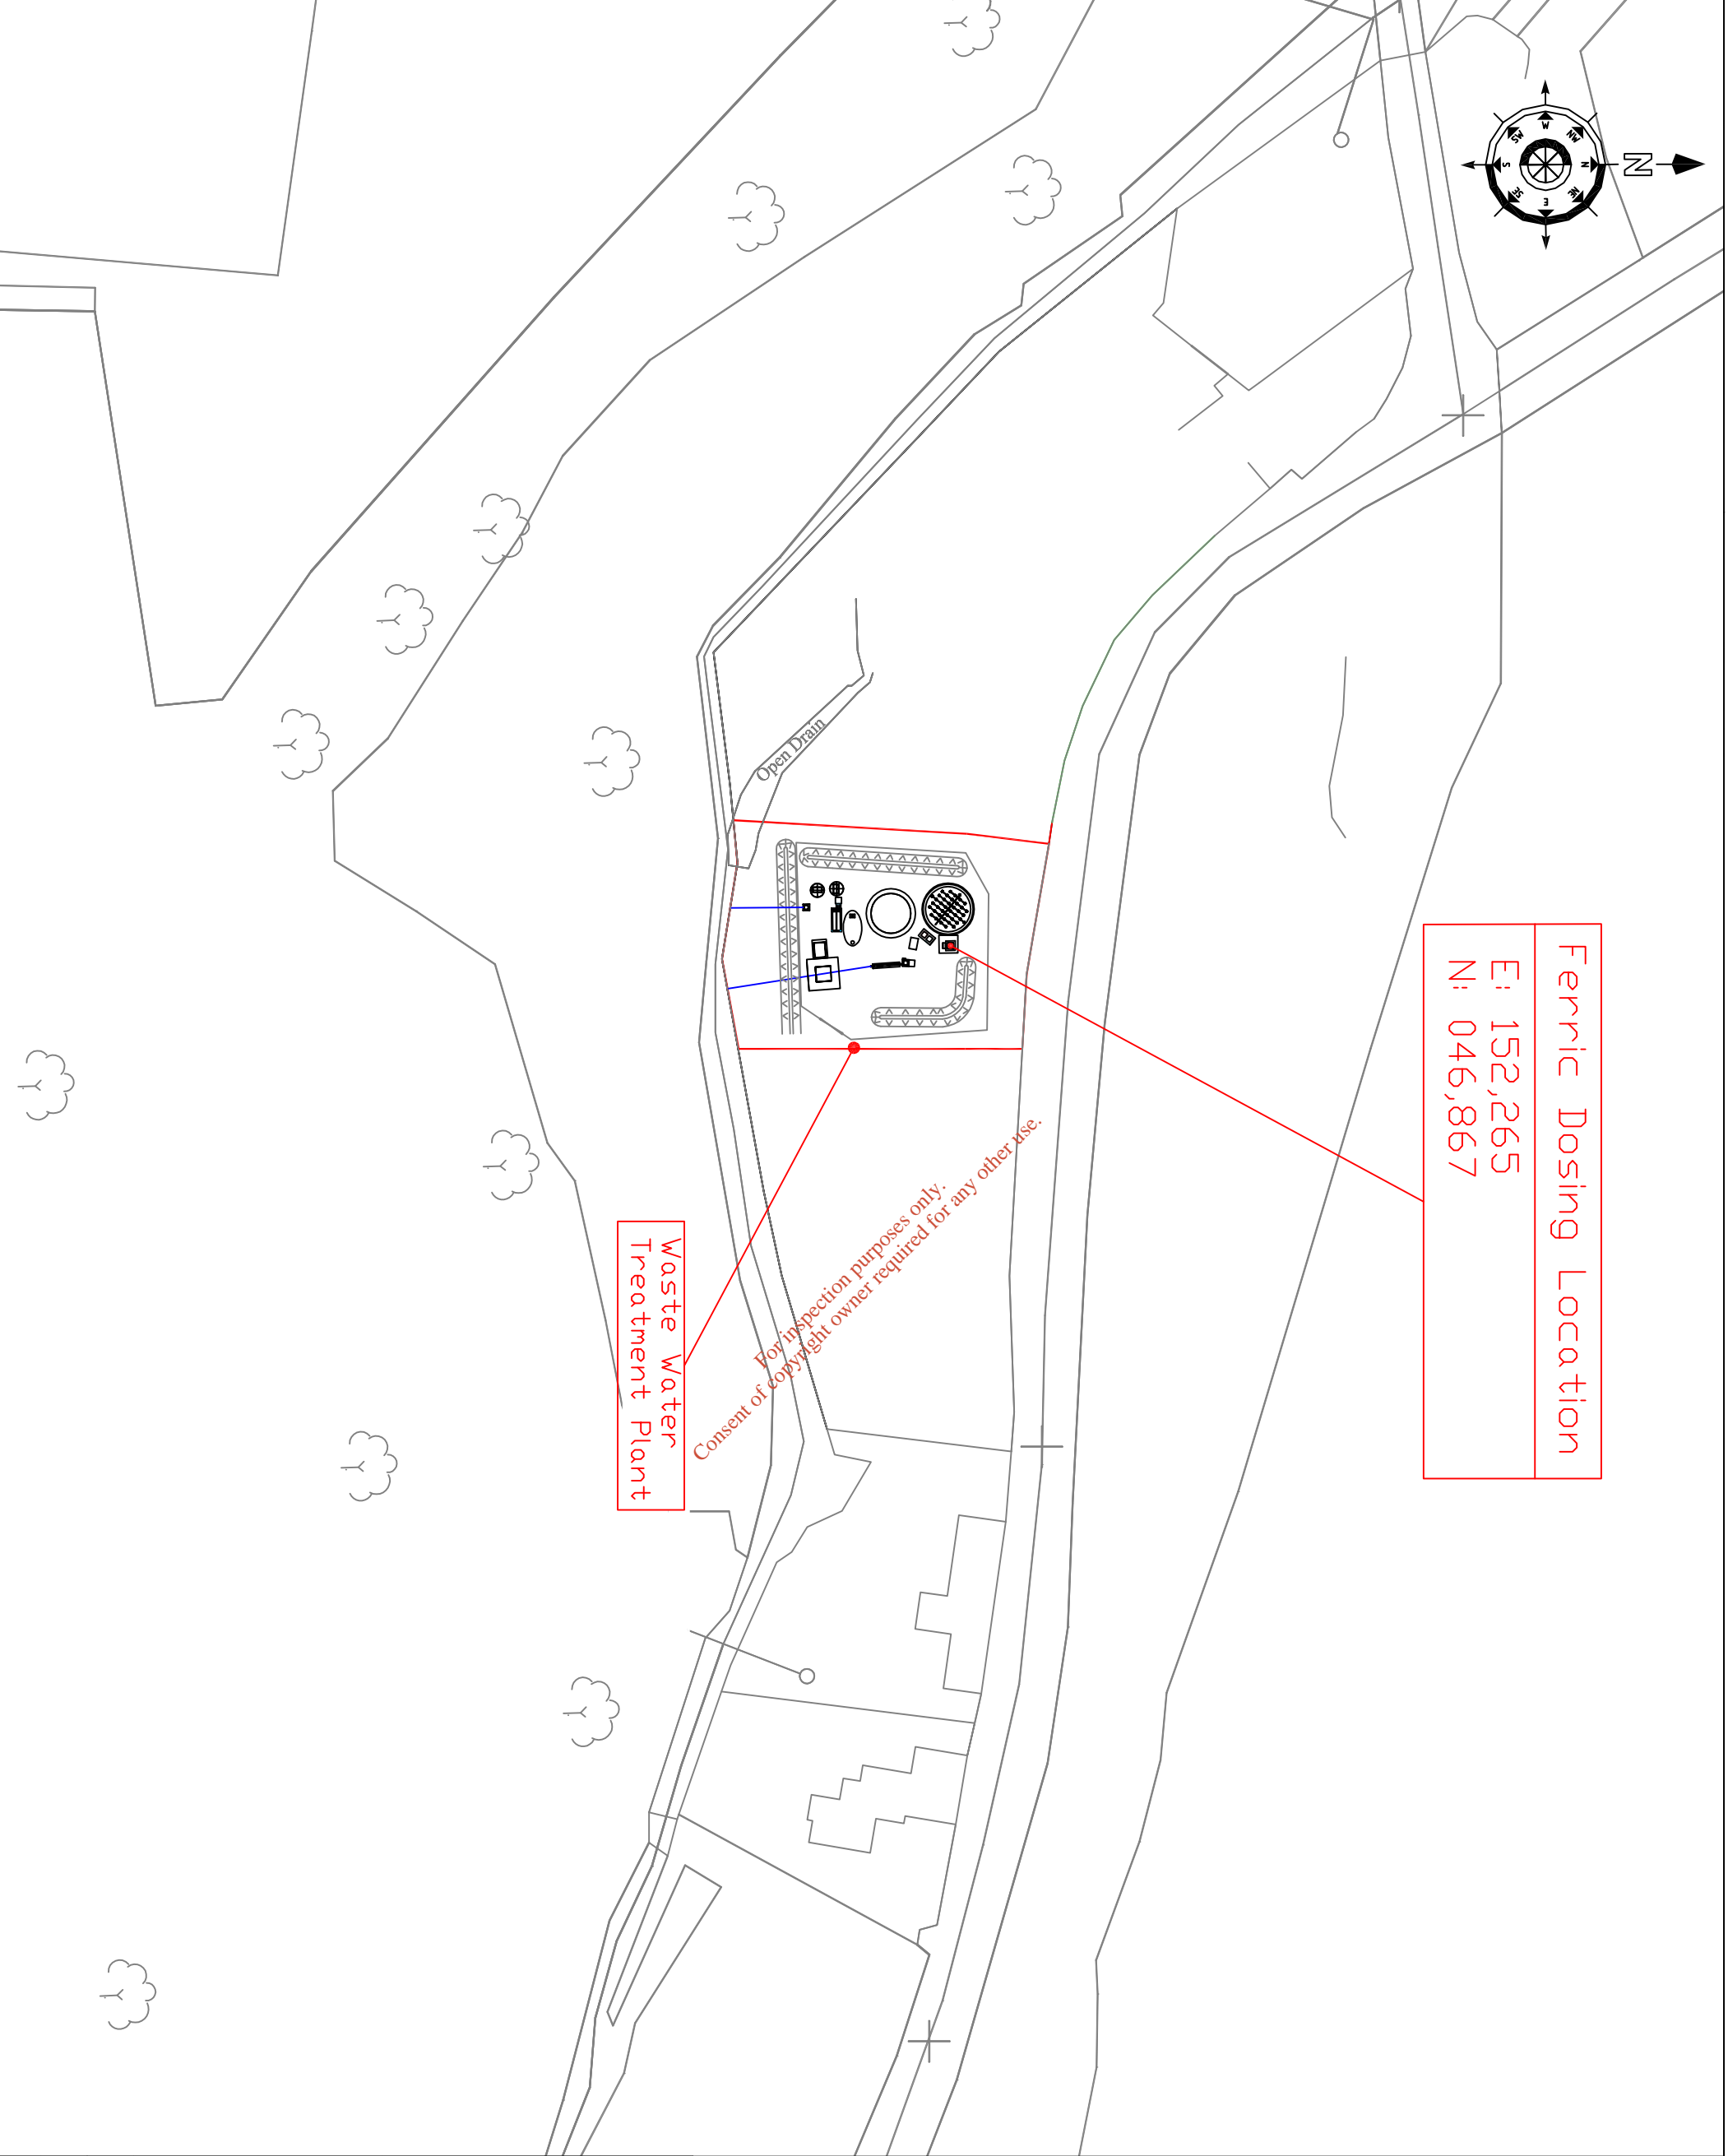


**NOTES**

1. Dimensions are not to be scaled from drawing. For any discrepancies found consult with the design office.
2. This drawing is to be read in conjunction with the WWDL Application.
3. This drawing is to be read in conjunction with all other WWDL Application drawings.

No.	Date	Drawn/Checked	Revision Description
A	7/21/2011	MD/TDR	Ferric dosing Location Added

**Cork County Council,  
Southern Division.**



N. O'KEEFE, B.E.,  
COUNTY ENGINEER,  
COUNTY HALL,  
CDR.K.

**Job Title:**  
Kilbrittain  
Wastewater Discharge  
Licence Application

**Drawing Title:**  
Ferric Dosing Location  
Attachment A1 - Map 4

<b>Scales:</b> 1:500 @ A3	<b>Surveyed by:</b> O.C.	<b>Drawn by:</b> O.C.
<b>Designed by:</b> T.O.H.	<b>Checked by:</b> MD	<b>Date:</b> June 2009
<b>Drawing number:</b> A1_Map4_A	<b>Rev:</b> A	