

Comhairle Contae Chorcaí Cork County Council

Administration
Environmental Licensing Programme
Office of Climate, Licensing & Resource Use
Environmental Protection Agency
Headquarters
P.O. Box 3000
Johnstown Castle Estate
Co. Wexford

Annabella,
Mala,
Co. Chorcaí.
Fón: (022) 21123 • Faics: (022) 21983
R-phost: northcork@corkcoco.ie
Suíomh Gréasáin: www.corkcoco.ie
Annabella,
Mallow,
Co. Cork.
Fón: (022) 21123 • Fax: (022)21983
R-phost: northcork@corkcoco.ie
Suíomh Gréasáin: www.corkcoco.ie
2nd June 2011



Request for a technical amendment to licence register number D0202-01 agglomeration of Mitchelstown

Dear Sir or Madam

Cork County Council request a technical amendment of licence register number D0202-01 under Section 33(1) of the wastewater discharge authorisation regulations S.I. 684 of 2007.

Cork County Council request the following changes to the licence

a. Condition 4.3, Schedule 2.1 & Schedule B.1 - the monitoring location to be defined as a sample prepared from a flow proportional and flow related composite sample that is prepared from samples collected from both the Mitchelstown Wastewater Treatment Plant and the IPPC facility Dairygold Co-Op Society Ltd. Register number P0404-02. This sample will be prepared on a flow ratio basis by combining the sample on a ratio using the known flows on the day of sampling. A copy of revised map E2 is submitted with this request and a revised table E3.

Rationale for request – the final discharge manhole for the combined discharge from both facilities is located in land that is privately owned by a third party. Both pipes travel separately to this location and do not combine until this manhole. This location does not have a source of electrical power and Cork County Council is unable to install electrical supplies as this land is privately owned. Furthermore it is not possible to install temporary portable equipment at this location as there are health and safety issues that relate to access for staff in both the agency and the local authorities.

b. Schedule A.1 - Cork County Council request a technical amendment of schedule A.1 that will set the ELV limits for the combined discharge from both locations at the urban wastewater limits as in condition 3.2 when there is no discharge from the IPPC facility. The IPPC facility is a seasonal operation and Cork County Council request that the urban wastewater limits as defined in condition number 3.2 be the limits when this occasion arises at those periods of the year.


Yours Sincerely

Michael Cotter
Senior Executive Engineer
Cork County Council

For inspection purposes only.
Consent of copyright owner required for any other use.

Attached – Map E2 and revised Table E3



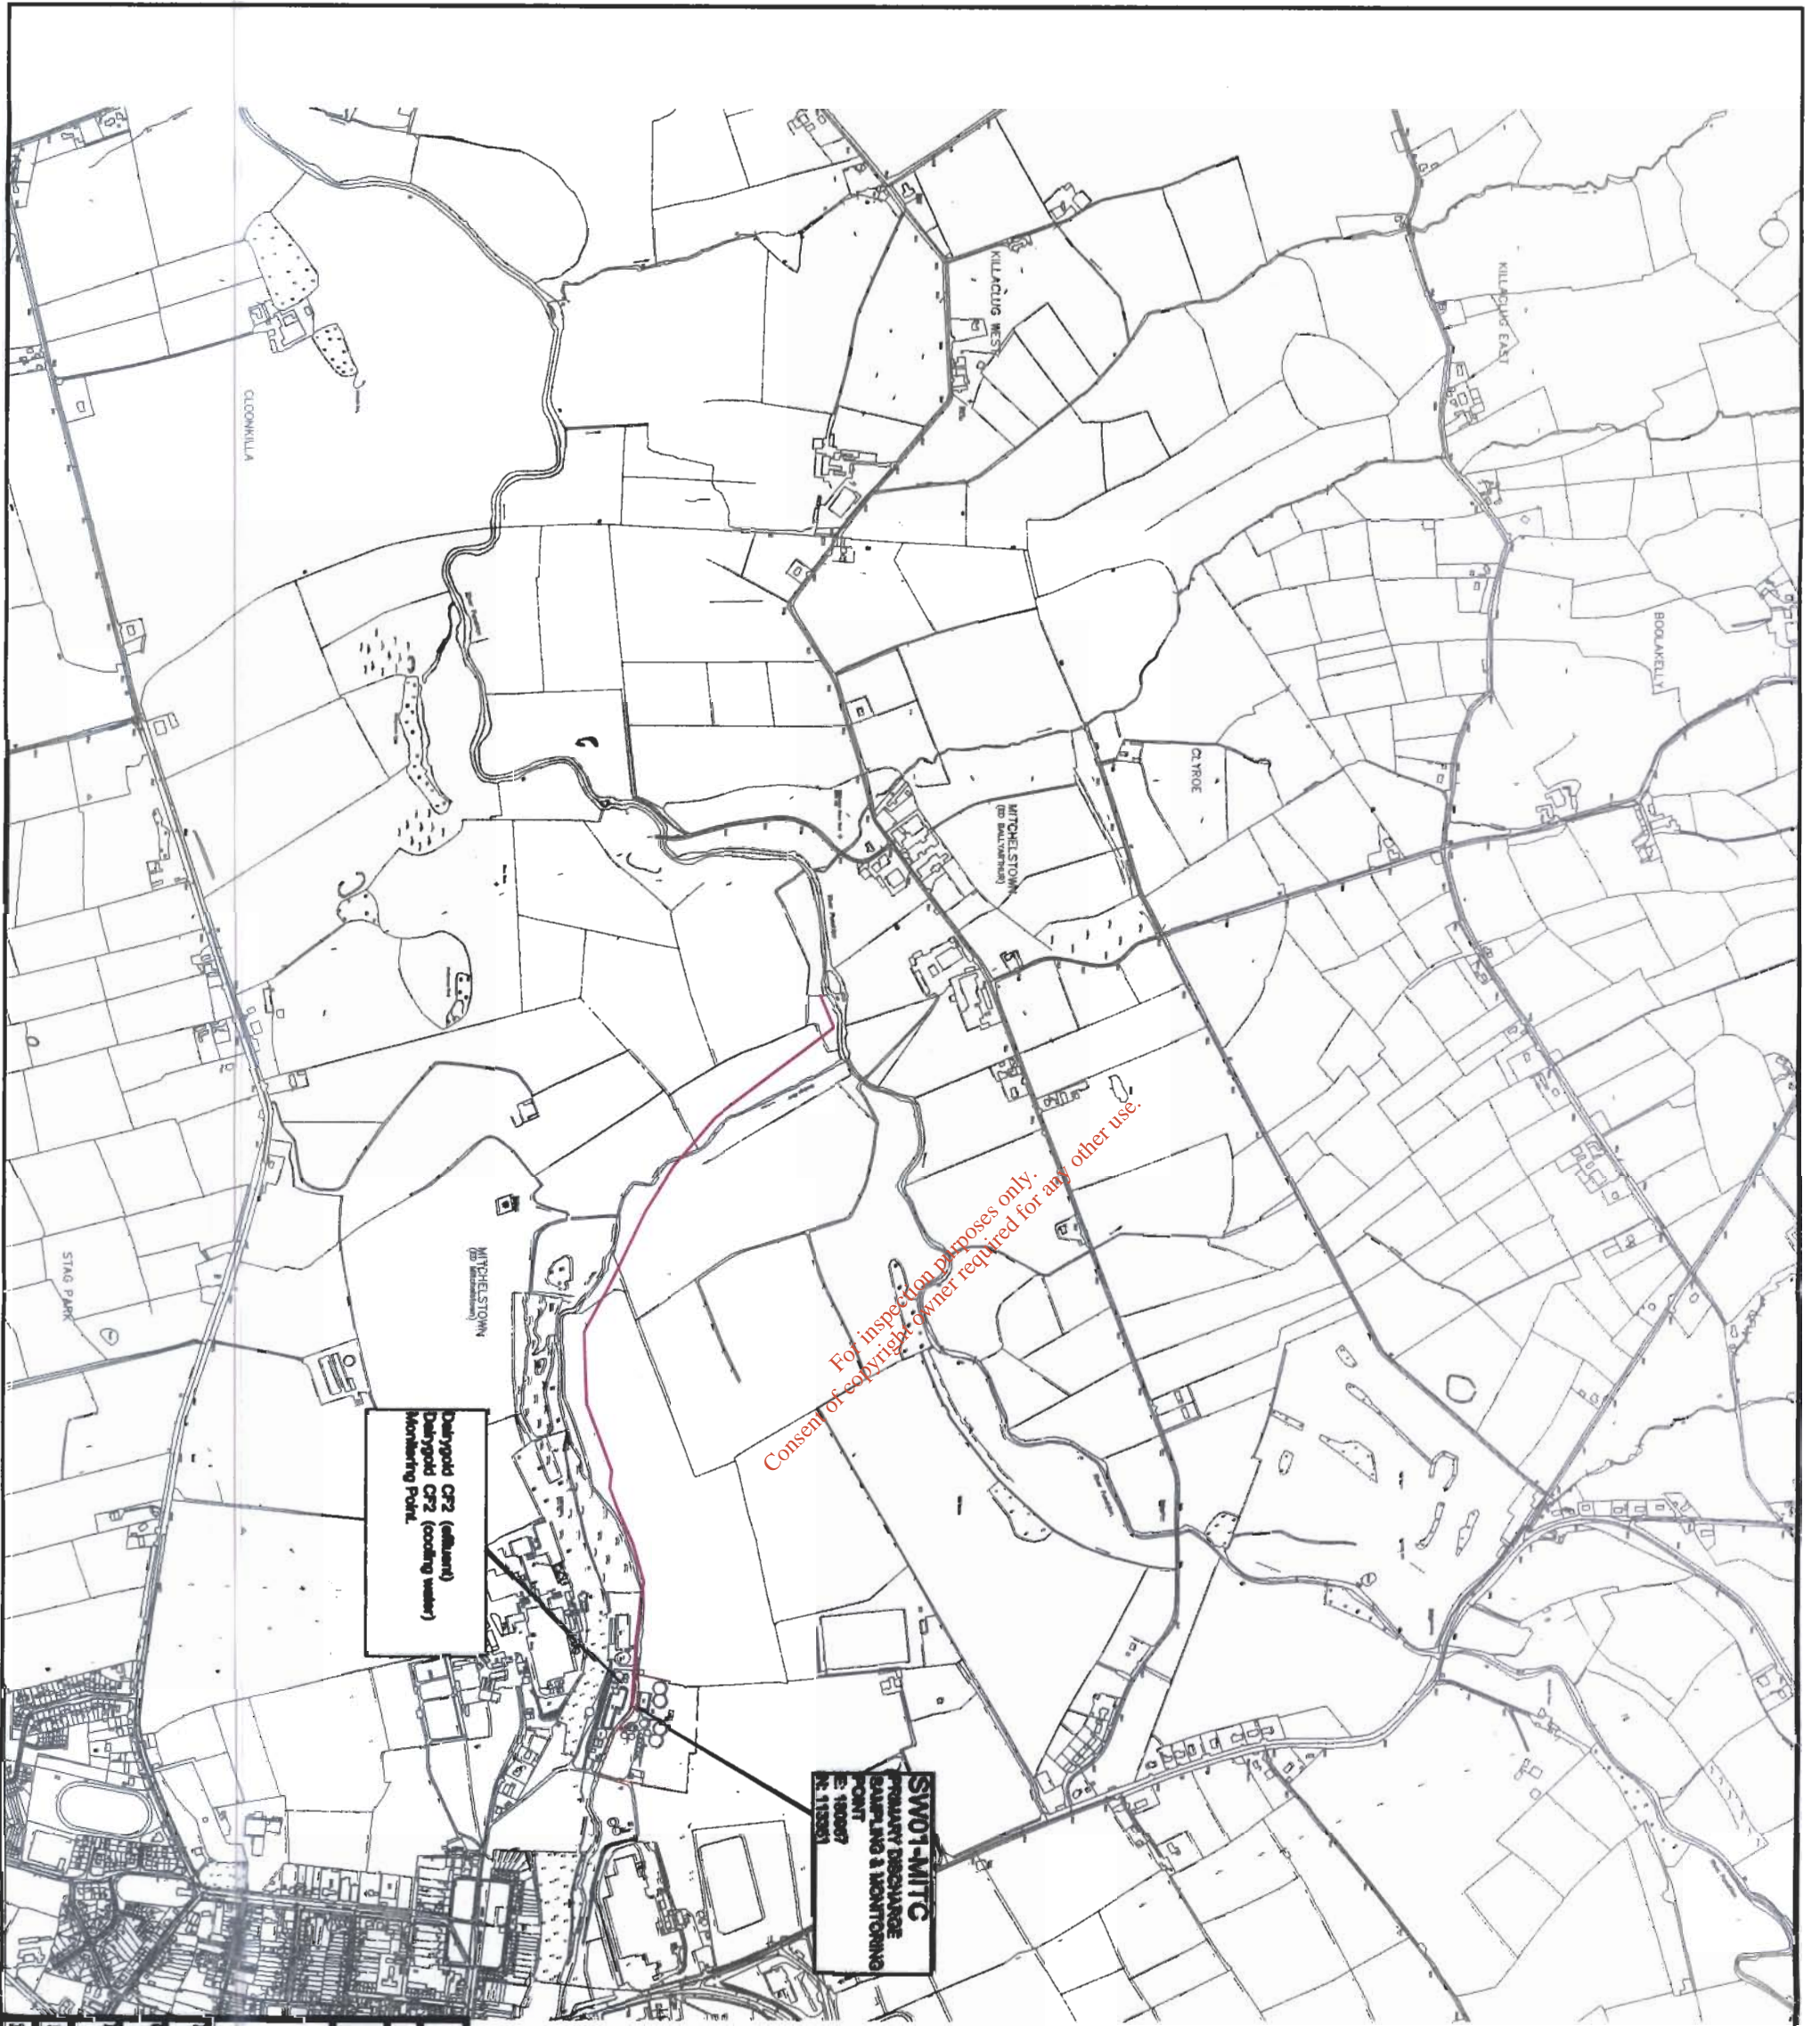

MAP REPRODUCED BY PERMISSION OF
ORDNANCE SURVEY IRELAND
(CORK CCMA 9802)

ISSUED FOR WASTEWATER LICENSE		SEPT'08
AMENDMENT DETAILS		
A		
T.J.O'CONNOR & ASSOCIATES CONSULTING ENGINEERS CORRIG ROAD, CORRIG ROAD, SANDYSTOWN, DUBLIN 18. TEL: 896 8281 FAX: 896 4641		
PROJECT: MITCHELSTOWN EPA DISCHARGE LICENSE APPLICATION		
CLIENT: CORK COUNTY COUNCIL		
DRAWING TITLE: ATTACHMENT B.2 - LOCATION OF MITCHELSTOWN WWTP		
SCALE: NTS	JOB NO: 2844	DRAWING NO: MITCHELSTOWN_B2_004
DATE: DRAWN BY: JH		