

Michael Martin
Environmental Licensing Programme
Office of Climate, Licensing & Resource Use
Environmental Protection Agency
PO Box 3000
Johnstown Castle Estate
Co. Wexford.

Uisce Éireann
Bosca OP 6000
Baile Átha Cliath 1
Éire

Irish Water
PO Box 6000
Dublin 1
Ireland

T: +353 1 89 25000
F: +353 1 89 25001
www.water.ie

16th October 2015

IW-ER-LT0295

Dear Michael Martin


RE: Coachford Water Discharge Licence Application D0427-01


In response to the Regulation 18(3)(b)-1 request for further information notice dated the 22nd September 2015, please see below relevant information.

Provide a map clearly detailing the boundary of the agglomeration to which this application relates. Please note that the agglomeration boundary shall be continuous and shall include the wastewater treatment plant and all areas serviced by the sewer network.

Please see the attached revised agglomeration map as requested.

Best Regards,


Gerry Galvin
Chief Technical Advisor

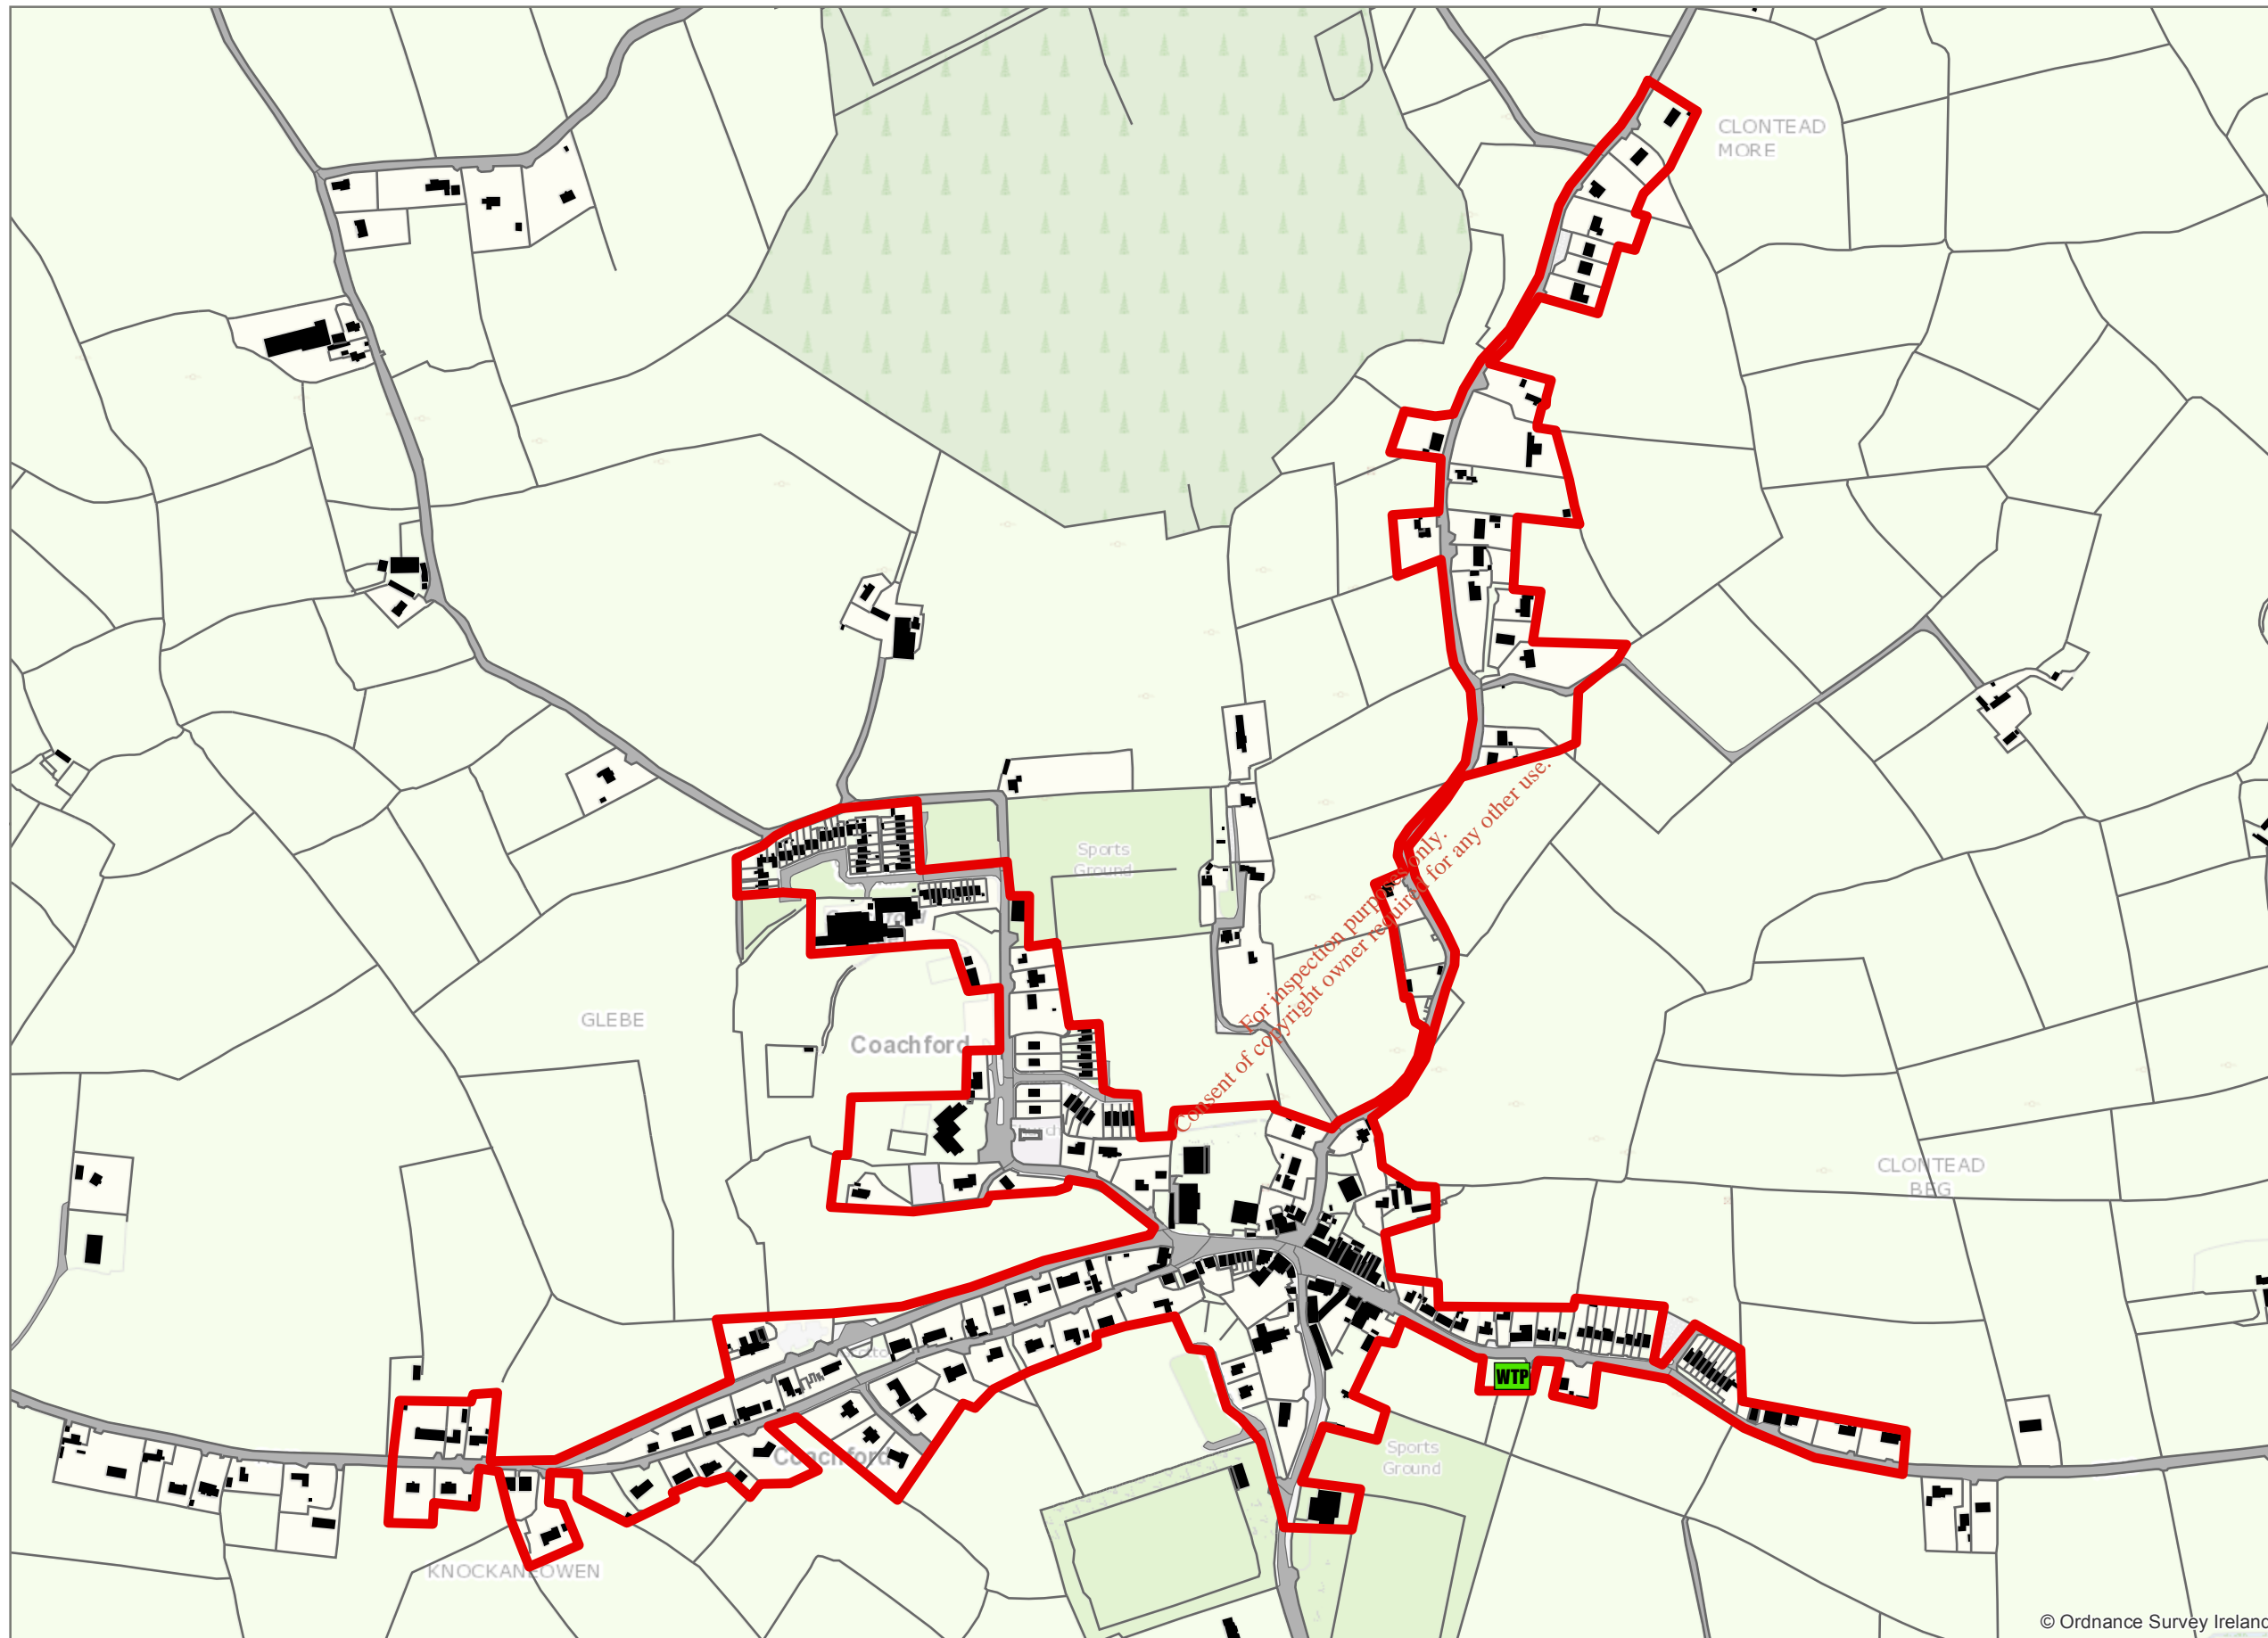

© Ordnance Survey Ireland

Legend

- WTP Treatment Plant
- Updated IW Agglomeration Boundary

0 37.5 75 150
Meters

Coordinate System: TM65 Irish Grid
Projection: Transverse Mercator

Scale @ A3: 1:6,000

Drawing No.: IW-AGG-2015-000x

Drawn By: E.Laurinaviciute

Checked By: M. O'Reilly

Approved By: M. O'Reilly

Drawn Date 09/10/2015

Checked Date: 09/10/2015

Approved Date: 02/10/2015



1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

© Copyright Irish Water

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

Map Template Design: kcarroll@water.ie

Agglomeration Boundary - Final Coachford - D0427