


Attachment 1

*For inspection purposes only.
Consent of copyright owner required for any other use.*

Biofilter Fan Exhaust
Emission Point AEF2

The information contained on this plan is the property of NRCGE and is not to be reproduced or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the expressed permission of NRCGE.

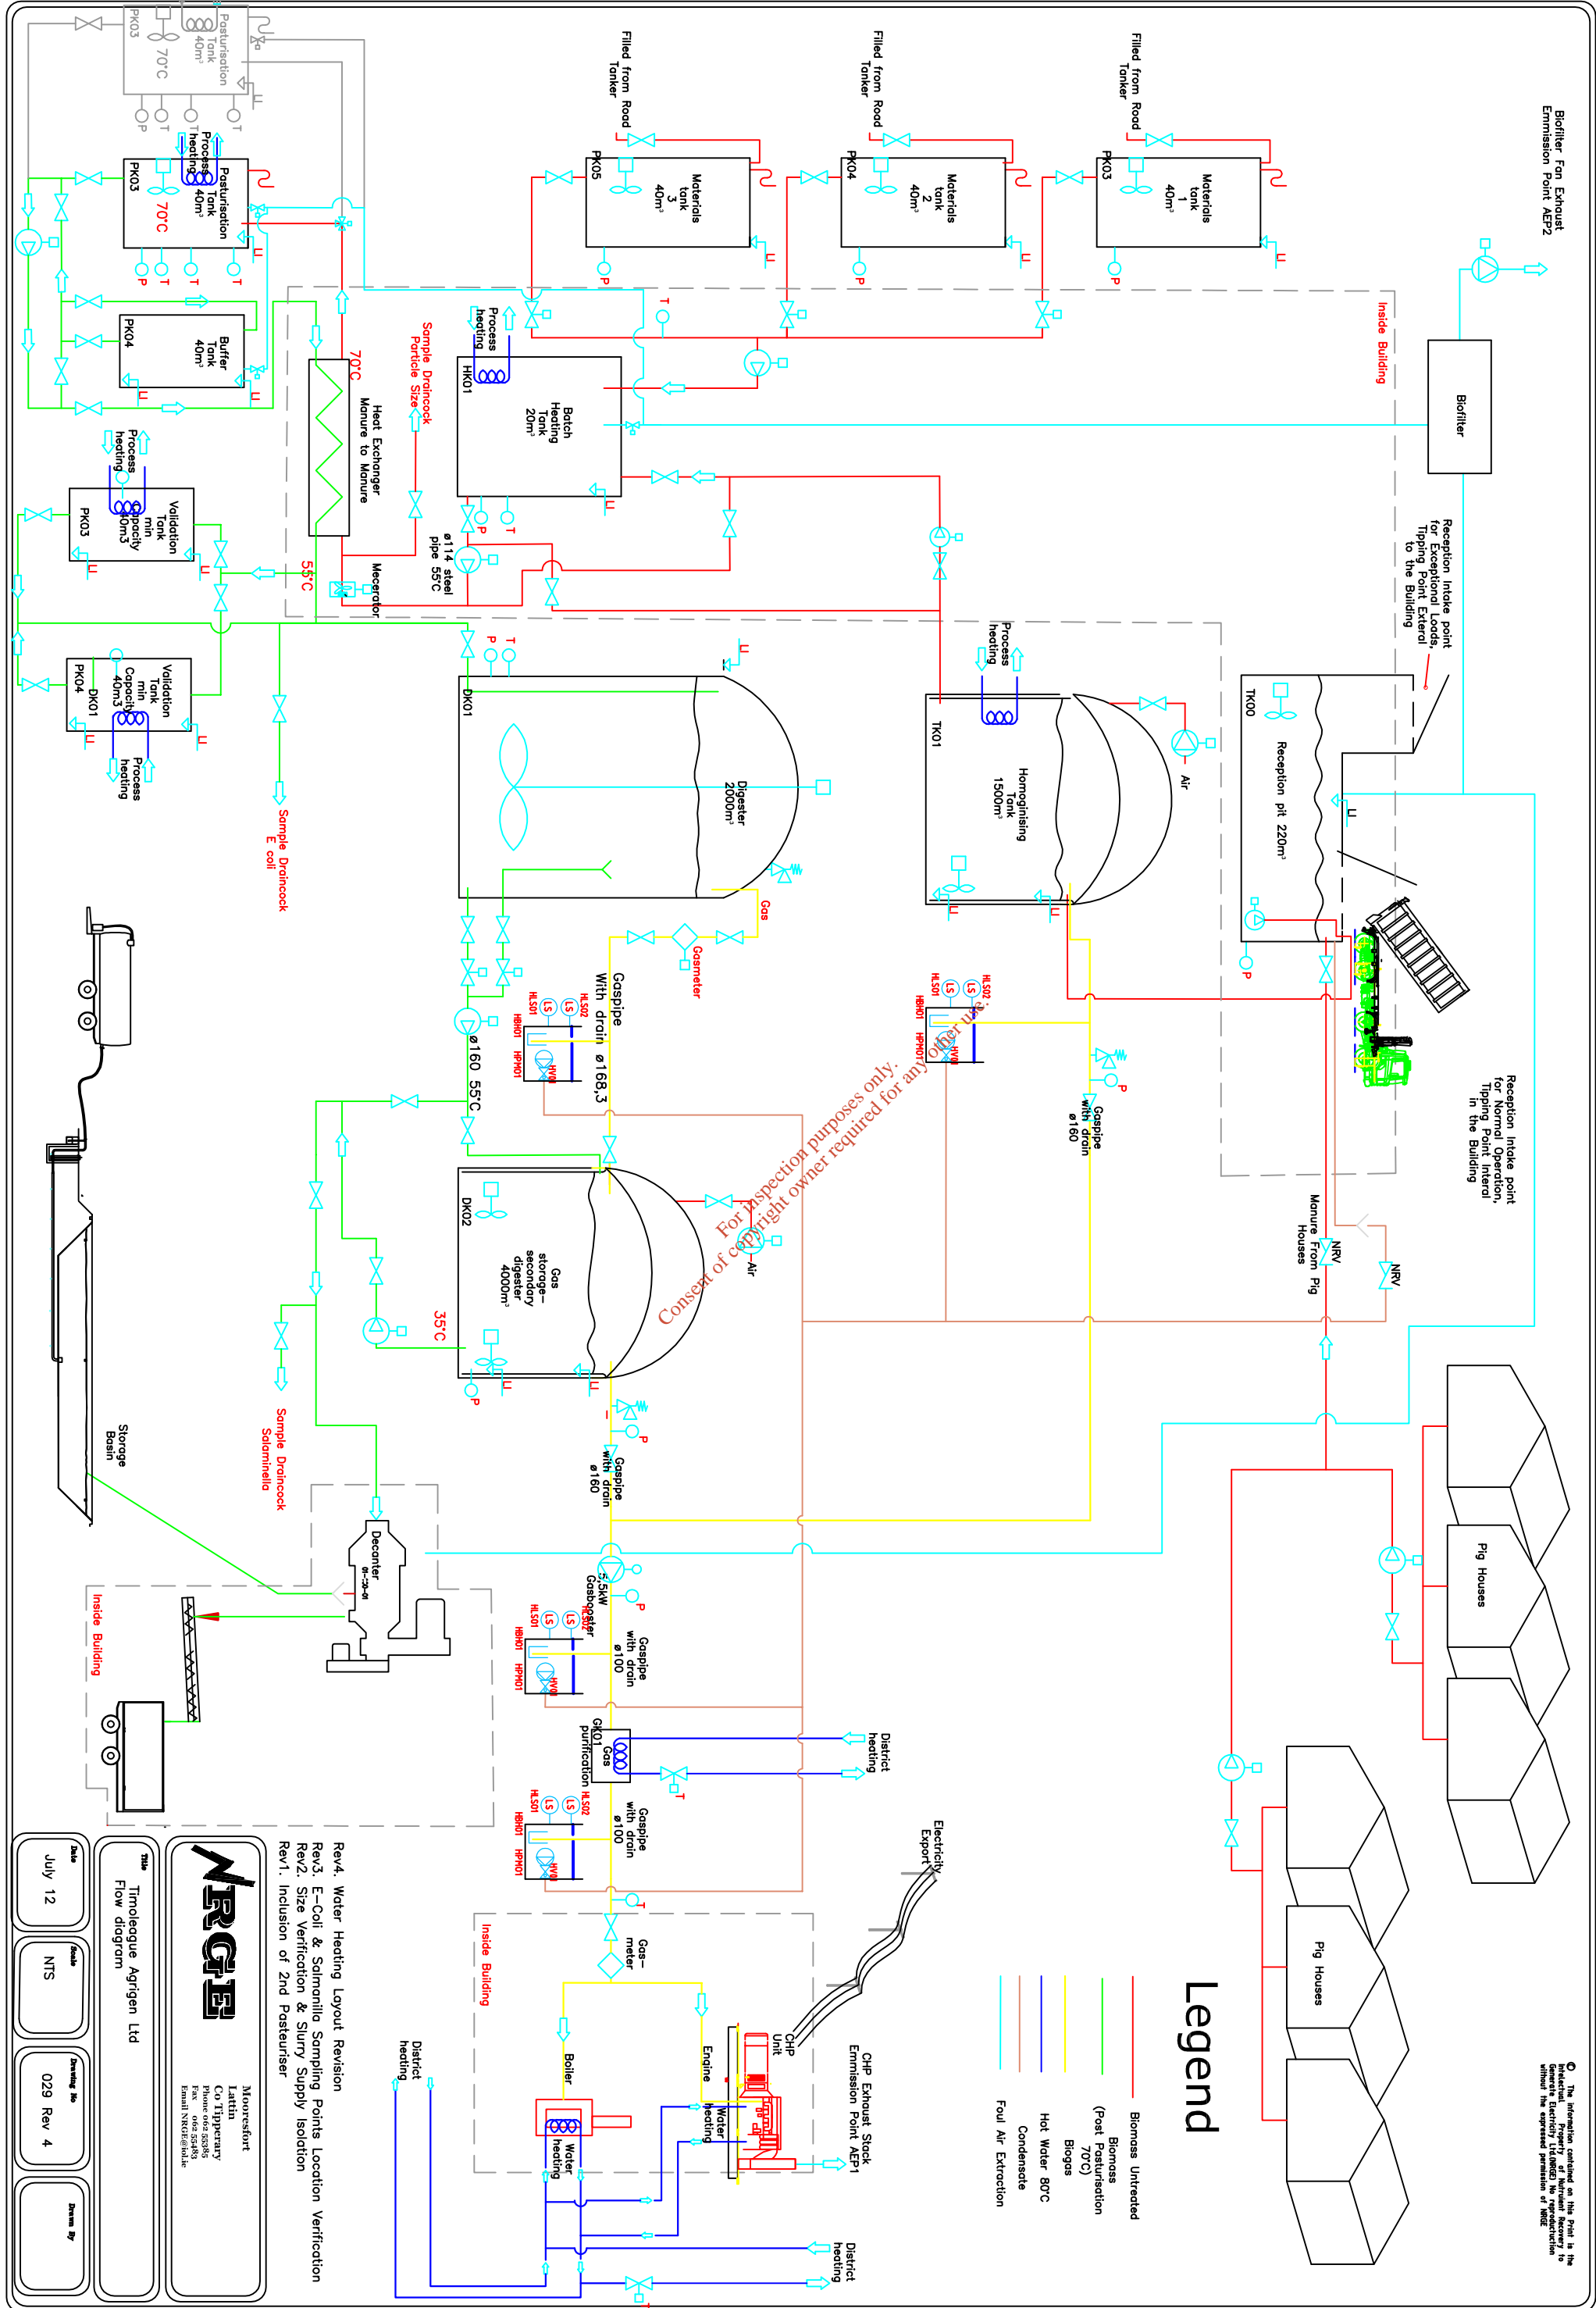

Legend

- Biomass Untreated
- Biomass (Post Pasturisation)
- Biogas
- Hot Water 80°C
- Condensate
- Foul Air Extraction

Rev4. Water Heating Layout Revision
 Rev3. E-Coil & Salmonella Sampling Points Location Verification
 Rev2. Size Verification & Slurry Supply Isolation
 Rev1. Inclusion of 2nd Pasturiser

NRCGE
 Moorecroft
 Lattin
 Co. Tipperary
 P.O. Box 25885
 Phone: 066 52485
 Fax: 066 52485
 Email: nrcge@nrcge.ie

Title: Timoleague Agrigen Ltd
 Flow diagram

Date	Author	Approved By	Drawn By
July 12	NTS	029 Rev 4	