

Unit 15
Melbourne Business Park
Model Farm Road
Cork



E:info@ocallaghanmoran.com
www.ocallaghanmoran.com
T: 021 434 5366

ANNUAL ENVIRONMENTAL REPORT
RILTA ENVIRONMENTAL LTD.
SITE 14-A1 GREENOGUE BUSINESS PARK
LICENCE NO. W0185-01
JANUARY 2017 – DECEMBER 2017

Prepared For: -

Rilta Environmental Ltd,
Greenogue Business Park,
Rathcoole,
County Dublin.

Prepared By: -

O' Callaghan Moran & Associates,
Unit 15 Melbourne Business Park,
Model Farm Road,
Cork.

29 March 2018

Project	Annual Environmental Report 2017			
Client	Rilta Environmental Ltd W0185-01			
Report No	Date	Status	Prepared By	Reviewed By
171950209	29/03/2018	Draft	Mr Neil Sandes PGeo EurGeol	Mr Jim O'Callaghan MSc
	29/03/2018	Final		

TABLE OF CONTENTS

	<u>PAGE</u>
1. INTRODUCTION.....	1
2. SITE DESCRIPTION	2
2.1 SITE LOCATION AND LAYOUT.....	2
2.2 WASTE MANAGEMENT ACTIVITIES	2
2.2.1 Waste Types & Processes.....	2
3. EMISSION MONITORING	4
3.1 SURFACE WATER MONITORING.....	4
3.2 GROUNDWATER MONITORING.....	4
3.3 WASTEWATER MONITORING	6
3.4 NOISE SURVEY.....	7
3.5 DUST MONITORING.....	7
4. SITE DEVELOPMENT WORKS	8
4.1 ENGINEERING WORKS.....	8
4.2 SUMMARY OF RESOURCE & ENERGY CONSUMPTION.....	8
5. WASTE RECEIVED AND CONSIGNED FROM THE FACILITY	9
6. ENVIRONMENTAL INCIDENTS AND COMPLAINTS	11
6.1 INCIDENTS	11
6.2 REGISTER OF COMPLAINTS	11
7. ENVIRONMENTAL DEVELOPMENT	12
7.1 ENVIRONMENTAL MANAGEMENT PROGRAMME REPORT.....	12
7.2 SITE MANAGEMENT STRUCTURE.....	12
7.3 ENVIRONMENTAL MANAGEMENT PROGRAMME	12
7.4 COMMUNICATIONS PROGRAMME	12
7.5 NUISANCE CONTROLS	12
8. OTHER REPORTS.....	13
8.1 EUROPEAN POLLUTANT RELEASE AND TRANSFER REGISTER.....	13
8.2 BUND INTEGRITY TEST REPORT	13
APPENDIX 1 -	Site Plan with Environmental Monitoring Locations
APPENDIX 2 -	European Pollutant Release and Transfer Register
APPENDIX 3 -	Schedule of Targets & Objectives 2017
APPENDIX 4 -	Proposed Targets & Objectives 2018
APPENDIX 5 -	Management Structure
APPENDIX 6 -	Bund Integrity Test Report

1. INTRODUCTION

This is the 2017 Annual Environmental Report (AER) for the Rilta Environmental Limited (Rilta) Materials Recovery Facility (MRF) located at Unit 14-A1 Greenogue Business Park, Rathcoole, County Dublin. The report covers the period from the 1st January 2016 to the 31st December 2017. The content of the AER is based on Schedule E of the Waste Licence (W0185-01).

2. SITE DESCRIPTION

2.1 Site Location and Layout

The facility is located within an industrial estate approximately 2km east of Newcastle village and approximately 2.5km west of Rathcoole village. Rilta have been operating at the facility since 2009.

2.2 Waste Management Activities

During the reporting period the licence allowed Rilta to accept and process up to 60,000 tonnes of waste per annum, as set out in Appendix A and summarised below:

2.2.1 Waste Types & Processes

During the reporting period, the facility was licensed to accept the following waste categories and maximum quantities, as specified in Schedule A of the Licence: -

- Household Waste (7,000 tonnes)
- Commercial & Industrial Waste (15,000 tonnes)
- Construction & Demolition Waste (1,000 tonnes)
- Sewage Sludge (2,000 tonnes)
- Industrial Sludge (2,000 tonnes)
- Hazardous Waste (as listed in Table E.2.2 entitled 'Hazardous waste Types and Quantities' of the application (33,000 tonnes)

Licensed Waste Disposal Activities, in accordance with the Third Schedule of the Waste Management Act, 1996:

Class 7: Physico-chemical treatment not referred to elsewhere in this Schedule (including evaporation, drying and calcination), which results in final compounds or mixtures, which are disposed of by means of any activity referred to in paragraphs 1 to 10 of this Schedule (including evaporation, drying and calcination);

This activity relates to the shredding of waste materials, including, household hazardous waste containers and metals, plastics, card and paper. Physico-chemical treatment may be carried out on effluents to meet discharge criteria.

Class 11: Blending or mixture prior to submission to any activity referred to in a preceding paragraph of this Schedule;

This activity relates to bulking-up of waste on-site prior to shipment of waste for disposal offsite.

Class 12: Repackaging prior to submission to any activity referred to in a preceding paragraph of this Schedule;

This activity relates to the baling and repackaging of various waste types prior to disposal off-site.

Class 13: Storage prior to submission to any activity referred to in a preceding paragraph of this Schedule, other than temporary storage, pending collection, on the premises where the waste concerned is produced;

This activity relates to the storage of hazardous and non-hazardous waste at the facility prior to disposal off-site.

Licensed Waste Disposal Activities, Fourth Schedule of the Waste Management Act, 1996.

Class 2: Recycling or reclamation of organic substances, which are not used as solvents (including composting and other biological transformation processes);

This activity relates to the recycling of various organic substances including, wood, paper/cardboard, textile materials and vegetable oils.

Class 3: Recycling or reclamation of metals and metal compounds;

This activity relates to the dismantling, shredding, baling and recycling of various metal wastes.

Class 4: Recycling or reclamation of other inorganic materials;

This activity is limited to the reclamation of refrigerator gasses.

Class 11: Use of waste obtained from any activity referred to in a preceding paragraph of this Schedule:

This activity is to make provision for the acceptance on-site for transfer to an appropriate facility of waste that has been obtained from any activity referred to previously in the Schedule.

Class 12: Exchange of waste for submission to any activity referred to in a preceding paragraph of this Schedule;

This activity refers to the exchange of certain waste types and their packaging for further processing off-site

Class 13: Storage of waste intended for submission to any activity referred to in a preceding paragraph of this Schedule, other than temporary storage, pending collection, on the premises where such waste is produced;

This activity is limited to the storage of waste at the facility prior to off-site recovery.

3. EMISSION MONITORING

Rilta implements the environmental monitoring programme specified in the licence to assess the significance of emissions from the site activities. The programme includes surface water, wastewater, groundwater, noise and dust monitoring. The monitoring locations are shown on the plan in Appendix A. The monitoring results are submitted to the Agency at quarterly intervals. An overview of the results is presented in this Section.

3.1 Surface Water Monitoring

Surface water monitoring was carried out quarterly at one location (SW1). There are no emission limit values (ELVs) or trigger levels set in the Licence. Following a request from the Agency, trigger levels were developed in September 2015 in accordance with the Agency's guidance on setting of trigger levels for storm water discharges to off-site surface waters at EPA licensed IPPC & Waste facilities based on data from Q-1 2009 to Q-3 2015.

Table 3.1 presents the surface water monitoring results in 2017. All parameters are below their respective warning levels.

Table 3.1 Surface water Monitoring Results 2017: SW1

Parameter	Units	Q1	Q2	Q3	Q4	Warning Level	Action Level
pH	pH units	6.68	8.15	7.67	6.91	8.78	9.34
Conductivity	mS/cm	168	493	197	175	573	715
COD	mg/l	<7	27	13	<7	57	76

3.2 Groundwater Monitoring

There are two groundwater monitoring wells on site (GW-1 and GW-2). The locations are shown on the plan in Appendix 1. GW-1 is in the southern section of the site and is upgradient of GW-2, which is in the northern end of the site.

Monitoring is carried out quarterly. The parameters analysed quarterly are pH, electrical conductivity, temperature, dissolved oxygen, chloride, sulphate, Total Organic Carbon. Annual monitoring of List I/II Organic Substances and dissolved metals are carried out annually.

Tables 3.2 to Table 3.5 include the groundwater analytical results for GW-1 and GW-2 for each quarter. The tables included for comparison purposes the Interim Guideline Values (IGV) prepared by the Agency and the groundwater Threshold Values (TV) from the Groundwater Regulations 2010.

All parameters were within the proposed trigger levels and below the IGV and TVs with the exception of the upgradient well (GW-1) where the manganese exceeded the IGV and chloride

exceeded the IGV but did not exceed the TV in Q3. The chloride concentration in MW-1 exceeded the IGV in Q4 also but the concentration was lower than the Q3 result and was just above the IGV. The cause of the elevated chloride and manganese is unknown but it is not associated with waste activities.

There were no further exceedances of the IGV or TVs throughout the year. There is no significant change in water quality between the upgradient and downgradient wells.

Table 3.2 Q1 Groundwater Monitoring Results

Parameter	Unit	GW-1 Up Gradient	GW-2 Down Gradient	IGV	TV
pH	pH Units	7.47	7.36	6.5-9.5	-
EC	µS/cm	685	698	1,000	875 – 1,875
Dissolved Oxygen	mg/l	7	7	NAC	-
Chloride	mg/l	18.8	13.6	30	187.5
Sulphate	mg/l	97.6	61.3	200	187.5
Total Organic Carbon	mg/l	<2	<2	NAC	-

Table 3.3 Q2 Groundwater Monitoring Results

Parameter	Unit	GW-1 Up Gradient	GW-2 Down Gradient	IGV	TV
pH	pH Units	7.54	7.43	6.5-9.5	-
EC	µS/cm	638	598	1,000	875 – 1,875
Dissolved Oxygen	mg/l	4	5	NAC	-
Chloride	mg/l	17.2	14.6	30	187.5
Sulphate	mg/l	82.3	61.4	200	187.5
Total Organic Carbon	mg/l	<2	<2	NAC	-

NAC – no abnormal change

Table 3.4 Q3 Groundwater Monitoring Results (Annual Parameters)

Parameter	Unit	GW-1 Up Gradient	GW-2 Down Gradient	IGV	TV
Boron	µg/l	17	29	1,000	750
Cadmium	µg/l	<0.5	<0.5	5	3.75
Calcium	mg/l	109.4	109.4	200	-
Copper	µg/l	<7	<7	30	1,500
Iron	µg/l	<20	<20	200	-
Lead	µg/l	<5	<5	10	18.75
Magnesium	mg/l	7.9	6.3	50	-
Manganese	µg/l	214	18	50	-
Nickel	µg/l	4	<2	20	15
Potassium	mg/l	1.0	3.0	5	-
Zinc	µg/l	4	<3	100	-
Sulphate	mg/l	79.6	68.8	200	187.5
Chloride	mg/l	44.3	11.4	30	187.5
Dissolved Oxygen	mg/l	6	6	NAC	-
Electrical Conductivity	µS/cm	658	331	1,000	875 – 1,875
pH	pH units	7.27	7.12	6.5-9.5	-
Total Organic Carbon	mg/l	4	7	NAC	-
VOC	µg/l	ND	ND	-	-
sVOC	µg/l	ND	ND	-	-

NAC – no abnormal change
 ND – None Detected

Table 3.5 Q4 Groundwater Monitoring Results

Parameter	Unit	GW-1 Up Gradient	GW-2 Down Gradient	IGV	TV
pH	pH Units	7.47	7.40	6.5-9.5	-
EC	µS/cm	593	607	1,000	875 – 1,875
Dissolved Oxygen	mg/l	7	6	NAC	-
Chloride	mg/l	31.3	11.0	30	187.5
Sulphate	mg/l	79.0	71.1	200	187.5
Total Organic Carbon	mg/l	<2	<2	NAC	-

NAC – no abnormal change

3.3 Wastewater Monitoring

The facility is designed to collect wastewater (foul) from floor wash downs in the warehouse building and discharge to it to the municipal sewer that serves the industrial estate. However, as putrescible wastes are not accepted at the facility and floor wash downs are not required, there is no wastewater discharge to sewer and no requirement for monitoring to be carried out.

3.4 Noise Survey

An annual noise survey is carried out. This was carried out in October 2017. Daytime noise monitoring was carried out at approved noise monitoring locations as shown on the site plan in Appendix 1 and the results are summarised in Table 3.6. Site operations were not audible at any of the stations and were therefore lower than the 55dB daytime limit as specified in the licence.

Table 3.6 Day-time Noise Survey Results

Station	N1	N2	N3
Period	Daytime	Daytime	Daytime
Ambient L_{Aeq} 30 min (dB)	64	58	52
Facility specific L_{Aeq} 30 min (dB)	52	<43	<43
Tone objectively detected	x	x	x
Tone attributable to facility	x	x	x
Facility audibly tonal	x	x	x
Facility audibly impulsive	x	x	x
Facility rated L_{Req} 30 min (dB)	52	<43	<43
Limit (dB)	55	55	55
Compliance	✓	✓	✓

3.5 Dust Monitoring

Dust monitoring was carried out in April/May, August/September and October/November. The results are in Table 3.7. In the October / November sampling round the dust jar at the monitoring location D-2 was lost, most likely as a result of the ex-hurricane Ophelia winds. There were no exceedances of the dust deposition limit (350 mg/m²/day) set in the Licence.

Table 3.7 Dust Monitoring Results 2017

	April / May mg/m ² /day	August / September mg/m ² /day	October / November mg/m ² /day	Deposition Limit mg/m ² /day
D-1	<10	<10	91	350
D-2	48	113	*	350
D-3	281	57	172	350
D-4	234	26	110	350

4. SITE DEVELOPMENT WORKS

4.1 Engineering Works

There was no engineering works completed in 2017 and none are proposed for 2018.

4.2 Summary of Resource & Energy Consumption

Table 4.1 is a summary of the resource and energy consumption during the reporting period and a comparison with the consumption in 2016.

Table 4.1 Resources Used On-Site in 2016 & 2017

Resources	Quantities 2016	Quantities 2017
Road Diesel	1360 litres	1,540 litres
Electricity	64,000 Kwh	77,000 Kwh
Water	840m ³	1,016m ³

5. WASTE RECEIVED AND CONSIGNED FROM THE FACILITY

Table 5.1 shows the total quantities of waste received and Table 5.2 shows the total quantities of waste consigned from the facility in 2017. Table 5.3 shows the quantities of waste received and consigned in previous years. A breakdown of the waste types is provided in accordance with the List of Waste. A more detailed description of the wastes consigned and the waste destinations are provided in the PRTR submission in Appendix 2.

The total amount received in 2017 was 3,373.8 tonnes. The total amount consigned was 3,313.026 tonnes. The difference in waste received into and consigned is 60.774 tonnes. This relates to waste that was on-site at the end of 2017 and which was consigned in 2018. All the wastes consigned from the site went to authorised recovery and disposal facilities.

Table 5.1 Waste Received 2017

EWC	Description	Waste In
16 02 11*	WEEE	89.36
16 02 13*	Transformers	1,023.35
16 02 14	Redundant Equipment	6.58
16 06 01*	Lead batteries	1,126.338
16 06 02*	Ni-Cd batteries	5.121
16 06 04*	Alkaline batteries (except 16 06 03)	4.778
16 06 05	Other batteries	0.801
17 06 01*	Insulation Material containing asbestos	47.920
17 06 05	Construction Materials containing asbestos	1,069.552

Table 5.2 Waste Consigned 2017

EWC	Description	Waste Out
13 03 07*	Mineral Based non-chlorinated insulating and heat transmission oils	158.35
15 01 10*	Packaging containing residues of or contaminated by dangerous substances	4.39
15 02 02*	Rags, cloths etc. containing dangerous substances	1.4
16 02 11*	Discarded equipment containing chlorofluorocarbons, HCFC, HFC	89.36
16 02 14	Discarded Equipment other than those mentioned in 16 02 09 to 16 02 13	6.58
16 06 01*	Lead batteries	1,126.338
16 06 02*	Ni-Cd batteries	5.121
16 06 04*	Alkaline batteries (except 16 06 03)	4.778
16 06 05	Other batteries	0.801
16 07 08*	Wastes containing oil	45.8
17 06 01*	Insulation Material containing asbestos	47.920
17 06 05	Construction Materials containing asbestos	1,069.552
19 12 02	Ferrous Metal	649.63
19 12 03	Non-ferrous Metal	136.18
20 01 27*	Paints, Inks, adhesives and resins containing dangerous substances	1.886
	Total Received	3,373.800
	Total Consigned	3,313.026
	Recovered	2,195.554
	Disposed	1,117.472
	Recovery Rate (%)	66.27%

Table 5.3 Waste Received & Consigned in Recent Years

	2016	2015	2014	2013	2012	2011
Total Received	1,673.14	1,332	2615.18	2614.40	2714	2617.5
Total Consigned	1630.91	1,403.541	2,546.67	2478.48	2788.20	2339.69
Total Recovered	1544.19	1,375.901	2,528.81	2474.98	2753.30	2339.69
Total Disposed	86.72	27.64	17.86	3.5	34.9	0
Recovery Rate	94.68%	98.03%	99.30%	99.86%	98.75%	100%

6. ENVIRONMENTAL INCIDENTS AND COMPLAINTS

6.1 Incidents

There were no notifiable environmental incidents in 2017.

6.2 Register of Complaints

Rilta maintains a register of complaints received in accordance with Condition 10.4 of the waste licence.

7. ENVIRONMENTAL DEVELOPMENT

7.1 Environmental Management Programme Report

RILTA has implemented an Integrated Management System (IMS) in accordance with the requirements of Occupational Health and Safety Assessment Series (OHSAS) 18001:2007 and International Standard Organisation (ISO) 14001:2004 in order to manage the Health, Safety and Environmental performance of their business and to control health and safety risk and to minimise their environmental aspects and impacts.

The IMS has been developed for the achievement of continual improvement taking into account the requirements of the Waste Licence Conditions. RILTA has prepared and effectively implement documented procedures and instructions in accordance with the requirements of both the OHSAS 18001:2007 and ISO 14001:2004. The facility was recertified in February 2015.

The schedule of the EMS Objectives and Targets, including their status for 2017 is included in Appendix 3.

7.2 Site Management Structure

Details of the site management structure are provided in Appendix 5.

7.3 Environmental Management Programme

The objectives that were achieved during this reporting period are outlined in Appendix 4.

7.4 Communications Programme

Rilta maintains a 'Public File' which contains all correspondence between Rilta and the Agency, all waste data and monitoring data as required by the licence. Opening Times for Inspection of Records are from 10 am – 4 pm. Visits to the site should be arranged in advance by ringing the Facility Manager at 01 401 8000

7.5 Nuisance Controls

Rilta has contracted an external vermin control company to carry out nuisance control at the facility.

8. OTHER REPORTS

8.1 European Pollutant Release and Transfer Register

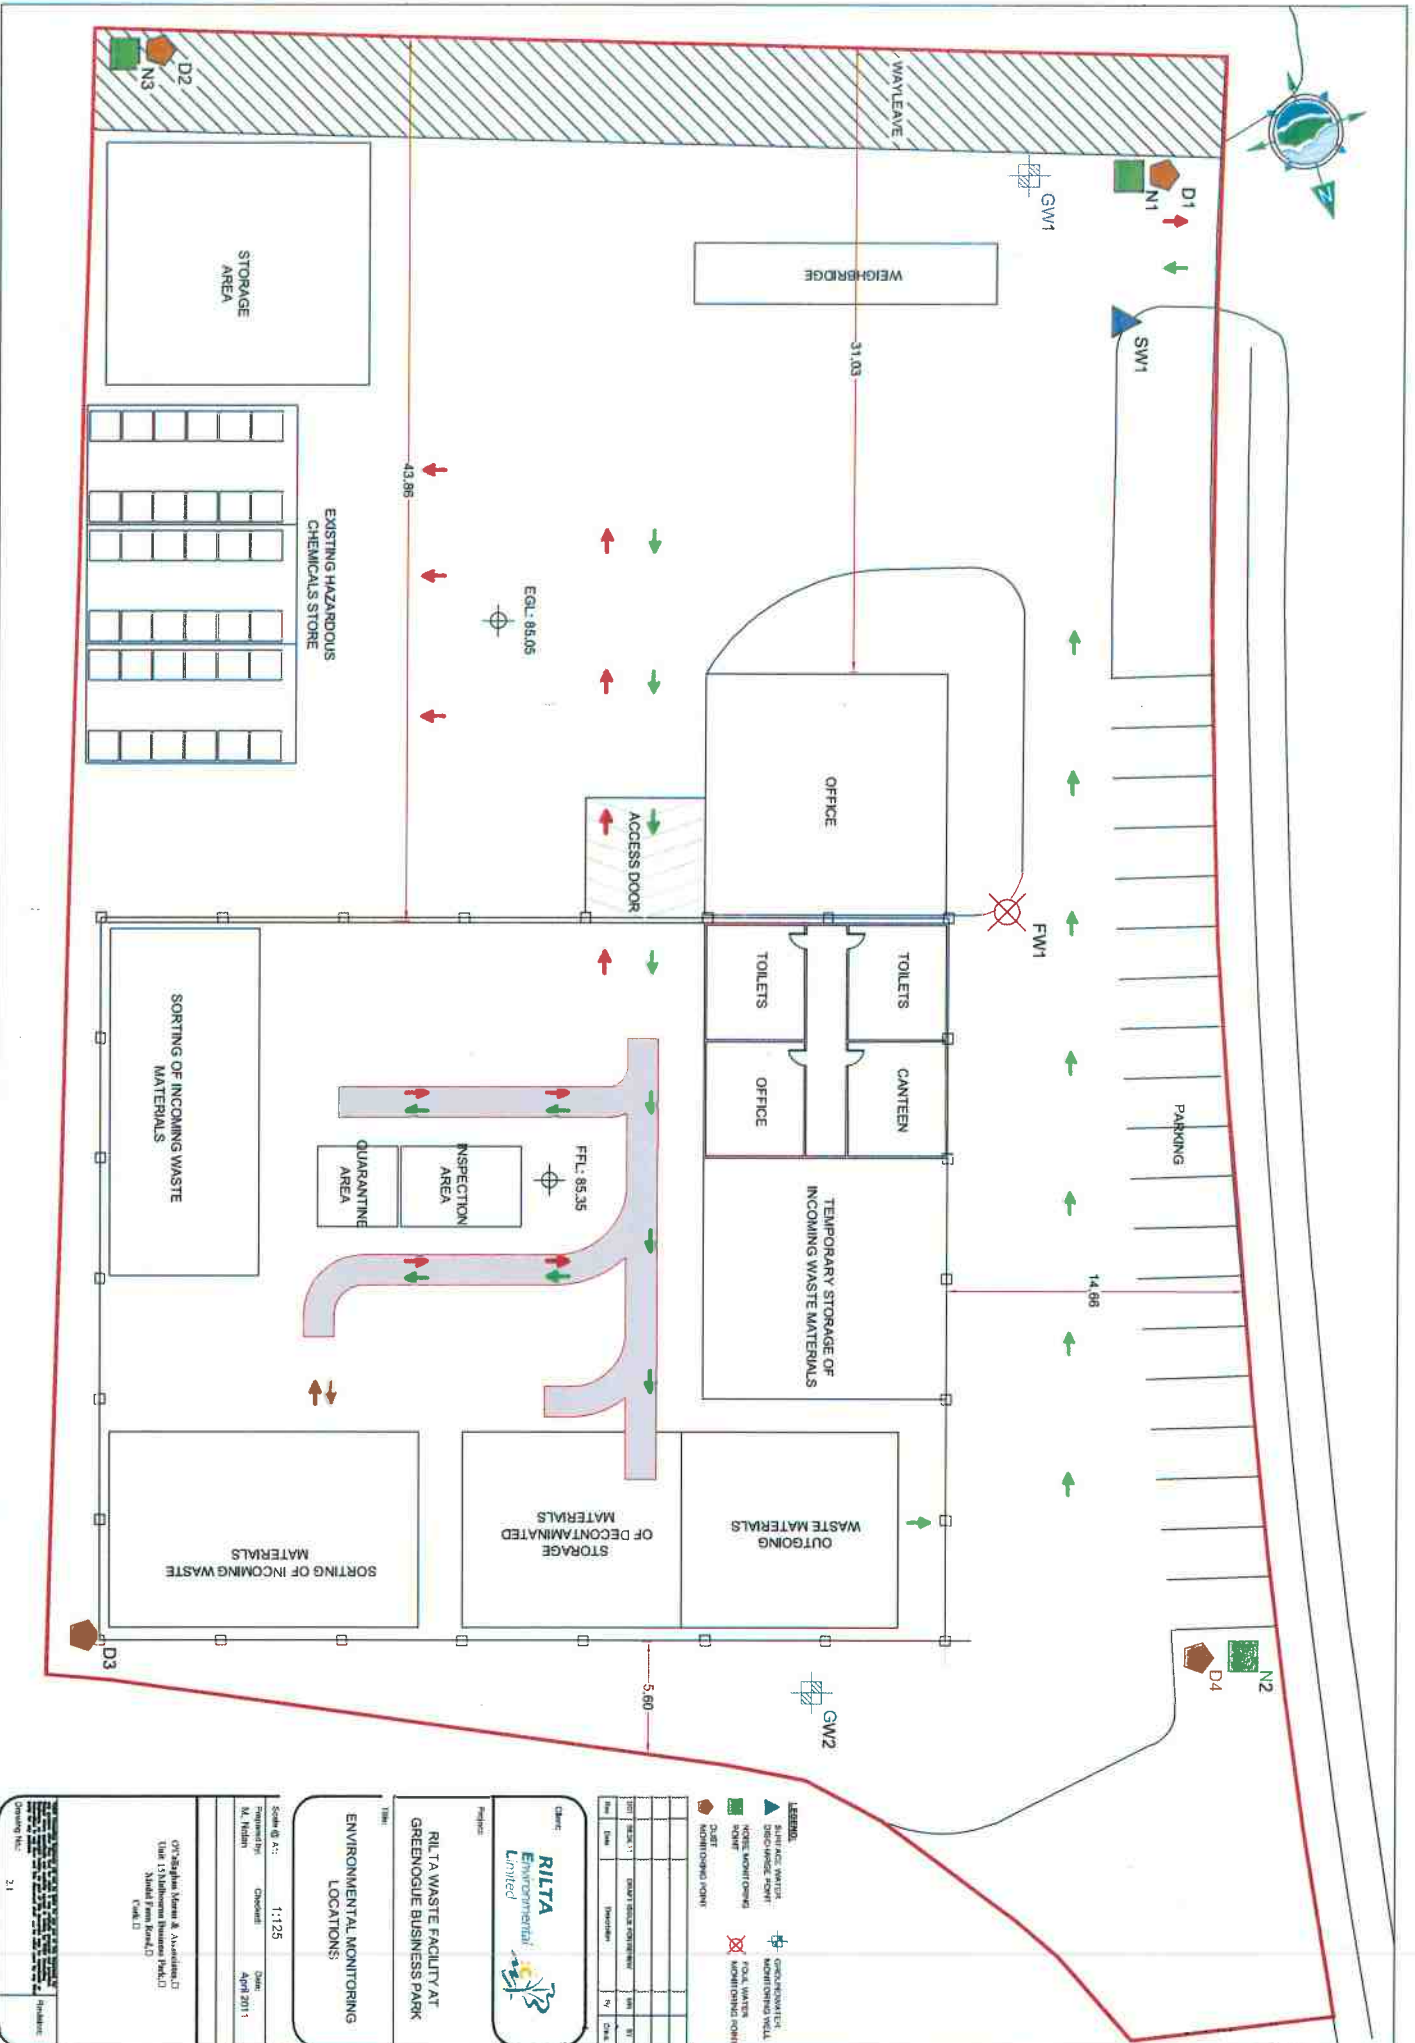
Under the European Pollutant Release and Transfer Register Regulation (EC) No. 166/2006 Rilta are required to submit information annually to the Agency. A copy of the information submitted to the Agency via the web-based data reporting system is in Appendix 2.

8.2 Bund Integrity Test Report

Bund integrity testing was completed in 2016. A copy of the report was submitted to the agency in 2016 and is included in Appendix 6.

APPENDIX 1

Site Plan showing Environmental Monitoring Locations



LEGEND

- DISCHARGE POINT
- MONITORING POINT
- DRAINAGE POINT
- DECONTAMINATION MONITORING POINT
- TOTAL WATER SUPPLY POINT
- DRAINAGE POINT

No.	Location	Inspector	Date	Result
1
2
3
4

Client: **RILTA Environmental Limited**

Project: **RILTA WASTE FACILITY AT GREENOUGE BUSINESS PARK**

Scale @ A1: 1:125

Prepared by: M. Nihan

Checked: M. Nihan

Date: April 2011

ENVIRONMENTAL MONITORING LOCATIONS

07-349488 Wexham & Associates Ltd
 1000 The Heights
 Sharnally Farm, Kesh, Co. Wick, Ireland

Ordinance Survey Ireland Licence number: EI4 001 6005 © Ordnance Survey Ireland Government of Ireland

21

APPENDIX 2

European Pollutant Release and Transfer Register



Environmental Protection Agency

| PRTR# : W0185 | Facility Name : Rilta Environmental | Filename : W0185_2017.xls | Return Year : 2017 |

[Guidance to completing the PRTR workbook](#)

PRTR Returns Workbook

Version 1.1.19

REFERENCE YEAR	2017
-----------------------	------

1. FACILITY IDENTIFICATION

Parent Company Name	Rilta Environmental Limited
Facility Name	Rilta Environmental
PRTR Identification Number	W0185
Licence Number	W0185-01

Classes of Activity

No.	class_name
-	Refer to PRTR class activities below

Address 1	Block 402, Grant Drive
Address 2	Greenogue Business Park
Address 3	Rathcoole
Address 4	
	Dublin
Country	Ireland
Coordinates of Location	-6.47708 53.2999
River Basin District	IEEA
NACE Code	3832
Main Economic Activity	Recovery of sorted materials
AER Returns Contact Name	Colm Hussey
AER Returns Contact Email Address	colm.hussey@rilta.ie
AER Returns Contact Position	Facility Manager
AER Returns Contact Telephone Number	0879176264
AER Returns Contact Mobile Phone Number	
AER Returns Contact Fax Number	
Production Volume	0.0
Production Volume Units	
Number of Installations	0
Number of Operating Hours in Year	0
Number of Employees	78
User Feedback/Comments	New waste streams this year which has led to new LoW codes and larger volumes on the whole
Web Address	

2. PRTR CLASS ACTIVITIES

Activity Number	Activity Name
5(a)	Installations for the recovery or disposal of hazardous waste
5(c)	Installations for the disposal of non-hazardous waste
50.1	General

3. SOLVENTS REGULATIONS (S.I. No. 543 of 2002)

Is it applicable?	No
Have you been granted an exemption ?	
If applicable which activity class applies (as per Schedule 2 of the regulations) ?	
Is the reduction scheme compliance route being used ?	

4. WASTE IMPORTED/ACCEPTED ONTO SITE

[Guidance on waste imported/accepted onto site](#)

Do you import/accept waste onto your site for on-site treatment (either recovery or disposal activities) ?	
--	--

This question is only applicable if you are an IPPC or Quarry site

4.1 RELEASES TO AIR

[Link to previous years emissions data](#)

PRTR : W0165 | Facility Name : Pinta Environmental | Filtration : W0165_2017.xls | Return Year : 2017

25/03/2018 15:59

SECTION A : SECTOR SPECIFIC PRTR POLLUTANTS

POLLUTANT		RELEASES TO AIR		METHOD		QUANTITY		
No. Annex II	Name	M/C/E	Method Used	Designation or Description	Emission Point 1	T (Total) KG/Year	A (Accidental) KG/Year	F (Fugitive) KG/Year
						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION B : REMAINING PRTR POLLUTANTS

POLLUTANT		RELEASES TO AIR		METHOD		QUANTITY		
No. Annex II	Name	M/C/E	Method Used	Designation or Description	Emission Point 1	T (Total) KG/Year	A (Accidental) KG/Year	F (Fugitive) KG/Year
						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION C : REMAINING POLLUTANT EMISSIONS (As required in your Licence)

POLLUTANT		RELEASES TO AIR		METHOD		QUANTITY		
Pollutant No.	Name	M/C/E	Method Used	Designation or Description	Emission Point 1	T (Total) KG/Year	A (Accidental) KG/Year	F (Fugitive) KG/Year
						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

Additional Data Requested from Landfill operators

For the purposes of the National Inventory on Greenhouse Gases, landfill operators are requested to provide summary data on landfill gas (Methane) flared or utilised on their facilities to accompany the figures for total methane generated. Operators should only report their Net methane (CH₄) emission to the environment under T (total) KG/yr for Section A; Sector specific PRTR pollutants above. Please complete the table below:

Landfill:	Methane flared	Methane utilised in engines/A above	Net methane emission (as reported in Section A above)	Method Used		Facility Total Capacity m3 per hour
				M/C/E	Designation or Description	
Pinta Environmental	0.0	0.0	0.0			N/A
	0.0	0.0	0.0			0.0 (Total Flaring Capacity)
	0.0	0.0	0.0			0.0 (Total Utilising Capacity)

4.2 RELEASES TO WATERS [Link to previous years emissions data](#)

[PRTR# : W0185 | Facility Name : Rilita Environmental | Filename : W0185_2017.xls | Return Year : 2017]

29/03/2018 15:32

SECTION A : SECTOR SPECIFIC PRTR POLLUTANTS **Data on ambient monitoring of storm/surface water or groundwater, conducted as part of your licence requirements, should NOT be submitted under AER / PRTR Reporting as I Please enter all quantities in this section in KGs**

POLLUTANT	Name	M/C/E	Method Used		Emission Point 1	T (Total) KG/Year	QUANTITY	
			Method Code	Description or Description			A (Accidental) KG/Year	F (Fugitive) KG/Year
No. Annex II						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION B : REMAINING PRTR POLLUTANTS **Please enter all quantities in this section in KGs**

POLLUTANT	Name	M/C/E	Method Used		Emission Point 1	T (Total) KG/Year	QUANTITY	
			Method Code	Description or Description			A (Accidental) KG/Year	F (Fugitive) KG/Year
No. Annex II						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION C : REMAINING POLLUTANT EMISSIONS (as required in your Licence) **Please enter all quantities in this section in KGs**

POLLUTANT	Name	M/C/E	Method Used		Emission Point 1	T (Total) KG/Year	QUANTITY	
			Method Code	Description or Description			A (Accidental) KG/Year	F (Fugitive) KG/Year
Pollutant No.						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

4.3 RELEASES TO WASTEWATER OR SEWER

[Link to previous years emissions data](#)

PRTR : W0105 : Facility Name : (Data Entry/Amend) | Emission : W0105_2017.xls : Return Year :

5/20/2018 16:15:35

SECTION A : PRTR POLLUTANTS

No. Annex II	Name	M/C/E	METHOD		Emission Point 1	QUANTITY		
			Method Code	Method Used Designation or Description		T (Total) KG/Year	A (Accidental) KG/Year	F (Fugitive) KG/Year
						0.0	0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION B : REMAINING POLLUTANT EMISSIONS (as required in your Licence)

Pollutant No.	Name	M/C/E	METHOD		Emission Point 1	QUANTITY		
			Method Code	Method Used Designation or Description		T (Total) KG/Year	A (Accidental) KG/Year	F (Fugitive) KG/Year
						0.0	0.0	0.0

4.4 RELEASES TO LAND [Link to previous years emissions data](#)

| PRTR# : W0185 | Facility Name : Rilita Environmental | Filename : W0185_2017.xls | Return Year : 2017 |

28/03/2018 15:34

SECTION A : PRTR POLLUTANTS

POLLUTANT		METHOD		Please enter all quantities in this section in KGs		
No. Annex II	Name	M/C/E	Method Used Designation or Description	Emission Point 1	T (Total) KG/Year	A (Accidental) KG/Year
					0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

SECTION B : REMAINING POLLUTANT EMISSIONS (as required in your Licence)

POLLUTANT		METHOD		Please enter all quantities in this section in KGs		
Pollutant No.	Name	M/C/E	Method Used Designation or Description	Emission Point 1	T (Total) KG/Year	A (Accidental) KG/Year
					0.0	0.0

* Select a row by double-clicking on the Pollutant Name (Column B) then click the delete button

5. ONSITE TREATMENT & OFFSITE TRANSFERS OF WASTE
Please enter all quantities on this sheet in Tonnes

Transfer Destination	European Waste Code	Hazardous	Quantity (Tonnes per Year)	Description of Waste	Waste Treatment Operation	M/C/E	Method Used		Location of Treatment	Haz. Waste Name and Licence/Permit No of Next Destination Facility Haz. Waste Name and Licence/Permit No of Receiver/Disposer	Haz. Waste Name and Licence/Permit No of Next Destination Facility Haz. Waste Name and Licence/Permit No of Receiver/Disposer	Name and Licence/Permit No. and Address of Final Receiver/Disposer (HAZARDOUS WASTE ONLY)	Actual Address of Final Destination (HAZARDOUS WASTE ONLY)
							Method Used	Method Used					
Within the Country	13 03 07	Yes	159.35	mineral-based non-chlorinated insulating mineral-based non-chlorinated insulating oils	R9	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	13 05 07	Yes	2.28	oil/water from oil/water separators	D9	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
To Other Countries	16 02 11	Yes	89.36	discarded equipment containing chlorofluorocarbons, HCFC, HFC	R4	M	Weighted	Abroad	Tech Rec NI, Dungannon, Co. Tyrone, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	16 02 14	No	6.58	discarded equipment other than those mentioned in 16 02 09 to 16 02 13	R4	M	Weighted	Offsite in Ireland	Hegarty Metals, Permit No. WP 05/04	Dock Road, Limerick, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	16 07 08	Yes	45.8	wastes containing oil	D9	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	19 12 02	No	649.63	ferrous metal	R4	M	Weighted	Offsite in Ireland	Hegarty Metals, Permit No. WP 05/04	Dock Road, Limerick, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	19 12 03	No	136.18	non-ferrous metal	R4	M	Weighted	Offsite in Ireland	Hegarty Metals, Permit No. WP 05/04	Dock Road, Limerick, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	20 01 27	Yes	1.886	paint, inks, adhesives and resins containing dangerous substances	R13	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	15 01 10	Yes	4.39	packaging containing residues of or contaminated by dangerous substances absorbents, filter materials (including oil filters not otherwise specified), wiping cloths, protective clothing contaminated by dangerous substances	R13	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
Within the Country	15 02 02	Yes	1.4	dangerous substances	R13	M	Weighted	Offsite in Ireland	Rita Environmental Ltd,w0192-3	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	402 Greenogue Business Park, Rathcoole, Co. Dublin, Ireland	
To Other Countries	17 05 01	Yes	47.92	insulation materials containing asbestos	D15	M	Weighted	Abroad	Biffa Waste Management (Cottonmount Landfill),..	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	
To Other Countries	17 05 05	Yes	693.827 (18)	construction materials containing asbestos	D15	M	Weighted	Abroad	Biffa Waste Management (Cottonmount Landfill),..	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	
To Other Countries	17 06 05	Yes	375.725 (18)	construction materials containing asbestos	D15	M	Weighted	Abroad	Biffa Waste Management (Cottonmount Landfill),..	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	140 Mallusk Road, Newtownabbey, Co. Antrim, BT36 4QN, United Kingdom	
To Other Countries	16 05 01	Yes	820.317	lead batteries	R13	M	Weighted	Abroad	Exide Technologies, Edificio Sonatur, Vila Nova da Rainha, 2050-522 Portugal	Edificio Sonatur, Vila Nova da Rainha, 2050-522 Portugal	Edificio Sonatur, Vila Nova da Rainha, 2050-522 Portugal	Edificio Sonatur, Vila Nova da Rainha, 2050-522 Portugal	

Transfer Destination	European Waste Code	Hazardous	Quantity (Tonnes per Year)	Description of Waste	Waste Treatment Operation	Method Used		Location of Treatment	EWC Waste: Name and Licence/Permit No of Next Destination Facility EWC Waste: Name and Licence/Permit No of Recipient/Disposer	EWC Waste: Address of Next Destination Facility EWC Waste: Address of Recipient/Disposer	Name and Licence / Permit No. and Address of Final Recipient / Disposer (HAZARDOUS WASTE ONLY)	Actual Address of Final Destination (HAZARDOUS WASTE ONLY)
						M/PC/E	Method Used					
To Other Countries	16 06 01	Yes	306.021	lead batteries	R13	M	Weighted	Abroad	HJ Enthoven & Sons BL5598 Darley Dale Smelter, South Derby, Derbyshire, DE4 2LP, United Kingdom	Darley Dale Smelter, South Derby, Derbyshire, DE4 2LP, United Kingdom	HJ Enthoven & Sons, BL5598, Darley Dale Smelter, South Derby, Derbyshire, DE4 2LP, United Kingdom	Darley Dale Smelter, South Derby, Derbyshire, DE4 2LP, United Kingdom
Within the Country	16 06 02	Yes	5.121	Ni-Cd batteries	R13	M	Weighted	Offsite in Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland
Within the Country	16 06 04	No	4.778	alkaline batteries (except 16 06 03)	R13	M	Weighted	Offsite in Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland
Within the Country	16 06 05	No	0.801	other batteries and accumulators	R13	M	Weighted	Offsite in Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland	Cappinacur Ind. East, Dairingean Road, Tullamore, Co. Offaly, Ireland

* Select a row by double-clicking the Description of Waste then click the delete button.

APPENDIX 3

Schedule of 2017 Targets and Objectives

RILTA ENVIRONMENTAL Ltd.

EHS MANAGEMENT SYSTEM



EHS MANAGEMENT PLAN
2015 - 2017

In accordance with
ISO 14001 & OHSAS18001

ENVIRONMENTAL MANAGEMENT PROGRAMME FOR THE ACHIEVEMENT OF OBJECTIVES AND TARGETS

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
1	Increase environmental awareness among RILTA staff	Develop and produce EHS diary for 2018	Find suitable producer(s) Develop content for approval Get quotes for production Print and distribute to relevant stakeholders	CH SL SL SL	Mar 17 Mar 17 Mar 17 Apr 17	17/01/2018: Draft of diary is prepared – with management for review.
2	Optimize waste tracking from cradle to grave	Develop integrated system for managing all data	Sign off on suitable reports on electronic tracking system Amend 'incoming waste records' to accommodate tracking reports Develop live mass balance monthly update	CH CH CH	Apr 17 May 17 Oct 17	17/01/2018: Waste tracking system fully operations.

Issue No.	013	Compiled by: <i>Name/Position</i>	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: <i>Name/Position</i>	Sean Cotter General manager

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
3	Ensure quality drainage system	No leaks	Re-coat the settlement tank (1) Re-coat the settlement tank (2) Re-coat the settlement tank (3)	CH CH CH	June 17 August 17 October 17	Yet to complete.
4	Ensure only clean water released to the river	No ELV breaches	Empty and clean attenuation tank Skim storm water interceptor on a monthly basis Replace/Repair damaged concrete on a rota basis to ensure no damaged areas by 2017	CH CH CH	Mar 17 Ongoing Dec 17	17/01/2018: Concrete repairs partially complete. Several large sections complete. Tanks cleaned and storm water interceptor skimmed.

Issue No.	013	Compiled by: Name/Position	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: Name/Position	Sean Cotter General manager

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
5	Reduce use of hazardous raw materials used on site	Employ solvent free paint	Source suitable paints Assess suitability of existing paint systems	CH CH	Mar 17 April 17	17/01/2018: Solvent free paint purchased and trialed.
6	Optimize the quality of trade effluent	No ELV breaches	Clean 'wet wells' twice a year Clean DAF system twice a year	TMc TMc	Ongoing Ongoing	17/01/2018: No ELV exceedances for 2017.

Issue No.	013	Compiled by: Name/Position	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: Name/Position	Sean Cotter General manager

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
7	To be a good and considerate neighbor	No complaints	<p>Complete noise monitoring.</p> <p>Monitor adjoining river on a quarterly basis.</p> <p>Implement 'closed door' policy system when unloading liquid waste tankers where possible</p> <p>Cold cutting at the cedar site to take place inside with doors close</p> <p>Make contact with immediate neighbors on a quarterly basis</p>	<p>CH</p> <p>CH</p> <p>CM/DG</p> <p>DG</p> <p>CH</p>	<p>Ongoing</p> <p>Ongoing</p> <p>Ongoing</p> <p>Ongoing</p> <p>Ongoing</p>	<p>17/01/2018: Noise monitoring complete. Good relationship established with neighboring businesses. No complaints received.</p>

Issue No.	013	Compiled by: <i>Name/Position</i>	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: <i>Name/Position</i>	Sean Cotter General manager

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
8	To Be Energy Efficient	Reduce electricity usage by 5%	Assess findings of 2016 audit. Implement findings of audit if economically and practically feasible.	CH/SC	Apr 17 June 17	17/01/2018: Overall the energy usage for 2017 when compared for 2016 increased by 115,336KWH. Energy efficient lighting system planned for install in Operations office in Jan 2018 – warehouses to follow.
9	Reduce Process Waste	Reduce filter cake volumes	Optimize the volume of 'dig-out' waste that can be dried.	DG	June 17	17/01/2018: Dig-out system now in place. Drying system for filter cake trialed – expected to begin full operation in Q1 2018.

Issue No.	013	Compiled by: <i>Name/Position</i>	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: <i>Name/Position</i>	Sean Cotter General manager

EMP Ref.	Objective	Target	Environmental Management Programme for the implementation of objectives.	Responsible Person	Completion Date	Completed (Y/N)
10	Reduce the Number of Lost Time Accidents	Aim for Zero Lost Time Accidents	Tailor Manual Handling Training to emphasize the need to cut out 'reaching and lifting' Aim for 100% Manual and Chemical handling Develop app for recording 'area of concern/hear-miss' data Aim for 75 near misses	SL SL SL SL	Ongoing Dec 17 Apr 17 Dec 17	17/01/2018: Improved reporting system for all accidents and near-misses. 36% increase in the number of near-misses reported between 2016 and 2017. No further work carried on near-miss app. Number of near misses for 2017 is 11.
11	Reduce Detergent use on Tank Cleaning Work	Reduce Detergent use by 10%	Eliminate neat detergent/road bio use Do not exceed recommended usage	EK EK	Dec 17 Dec 17	17/01/2018: waiting on data from Contracts Division.

Issue No.	013	Compiled by: <i>Name/Position</i>	Colm Hussey Facility & Environmental Manager
Date:	Feb 2017	Reviewed by: <i>Name/Position</i>	Sean Cotter General manager

APPENDIX 4

Schedule proposed Targets and Objectives 2018



RILTA ENVIRONMENTAL LTD.

ENVIRONMENTAL MANAGEMENT SYSTEM (EMS)

**ENVIRONMENTAL MANAGEMENT PLAN (EMP)
OBJECTIVES AND TARGETS REGISTER 2018 to 2020**

In accordance with

ISO 14001:2015

Revised By:	Sean Lawlor	Approved By:	Colm Hussey	Revision Date:	03/01/2018
------------------------	-------------	-------------------------	-------------	---------------------------	------------

Table of Contents

005c.....	3
005d	3
005e	4
005f	4
006a.....	4
006b	4
008b	5
009a.....	5
009b	6
010b	6

Aspect Ref. No.:	Aspect (i.e. what the issue is)	Objective (i.e. high level what needs to be done)	Target (i.e. low level what needs to be done)	Implementation Plan (i.e. how we are going to do it)	Indicators of Success
005c	Painting and drying - Chemical consumption	Convert over to water-based paints, 100% by end of year.	<ul style="list-style-type: none"> Complete trials with the water-based paints. Determine the required drying times and temperatures. 	<ul style="list-style-type: none"> Source and purchase suitable water-based paints. Carry out painting and drying trials with various temperatures and times and identify optimum conditions. Document the optimum conditions in an SOP which details the painting and drying process. 	<ul style="list-style-type: none"> Completed trials. Documented SOP. Cessation of purchases of high VOC content paints.
005d	Shot blasting - Material consumption	Resolve the issue with internal dust release from the shot blast unit and rectify by end of year.	<ul style="list-style-type: none"> Identify the source(s) of the dust leaks and eliminate. 	<ul style="list-style-type: none"> Identify where the dust leaks are originating from through visual observation and communication with operative. Determine if the process needs to be altered (e.g. later door opening times, stronger extraction, etc.) and if so, what alterations are required. Determine if physical repairs are required and if they are, implement the repairs. Determine the amount of shot blast material that is used for 1 month and compare when repairs/refit is complete. 	<ul style="list-style-type: none"> Dust releases eliminated. Volume of blast material used reduces when compared to similar processing events.

Aspect Ref. No.:	Aspect (i.e. what the issue is)	Objective (i.e. high level what needs to be done)	Target (i.e. low level what needs to be done)	Implementation Plan (i.e. how we are going to do it)	Indicators of Success
005e	Container recycling - Utility consumption	Define the volume of waste that is recycled in both the plastics and metal recycling processes.	<ul style="list-style-type: none"> Identify the weight of plastics recycled per month. Identify the weight of metals recycled per month. Determine if more efficient recycling/processing techniques/equipment are available to increase recycling rate or to reduce the current energy consumption. 	<ul style="list-style-type: none"> Consult supervisor and operator and request a log to be kept of the volumes of plastics and metals produced per month. Research new plastics shredding technologies and new drum crushing technologies – cost appropriate systems. 	<ul style="list-style-type: none"> Log established of volumes of plastics and metals produced each month for recycling. CAPEX request made for new appropriate equipment.
005f	Container processing - Utility consumption	Carry out two compressed air leak surveys per year and implement maintenance programme to eliminate identified compressed air leakages.	<ul style="list-style-type: none"> Complete two compressed air leak surveys. Implement maintenance programme to repair the identified leaks. Estimate the cost of lost air. 	<ul style="list-style-type: none"> Source a leak testing company and contract to carry out leak test surveys. Source repair company and implement repairs. Determine electricity costs before and after repairs. 	<ul style="list-style-type: none"> All identified air leaks repaired. Data generated on cost of identified compressed air leaks.
006a	Vehicle collections - Production of noise, exhaust gases and particulates, liquid and solid chemicals and debris	Confirm the maintenance schedule for the Site Services Division vehicle fleet. Complete quarterly audits of the vehicles.	<ul style="list-style-type: none"> Establish vehicle audit template. Contact site services manager and arrange to carry out a minimum of four vehicle audits. 	<ul style="list-style-type: none"> Create a vehicle audit template form. Implement the vehicle audits in conjunction with site services manager/supervisor. 	<ul style="list-style-type: none"> Vehicle audit template created. Minimum of four vehicle audits completed per year.
006b	Cleaning works – Chemicals	Carry out 6 audits of the cleaning works that the Site Services team carries out at customer premises.	<ul style="list-style-type: none"> Establish site services audit template. Contact site services manager and arrange to carry out a minimum of six audits. 	<ul style="list-style-type: none"> Create a site services audit template form. Implement the site services audits in conjunction with site services manager/supervisor. 	<ul style="list-style-type: none"> Site services audit template created. Minimum of six site services audits completed per year.

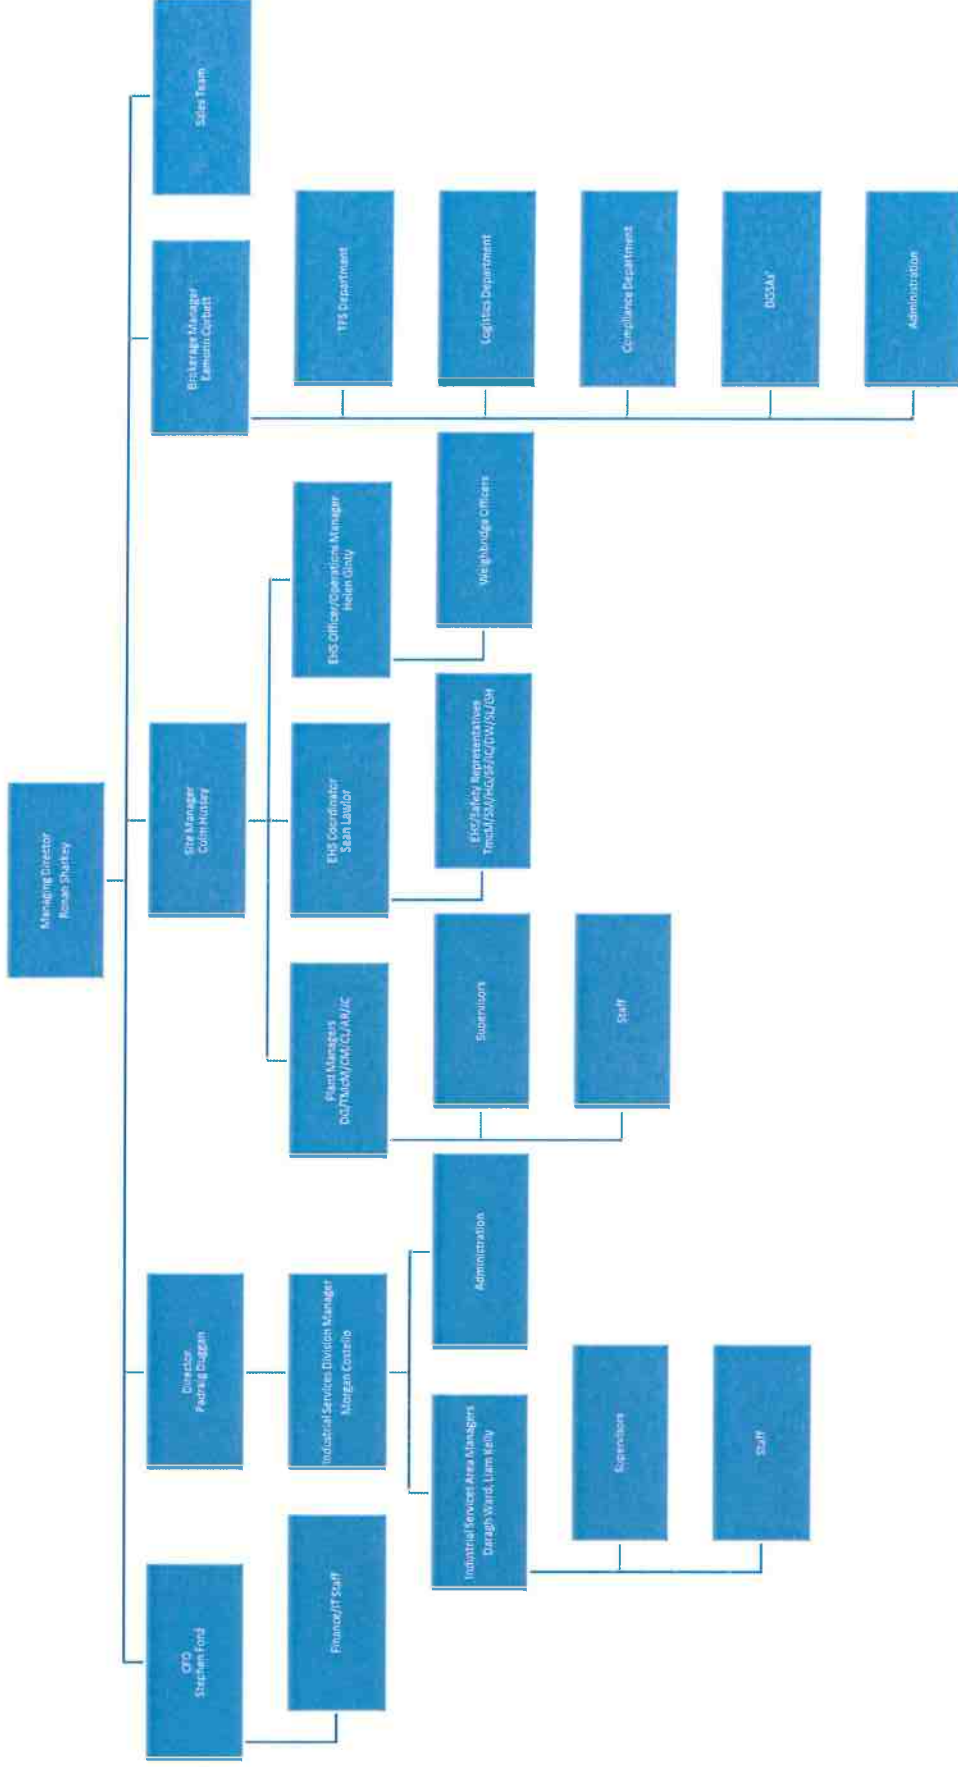
Aspect Ref. No.:	Aspect (i.e. what the issue is)	Objective (i.e. high level what needs to be done)	Target (i.e. low level what needs to be done)	Implementation Plan (i.e. how we are going to do it)	Indicators of Success
008b	Transformer processing - Production of noise and particulates, liquid and solid chemicals and debris	Complete weekly checks of the warehouse areas to ensure correct storage techniques.	<ul style="list-style-type: none"> Carry out weekly checks of the warehouse area. Rectify issues raised in a timely manner. 	<ul style="list-style-type: none"> Consult with transformer division manager and implement weekly checks of the warehouse area. 	<ul style="list-style-type: none"> Weekly checks completed. Identified issues rectified within 1 month of notification.
009a	Use of offices, canteens, toilet facilities, warehouses and yards - Utilities (gas, water, electricity)	Decrease lighting, heating and water consumption by 15% each based on 2017 consumption figures.	<ul style="list-style-type: none"> Reduce water consumption by 15% from 2017 figures. Reduce gas consumption by 15% from 2017 figures. Reduce electricity consumption by 15% from 2017 figures. 	<ul style="list-style-type: none"> Carry out water survey and identify high consumption areas. Carry out gas survey and identify high consumption areas. Carry out electricity survey and identify high consumption areas. Target the identified high consumption areas with projects to minimise consumption (e.g. awareness campaign, timers, low energy lighting, etc.). 	<ul style="list-style-type: none"> Utility consumption reduction of 15% Water surveys completed. Gas surveys completed. Electricity surveys completed.

Aspect Ref. No.:	Aspect (i.e. what the issue is)	Objective (i.e. high level what needs to be done)	Target (i.e. low level what needs to be done)	Implementation Plan (i.e. how we are going to do it)	Indicators of Success
009b	Use of offices and warehouses - Waste material	Determine the volume of waste generated by the Operations building and reduce volume by 10%.	<ul style="list-style-type: none"> Determine areas where waste is generated in the operations building. Quantify this waste volume. Reduce this volume by 10%. 	<ul style="list-style-type: none"> Identify the volume/weight of waste material generated by each office. Identify high volume waste streams. Identify the cost for disposal/recycling of this waste. Inform staff of costs and options and task staff with waste minimisation project. 	<ul style="list-style-type: none"> Staff buy-in to waste reduction programme(s). 10% decrease in volume/weight of waste generated from the operations building.
010b	Dispensing - Chemicals	Determine the volume of fuel consumed by each vehicle that utilises the diesel fuel pump.	<ul style="list-style-type: none"> Determine the volume of diesel that each site vehicle consumes. Identify high consuming vehicles and assess if more regular servicing or replacement is required. Determine the cost of this fuel. Determine the cost of a more efficient alternative vehicle. 	<ul style="list-style-type: none"> Identify how the dispensing system works. Track each user and vehicle to identify consumption pattern. Determine servicing schedule for high consuming vehicles. Determine if an alternative vehicle is a valid option. 	<ul style="list-style-type: none"> Reduction in fuel consumption without affecting work volumes.

APPENDIX 5

Management Structure

Rilta Environmental Organisational Chart 2018



APPENDIX 6

Bund Integrity Test Report



Rilta Environmental Ltd.

**Bund Integrity Testing
at Site 14A1,
Greenogue Business Park,
Rathcoole, Co. Dublin**

November 2016

Revision: B

TOBIN CONSULTING ENGINEERS



REPORT

PROJECT:

Bund Integrity Testing

**Site 14A1, Greenogue Business Park
Rathcoole, Co. Dublin**

CLIENT:

Rilta Environmental Ltd
RILTA Environmental Limited,
Block 402,
Greenogue Business Park,
Rathcoole,
Co. Dublin
Tel: + 353 1 401 8000
Fax: + 353 1 401 8080
Email: info@rilta.ie

COMPANY:

TOBIN Consulting Engineers
Block 10 - 4
Blanchardstown Corporate Park,
Blanchardstown,
Dublin 15

www.tobin.ie

DOCUMENT AMENDMENT RECORD

Client: Rilta Environmental Ltd.
Project: 10063 – Bund Testing
Title: Bund Integrity Testing

PROJECT NUMBER: 10063				DOCUMENT REF: 10063/Rev A			
Revision	Description & Rationale	Originated	Date	Checked	Date	Authorised	Date
A	Bund Integrity Testing	FH	090217	ST	190213	DG	190213
TOBIN Consulting Engineers							

TABLE OF CONTENTS

1	INTRODUCTION	1
2	METHODOLOGY	1
2.1	METHODOLOGY FOR TESTING AT SITE 14A1, GREENOGUE BUSINESS PARK	2
2.1.1	Large Warehouse Building (Area / Bund No. 12)	2
2.1.2	Storage Bay – Portable Bunds (6 No.) (Area / Bund No. 13)	2
2.1.3	Processing Area – Portable Bunds (2No.) (Area / Bund No. 14)	2
2.1.4	Outdoor Concrete Bund / Loading Bay (Area / Bund No. 15)	3
2.1.5	Underground Concrete Bund (Area / Bund No. 16)	3
3.0	CONTROL	4
3.1	FAILURE	4
3.2	WATER DISPOSAL	4
3.3	PROGRAMME FOR TESTING (SITE 14A1)	5
4	RESULTS	6
4.1	HYDROSTATIC SURVEY RESULTS	6
4.2	TESTING AT SITE 14A1, GREENOGUE BUSINESS PARK	6
4.2.1	Large Warehouse Building (Area / Bund No. 12)	6
4.2.2	Storage Bay - Portable Bunds (6No.) (Area / Bund No.13)	7
4.2.3	Processing Area - Portable Bunds (2No.) (Area / Bund No.14)	8
4.2.4	Outdoor Concrete Bund (Area / Bund No.15)	9
4.2.5	Underground Concrete Bund (Area / Bund No.16)	9
5	CCTV	10
5.1	CCTV SURVEY	10
6	CONCLUSION	11

Appendix A

Figure 1 – Bund / Tank Locations for testing (Site 14A1, Greenogue Business Park)

Appendix B

Site 14A1 (Ref. Cedar Yard) - CCTV Drainage Inspection Report

1 INTRODUCTION

Tobin Consulting Engineers (hereafter referred to as TOBIN) have been commissioned by Rilta Environmental Ltd. to carry out Bund Integrity Testing at their facility at 14A1, Greenogue Business Park, Rathcoole, Co. Dublin under the requirements of the site's EPA Waste Licence (No. W0185-01).

TOBIN proposed that over a period amenable to facility operations hydrostatic testing, CCTV survey and structural survey would be carried out on the specified bunds and areas.

A CCTV survey of the site drainage was carried out by Rilta staff on 15/11/16. A structural survey of the Buildings outlined for assessment was carried out by a TOBIN Engineer on Friday, 25th November 2016.

Hydrostatic testing of a number of bunded areas and underground settlement tanks commenced on Saturday, July 23rd 2016 and concluded Monday, July 25th 2016. A second visit for testing of the underground bund at Site 14A1, Greenogue Business Park commenced Tuesday, 14th November 2016 and concluded on Thursday 16th November 2016 in order to carry out Testing of four indoor portable bunds.

Areas / Bunds for testing identified within Site 14A1, Greenogue Business Park include:

- Area / Bund No. 12: Large Warehouse
- Area / Bund No. 13: Storage Bay Portable Bunds (2No)
- Area / Bund No. 14: Processing Bay Portable Bunds (2No)
- Area / Bund No. 15: Outdoor Concrete Bund
- Area / Bund No. 16: Underground Concrete Bund

TOBIN carried out preliminary inspections of the bunds and areas listed above and made assessments as to the necessity/suitability of each for hydrostatic testing or structural assessment. A detailed bund location map (Figure 1) is contained in Appendix A.

2 METHODOLOGY

It was proposed that over a period when the facility was non-operational, liquid levels within the over ground bunds and underground tanks would be monitored, following preparatory works, for a three day period (preferably over a weekend). Any subsequent fluctuation in levels over this period would indicate if the integrity of each bund is intact.

2.1 METHODOLOGY FOR TESTING AT SITE 14A1, GREENOGUE BUSINESS PARK

A methodology for the testing of individual bunds and tanks at Site 14A1 is detailed below. The locations of the areas tested at Site 14A1 is shown in Figure 1 in Appendix A.

2.1.1 Large Warehouse Building (Area / Bund No. 12)

A structural survey was carried out by a TOBIN Engineer on the Internal Warehouse Building on Friday, 25th November, located as shown in Figure 1 of Appendix A. This building is designated as an area for the storage, inspection and processing of incoming electrical transformers. This survey consisted of a visual assessment of all walls, floors and ramps within the building.

2.1.2 Storage Bay – Portable Bunds (2 No.) (Area / Bund No. 13)

There are Indoor Portable Bunds/Tanks (2 No.) in the Storage Bay Building at Site 14A1, located as shown in Figure 1 of Appendix A.

It was proposed that over a period when the facility was non-operational, liquid levels within the internal storage bunds would be monitored for a three day period.

The locations of the storage bunds during the testing period and location of the main outdoor storage area are shown in Figure 1 attached.

Please Note: *During this 3 day test period the total drop in water level, after allowing for rainfall and evaporation, should not exceed 1/500th of the average depth of water or 10mm.*

2.1.3 Processing Area – Portable Bunds (2No.) (Area / Bund No. 14)

It was proposed to test the Indoor Portable Steel Bunds (2No.) in the Processing Bay Building at Site 14A1, located as shown in Figure 1 of Appendix A. The bunds were thoroughly cleaned out, with any debris and sludge removed from the bunds prior to testing.

Each bund was then incrementally filled with water to a level that is equal to 25% of the overall capacity of each bund. This was to represent the maximum capacity the bund will be required to hold.

When the bund was full to the required limit it was be allowed to sit for one day to allow the container/bund to absorb any initial water and reach an equilibrium state. After this 24hr period had lapsed, the level of water was measured at 24hr intervals over 3 days.

Further to this testing the bund was inspected by a structural engineer to ensure that any remedial work that is required has been carried out such as welding or repairing any cracks or faults to a satisfactory standard.

Please Note: *During this 3 day test period the total drop in water level, after allowing for rainfall and evaporation, should not exceed 1/500th of the average depth of water or 10mm.*

2.1.4 Outdoor Concrete Bund / Loading Bay (Area / Bund No. 15)

It was proposed to test the Outdoor Concrete Bund / Loading Bay at Site14A1, located as shown in Figure 1 of Appendix A. The bund was thoroughly cleaned out, with any debris and sludge removed from the bund prior to testing.

The bund was then incrementally filled with water to a level that is equal to 25% of the overall capacity of the bund. This was to represent the maximum capacity the bund will be required to hold.

When the bund was full to the required limit it was allowed to sit for one day to allow the container/bund to absorb any initial water and reach an equilibrium state. After this 24hr period had lapsed, the level of water was measured at 24hr intervals over 3 days.

Further to this testing the bund was inspected by a structural engineer to ensure that any remedial work that is required has been carried out such as protective coating applied or any cracks or faults repaired and sealed to a satisfactory standard.

Please Note: *During this 3 day test period the total drop in water level, after allowing for rainfall and evaporation, should not exceed 1/500th of the average depth of water or 10mm.*

2.1.5 Underground Concrete Bund (Area / Bund No. 16)

Testing was carried out on the Underground Concrete Bund over a 3 day period in July 2016. It was proposed to test the Underground Concrete Bund at Site14A1, located as shown in Figure 1 of Appendix A. The bund was thoroughly cleaned out, with any debris and sludge removed from the bund prior to testing.

The bund was then incrementally filled with water to a level that is equal to 25% of the overall capacity of the bund. This was to represent the maximum capacity the bund will be required to hold.

When the bund was full to the required limit it was allowed to sit for one day to allow the container/bund to absorb any initial water and reach an equilibrium state. After this 24hr period had lapsed, the level of water was measured using a data logger to record any changes in water level.

Further to this testing the bund was inspected by a structural engineer to ensure that any remedial work that is required has been carried out such as protective coating applied or any cracks or faults repaired and sealed to a satisfactory standard.

Please Note: *During this 3 day test period the total drop in water level, after allowing for rainfall and evaporation, should not exceed 1/500th of the average depth of water or 10mm.*

3.0 CONTROL

Due to the potential for evaporation in the settlement tanks/bunded areas, a control was put in place (note: where tanks are internal there is no risk of precipitation influencing levels). A container was filled to a specific level with liquid from the Underground Tanks. This control was left beside the internal tanks throughout the testing period. This control provides an indication of the evaporation rate active on the tanks and the influence of any rainfall during the testing period.

Due to the potential for evaporation and precipitation in the Outdoor Concrete Bund, a control was put in place. A container was filled to a specific level with water. This control was left beside the Outdoor Concrete Bund.

These controls provide an indication of the evaporation and precipitation rate active on the bunds both indoors and outdoors.

3.1 FAILURE

Should the structure not satisfy the test, remedial works will be recommended and carried out and the same procedure will be repeated.

3.2 WATER DISPOSAL

Any water used in this procedure will be disposed of through the surface water drainage system on site.

3.3 PROGRAMME FOR TESTING (SITE 14A1)

With the exception of the tests carried out in November for the internal bunds, it was proposed that all testing would be carried out over the same 4-day period¹ in July 2016.

- Day 1: TOBIN staff attended Site 14A1 on Friday, July 22nd 2016, before the testing commenced in order to assess the Underground Concrete Bund and Outdoor Concrete Bund for testing and to review the location of the Bunds to be tested (with Rilta staff) and the preparation of test areas including the addition of water to the bund as required for hydrostatic testing (with Rilta staff). Levels were taken by TOBIN staff.
- Day 2-4: TOBIN staff attended Site 14A1 on Saturday, 23rd July, Sunday, 24th July and Monday, 25th July to take levels at the Underground and Outdoor Concrete Bunds. Levels were taken at the same time each day, weather conditions noted and controls checked

A second visit was required to carry out hydrostatic testing on the Over indoor portable bunds at Site 14A1 in November 2016.

- Day 1: TOBIN staff attended Site 14A1 on Monday, 14th of November 2016 before the testing commenced in order to assess all Areas / Bunds for testing and to review the locations of the Areas / Bunds to be tested (with Rilta staff). Preparation of test areas including the addition of water to containers/bunds where required for hydrostatic testing (with Rilta staff). Levels were taken by TOBIN staff.
- Days 2-4: TOBIN staff attended site on Tuesday, November 15th, Wednesday, 16th November and Thursday, 17th November to take levels at each test location. Levels were taken at the same time each day, weather conditions noted and controls checked.
- A TOBIN Structural Engineer visited site to carry out a structural assessment of the bunds and buildings on Friday, 25th November.

¹ Where this was not practical for Rilta, an alternative programme for testing was agreed (all results are included herein).

4 RESULTS

4.1 HYDROSTATIC SURVEY RESULTS

Hydrostatic testing was carried out on the Bunded areas & Underground Storage Tanks from Friday, July 22nd to Monday, July 25th 2016, and for additional Indoor Portable Storage Bunds from Tuesday, 15th November to Thursday, 17th November 2016.

No fluctuation in liquid levels was noted in the bunds or tanks during the first monitoring period Day 1 to Day 2 (November 15th to 16th November 2016) and levels remained constant for the second monitoring period Day 2 to Day 3 (16th November to 16th November 2016). Results from the controls showed no variation and were consistent with readings from all storage tanks.

As no fluctuation was noted in liquid levels during the measurement period and the control remained constant, it is determined that all tested bunds and tanks are in good structural condition. No ancillary works are required for these bunds.

4.2 TESTING AT SITE 14A1, GREENOGUE BUSINESS PARK

Testing commenced 'as per methodology' on Saturday 23rd July 2016 and concluded on Monday, 25th of July 2016. A second visit was required to test the Indoor Portable Bunds bund. This test commenced on Tuesday, 15th November 2016 and concluded on Thursday, 17th November 2016. Measurements were recorded over three consecutive days and the results were analysed by TOBIN staff. No fluctuation in liquid level was noted at any of the monitoring locations, during any of the daily monitoring events (see results below). The controls for these assessments showed no change, remaining consistent with the results from the daily monitoring. See section 4.2.2 below for test results.

4.2.1 Large Warehouse Building (Area / Bund No. 12)

As per methodology a structural survey was carried out by a TOBIN Engineer on the Warehouse on Friday, 25th November 2016, located as shown on Figure 1 of Appendix A.

This area is generally used to store relatively dry materials. The construction is typical industrial ground floor construction with 6m x 6m concrete bays. There is a concrete upstand approx 100mm high around the perimeter of the area with block walls above. There is ramped access to the entrances and exits to the bund.

The floor slab and up-stand was generally found to be in good structural condition with no obvious defects. The ramps approaching the external dock – leveller have been damaged by the impact of

the vehicular movements. These require repair with a suitable repair mortar. The make-up of the joint filler material between the 6m x 6m concrete bays is unknown and maybe unsuitable to store the material required. It is recommended that these joints be re-sealed with a suitable sealant that capable of performing with aggressive materials.

4.2.2 Storage Bay - Portable Bunds (2No.) (Area / Bund No.13)

Testing commenced 'as per methodology' on Monday, 14th November 2016. Measurements were recorded over three consecutive days and the results were analysed by TOBIN staff. No fluctuation in liquid level was noted at any of the indoor bund monitoring locations, during any of the daily monitoring events (see results below).

As no fluctuation was noted in tank liquid levels during the measurement period, the internal bunds are in good structural condition as detailed below.

Storage Bay Portable Bund No. 1:

As per methodology Bund No. 1 was filled with water to an appropriate level (110% tank volume) on Monday the 14th November 2016. A >24hr absorption period was observed (due to weekend period) to allow the bund walls to become saturated. The test commenced on Tuesday 15th November 2016. Table 4-7 below represents recorded water levels within the bund over the test period. Two levels were taken for each bund as there was a slight slant in some of the storage tanks.

Table 4-7 Storage Bay Portable Bund No. 1 Test Result

Measurement Location	Mon 14 th Nov	Tues 15 th Nov	Wed 16 th Nov	Thur 17 th Nov	Fluctuation	Pass / Fail
Storage Bay Portable Bund No. 1						
A, Front Left	23.1	23.2	23.2	23.1	-0.1cm	Pass
B, Front Right	23.6	23.6	23.6	23.6	0.0cm	Pass
C, Rear Left	23.7	23.7	23.7	23.7	0.0cm	Pass
D, Rear Right	23.4	23.4	23.4	23.3	-0.1cm	Pass

Testing at this location was not impacted by facility operations

Storage Bay Portable Bund No. 2:

As per methodology Bund No. 2 was filled with water to an appropriate level (110% tank volume) on Monday the 14th November 2016. A >24hr absorption period was observed (due to weekend period) to allow the bund walls to become saturated. The test commenced on Tuesday 15th November 2016. Table 4-8 below represents recorded water levels within the bund over the test

period. Two levels were taken for each bund as there was a slight slant in some of the storage tanks.

Table 4-8 **Storage Bay Portable Bund No. 2 Test Result:**

Measurement Location	Mon 14 th Nov	Tues 15 th Nov	Wed 16 th Nov	Thur 17 th Nov	Fluctuation	Pass / Fail
Storage Bay Portable Bund No. 2						
A, Front Left	24.2	24.2	24.2	24.2	0.0cm	Pass
B, Front Right	24.3	24.3	24.3	24.3	0.0cm	Pass
C, Rear Left	24.2	24.3	24.3	24.3	-0.1cm	Pass
D, Rear Right	24.1	24	24	24	-0.1cm	Pass

Testing at this location was not impacted by facility operations.

4.2.3 Processing Area - Portable Bunds (2No.) (Area / Bund No.14)

As per methodology Area / Bund No. 14 was filled with water to an appropriate level (110% tank volume) on Monday the 14th November 2016. A >24hr absorption period was observed (due to weekend period) to allow the bund walls to become saturated. The test commenced on Tuesday 15th November 2016. Table 4-13 below represents recorded water levels within the bund and control over the test period. Various levels were taken for each bund as there was a variation in floor level in some of the bunds.

Table 4-9 **Bund / Area No. 14 Test Result**

Measurement Location	Tues 15 th Nov	Wed 16 th Nov	Thur 17 th Nov	Fluctuation	Pass / Fail
Main Bund					
A, Front Left	29.4cm	29.4cm	29.3cm	-0.1cm	Pass
B, Front Right	29.6cm	29.6cm	29.6cm	0.0cm	Pass
C, Rear Right	28.6cm	28.6cm	28.5cm	-0.1cm	Pass
D, Rear Left	28.5cm	28.4cm	28.4cm	-0.1cm	Pass
Processing Bund					
E, Front Left	11.7cm	11.7cm	11.7cm	0.0cm	Pass
F, Front Right	9.9cm	9.9cm	9.9cm	0.0cm	Pass

Testing at this location was not impacted by facility operations.

4.2.4 Outdoor Concrete Bund (Area / Bund No.15)

As per methodology Area / Bund No. 15 was filled with water to an appropriate level (110% tank volume) on Friday 22nd July. A >24hr absorption period was observed (due to weekend period) to allow the bund walls to become saturated. The test commenced on Saturday 23rd July. Table 4-14 below represents recorded water levels within the bund and control over the test period. Various levels were taken for each bund as there was a variation in floor level in some of the bunds.

Table 4-14 Bund / Area No. 15 Test Result

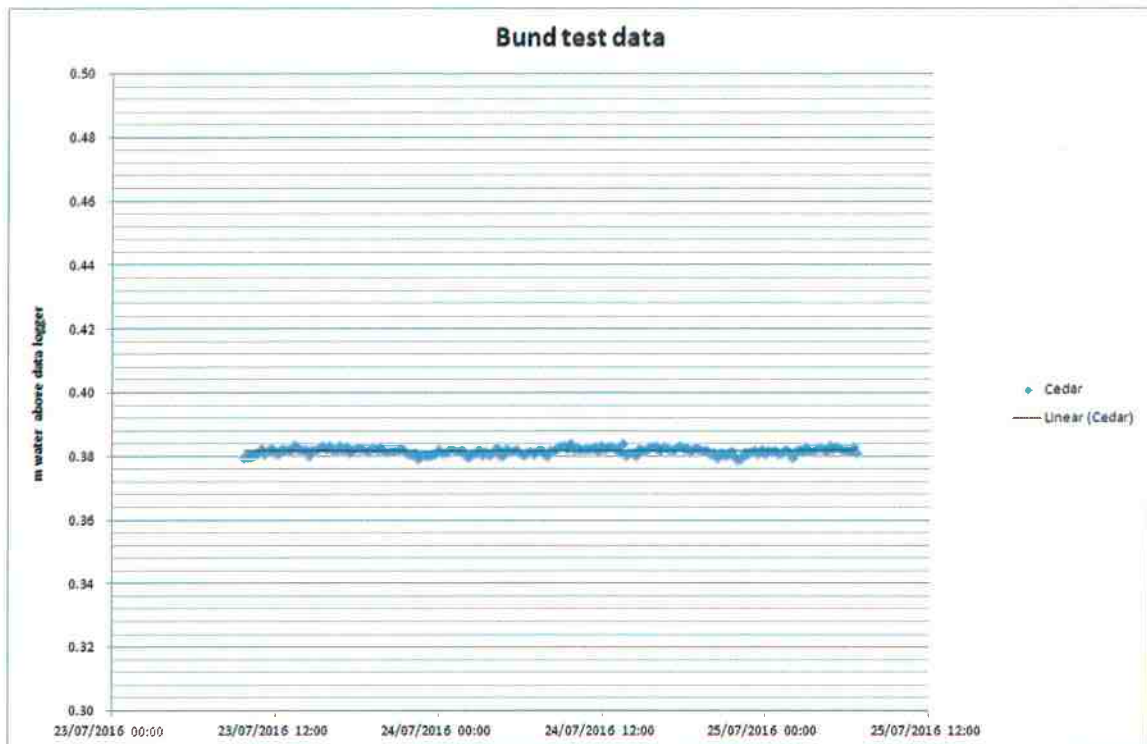
Measurement Location	Sat 23 rd Jul (Top of bund to water level)	Sun 24 th Jul (Top of bund to water level)	Mon 25 nd Jul (Top of bund to water level)	Fluctuation	Pass / Fail
A, Front Right	90cm	90cm	90cm	0.0cm	Pass
B, Rear Right	93cm	93cm	93cm	0.0cm	Pass
C, Rear Centre	113cm	113cm	113cm	0.0cm	Pass
D, Rear Left	94cm	94cm	94cm	0.0cm	Pass
E, Front Left	95cm	95cm	95cm	0.0cm	Pass

Testing at this location was not impacted by facility operations.

4.2.5 Underground Concrete Bund (Area / Bund No.16)

As per methodology Area / Bund No. 16 was filled with water to an appropriate level (110% tank volume) on Friday 22nd July 2016. A >24hr absorption period was observed (due to weekend period) to allow the bund walls to become saturated, a data logger was then placed in the underground concrete bund. The test commenced on Saturday 23rd July. Table 4-15 below represents recorded change in water levels within the bund and control over the test period.

Table 4-15 Bund / Area No. 16 Test Result



Testing at this location was not impacted by facility operations.

No fluctuation in liquid levels was noted in the bunds or tanks during the first monitoring period Day 1 to Day 2 (November 15th to 16th November 2016) and levels remained constant for the second monitoring period Day 2 to Day 3 (16th November to 16th November 2016). Results from the controls showed no variation and were consistent with readings from all storage tanks.

As no fluctuation was noted in liquid levels during the measurement period and the control remained constant, it is determined that all tested bunds and tanks are in good structural condition. No ancillary works are required for these bunds

5 CCTV

5.1 CCTV SURVEY

A CCTV drainage inspection was carried out on 5th of December 2016 on behalf of Rilta Environmental Ltd. The Inspection Report is included in Appendix B attached.

It was apparent from the CCTV camera inspection that the drainage system is generally in good condition, with some area requiring attention. A summary of defects and recommended remedial works can be found on the final page of Appendix B.

6 CONCLUSION

The assessment of the bunds / areas after CCTV survey, structural and hydrostatic testing is as follows:

Areas / Bunds for testing identified within Site 14A1, Greenogue Business Park include:

- Area / Bund No. 12: Large Warehouse = **PASS**
- Area / Bund No. 13: Storage Bay Portable Bunds (2No) = **PASS**
- Area / Bund No. 14: Processing Bay Portable Bunds (2No) = **PASS**
- Area / Bund No. 15: Outdoor Concrete Bund = **PASS**
- Area / Bund No. 16: Underground Concrete Bund = **PASS**
-

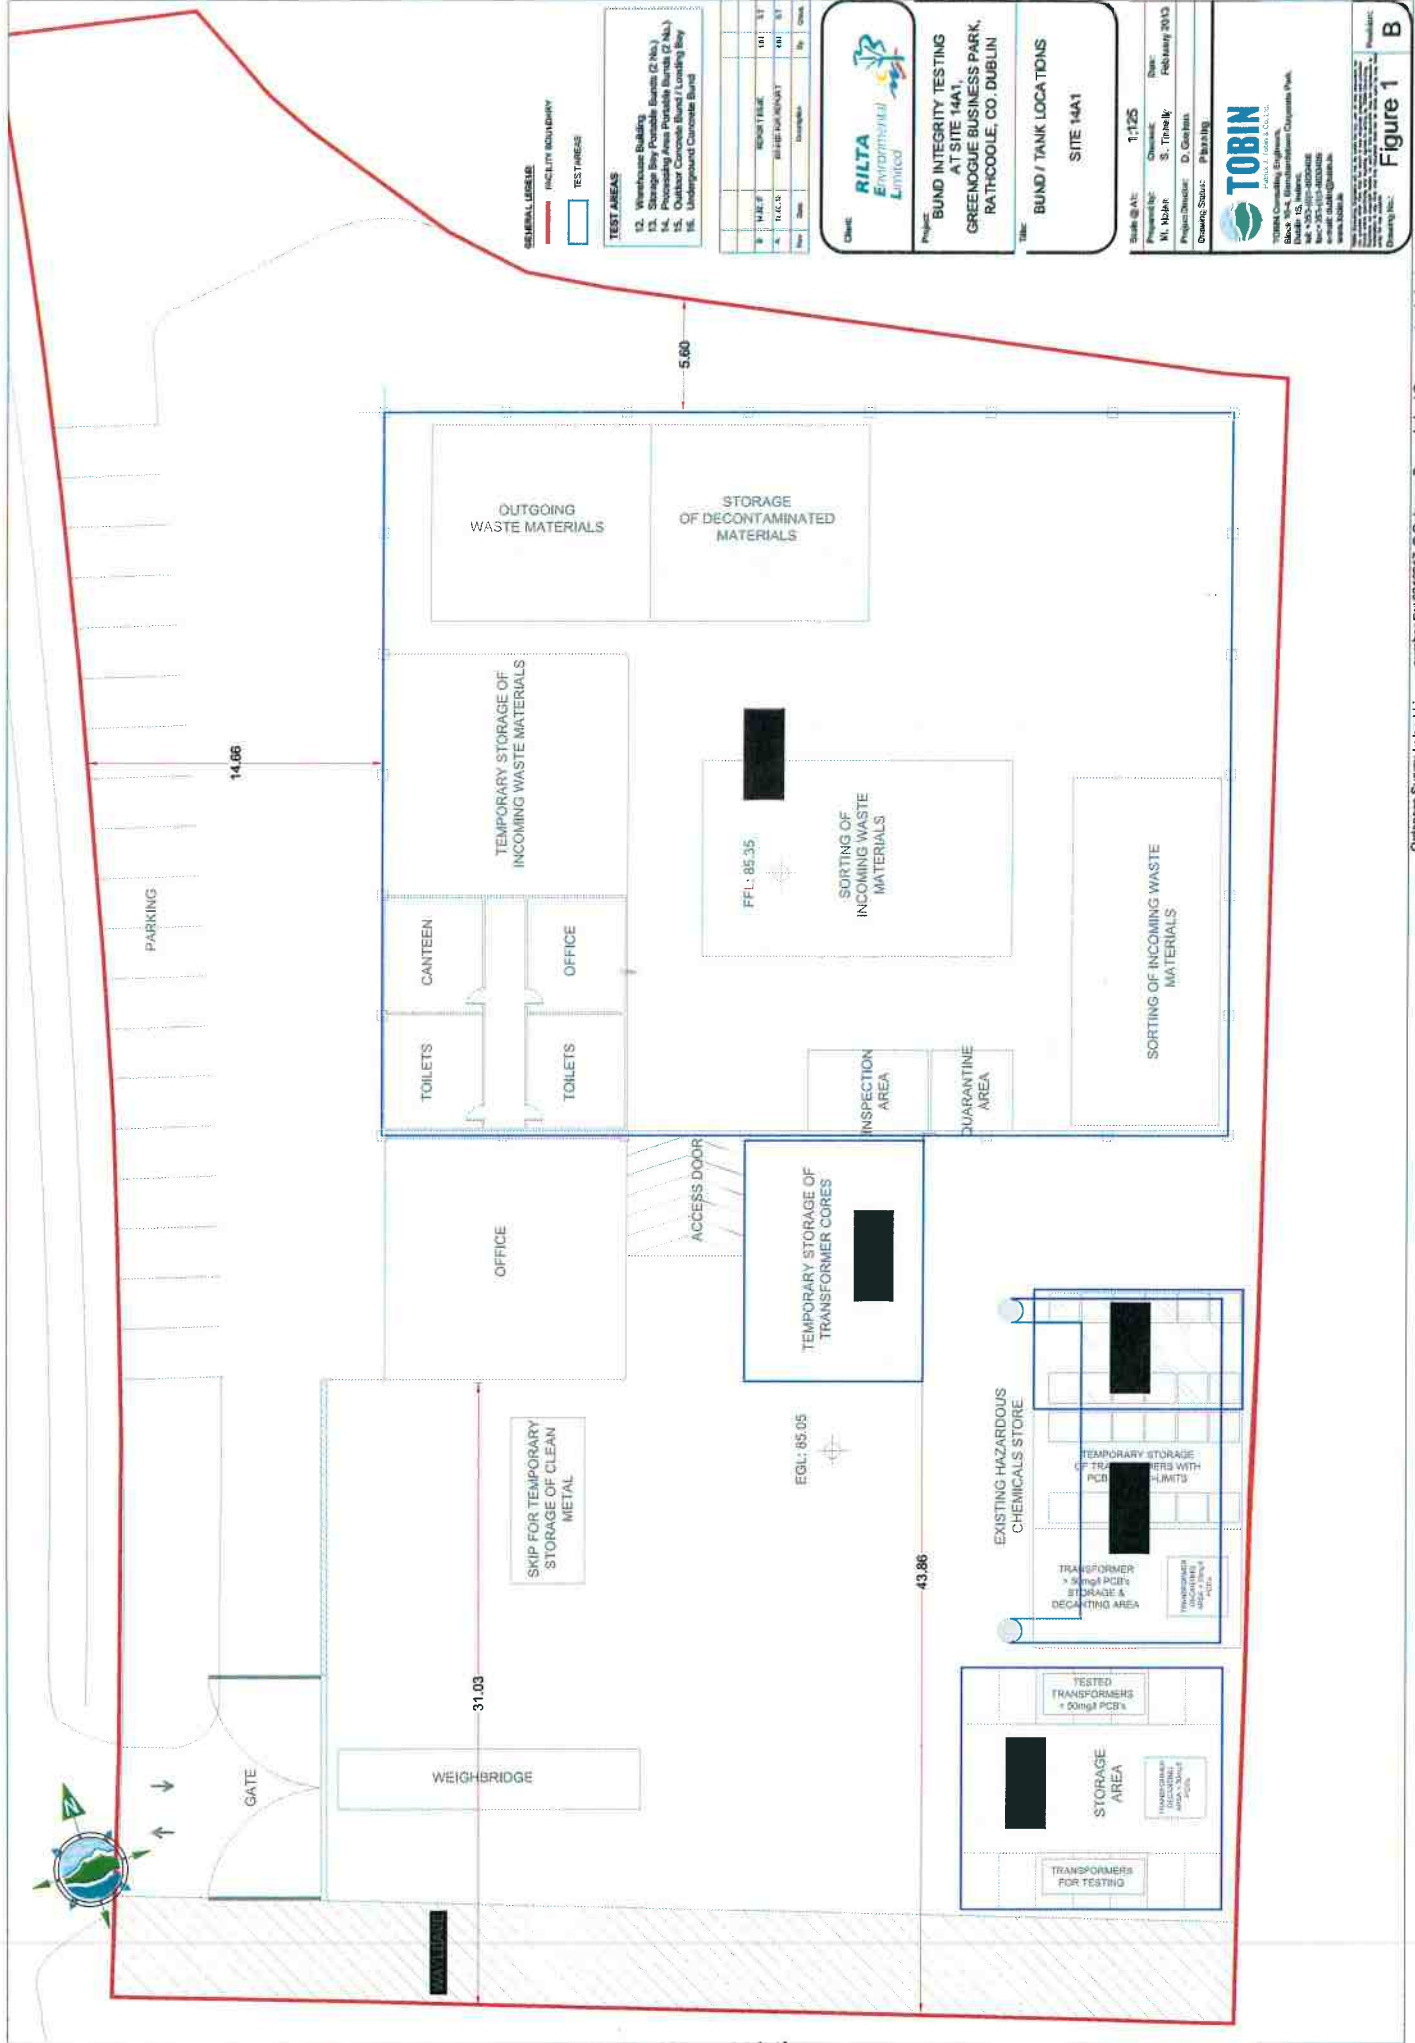
CCTV Survey = **Pass** (Remedial works recommended)

APPENDIX A

Figure 1: Bund / Tank Locations for Testing
(Site 14A1, Greenogue Business Park)

APPENDIX B

Site 14A1 (Ref. Cedar Yard) - CCTV Drainage Inspection Report



GENERAL LEGEND
 INCLIN INDOORRY
 ESTIMATED

TEST AREAS
 12. Warehouse Building
 13. Storage Bay Portable Bunks (2 No.)
 14. Processing Area Portable Bunks (2 No.)
 15. Outdoor Concrete Bunk / Loading Bay
 16. Underground Concrete Bunk

REF	REPORT TITLE	DATE
A	RISE PLAN	01/11/17
B	RISE PLAN	01/11/17



Client: RILTA Environmental Limited
Project: BUND INTEGRITY TESTING AT SITE 14A1, GREENOGUE BUSINESS PARK, RATHCOOLE, CO. DUBLIN
Title: BUND / TANK LOCATIONS SITE 14A1

Scale: 1:125
Prepared by: M. Nisar
Checked: S. Thrack
Date: February 2018
Project Director: D. Graham
Drawn Status: Planning

TOBIN
 TOBIN Consulting Engineers Ltd.
 Block 16-C, Broomfield Business Park,
 16-18, Broomfield Road,
 M-30, 18th Floor, Broomfield,
 Dublin 15, Ireland
 Tel: +353 (0)1 453 6000
 Fax: +353 (0)1 453 6001
 Email: info@tobin.ie
 www.tobin.ie

Figure 1 B

A ClearCircle Environmental Company



www.clearcircle.com



INTEGRATED HAZARDOUS WASTE MANAGEMENT SOLUTIONS

CCTV DRAINAGE INSPECTION REPORT

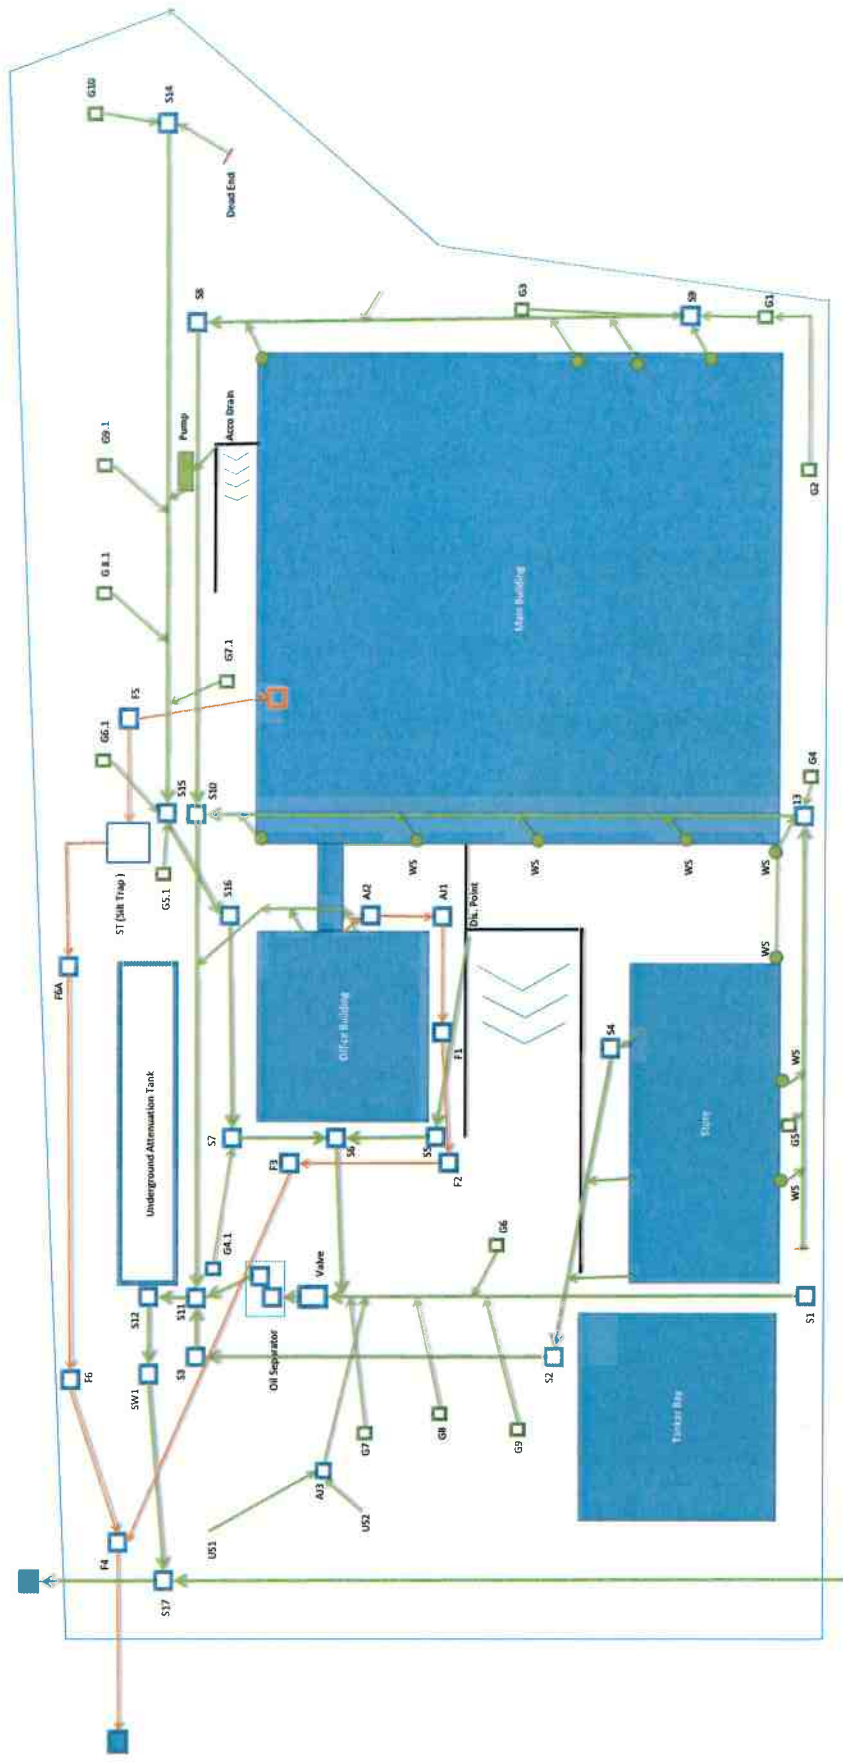
***Block 14A1, Grants Road,
Greenogue Business Park,
Rathcoole, Co. Dublin.***



Block 402, Greenogue Business Park,
Rathcoole, Co. Dublin
Tel: +353 (0) 1 401 8000
Fax: +353 (0) 1 401 8080
Email: info@rilta.ie
www.rilta.ie



EPA WASTE LICENCE NO. W0192-03



Project-information / Inspection: 1

Project name :
CEDAR

Project Number :

Contact :

Date :
05/12/2016

Client **CEDAR**
 Responsible: **Colm Hussey**
 Department:
 Street: **Greenogue Business Park**
 City, St Zip: **Rathcoole**
 Po Box: **Dublin**
 Telephone:
 Fax:
 Mobile:
 e-mail:

Proj mgr **CEDAR**
 Responsible: **Colm Hussey**
 Department:
 Street: **Greenogue Business Park**
 City, St Zip: **Rathcoole**
 Po Box: **Dublin**
 Telephone:
 Fax:
 Mobile:
 e-mail:

Contractor **Rilta Environmental Ltd**
 Responsible: **Eoin Kirby, Frantisek Navratil**
 Department: **Contracts**
 Street: **Greenogue Business Park**
 City, St Zip: **Rathcoole**
 Po Box: **Dublin**
 Telephone: **01 4018000**
 Fax:
 Mobile: **0877988574**
 e-mail: **info@rilta.ie**

Inspection report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 1	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : AJ1
Road : Greenogue Busniss Park	Catchment:	U/S Depth : F1
Location Property with buildings	Tape number : 051216_1	D/S MH : F1
Inspection AJ1 (D/S) F1	Pipe Length	D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 7.71 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
	AJ1					
	0.00	IC	Start node type, inspection chamber, reference number : AJ1	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	1.80	SR	Sealing ring intruding, from 5 to 7 o'clock	00:00:18		(Constr) 1
	2.20	LR	Line deviates right Remarks: 90deg.	00:00:23		(Serv) 0
	7.70	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	7.71	MHF	Finish node type, manhole reference number: F1	00:00:00	1_6A	(Constr) 0
	F1					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.65	5	1	0	0	0	0	1

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 05/12/2016	Section number : 1	PLR Suffix : X
----------------------	----------------------------------	----------------------	-----------------------	-------------------



Photo: 1_6A, MPEG #: 051216_1, 00:00:00
7.71m, Finish node type, manhole reference number: F1

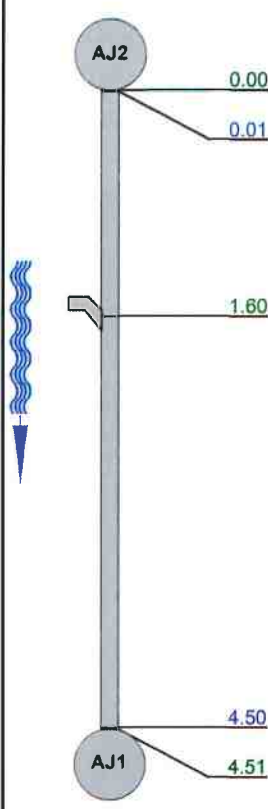
Inspection report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 2	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location Property with buildings	Inspection AJ2 (D/S) AJ1	Location details: Catchment: Tape number : 051216_1 Pipe Length	U/S MH : AJ2 U/S Depth : D/S MH : AJ1 D/S Depth :
-----------------------------	---	--	------------------------------------	--	--

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.51 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	IC	Start node type, inspection chamber, reference number : AJ2	00:00:01		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	1.60	CN	Connection other than junction, at 3 o'clock, diameter 150mm	00:00:23		(Constr) 0
	4.50	WL	Water level, 0% of the vertical dimension	00:01:02		(Serv) 0
	4.51	ICF	Finish node type, inspection chamber reference number: AJ1	00:01:02		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

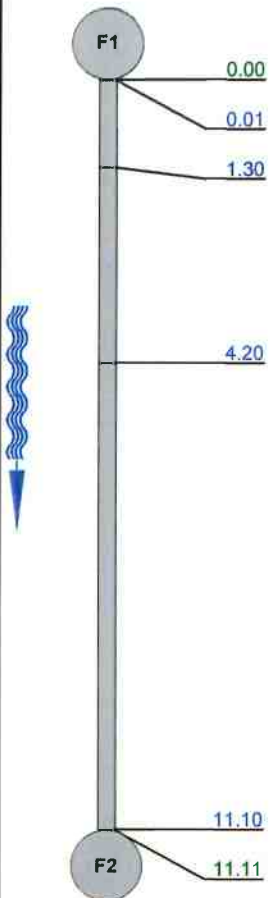

Inspection report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 3	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : F1
Road : Greenoque Busniss Park	Catchment:	U/S Depth : F2
Location Property with buildings	Tape number : 051216_1	D/S MH : F2
Inspection F1 (D/S) F2	Pipe Length	D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 11.11 m	Lining :

Comment :

1:105	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : F1	00:00:04		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:04		(Serv) 0
	1.30	WL	Water level, 5% of the vertical dimension	00:00:16		(Serv) 0
	4.20	WL	Water level, 0% of the vertical dimension	00:00:48		(Serv) 0
	11.10	WL	Water level, 0% of the vertical dimension	00:01:55		(Serv) 0
		MHF	Finish node type, manhole reference number: F2	00:01:55		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

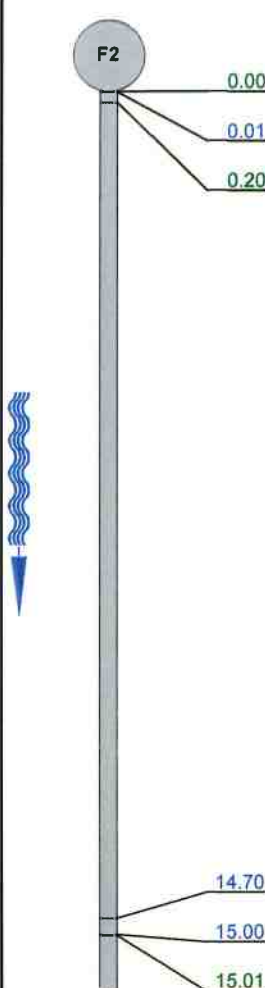
Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location Property with buildings	Inspection F2 (D/S) F3	Location details: Catchment: Tape number : 051216_1 Pipe Length	U/S MH : F2 U/S Depth : D/S MH : F3 D/S Depth :
-----------------------------	---	--	----------------------------------	---	--

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 147.00 m	Lining :

Comment :

1:126	Position	Code	Observation	MPEG	Photo	Grade
	F2					
	0.00	MH	Start node type, manhole, reference number : F2	00:00:05		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:05		(Serv) 0
	0.20	SR	Sealing ring intruding, from 6 to 12 o'clock	00:00:07	4_3A	(Constr) 1
	14.70	LL	Line deviates left	00:03:32		(Serv) 0
	15.00	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	15.01	MHF	Finish node type, manhole reference number: F3	00:00:00		(Constr) 0





Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade

Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade




Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade

Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade
						





Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

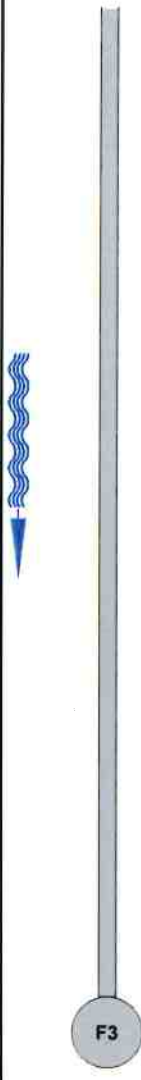
Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade

Inspection Report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 4	PLR : X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:126	Position	Code	Observation	MPEG	Photo	Grade
<div style="position: relative; width: 100%; height: 100%;">  </div>						

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.03	5	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 05/12/2016	Section number : 4	PLR Suffix : X
-----------------------------	---	-----------------------------	------------------------------	--------------------------



Photo: 4_3A, MPEG #: 051216_1, 00:00:07
0.2m, Sealing ring intruding, from 6 to 12 o'clock

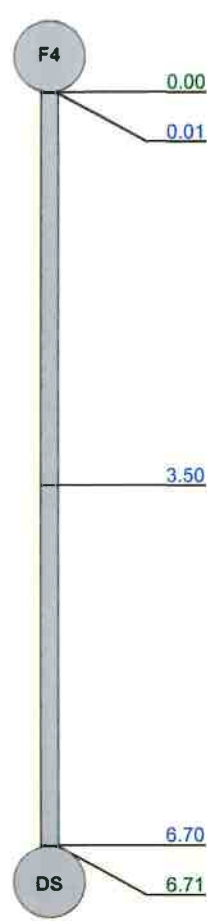
Inspection report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 5	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenoque Busniss Park	Location details: Catchment:	U/S MH : F4
Location Property with buildings	Inspection F4 (D/S) DS	Tape number : 051216_1	U/S Depth : DS
		Pipe Length	D/S MH : DS
			D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Concrete
Total length : 6.71 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : F4	00:00:02		(Constr) 0
	0.01	WLC	Clear water level, 10% of the vertical dimension	00:00:02		(Serv) 0
	3.50	WL	Water level, 15% of the vertical dimension	00:01:05		(Serv) 0
	6.70	WL	Water level, 15% of the vertical dimension	00:01:58		(Serv) 0
	6.71	MHF	Finish node type, manhole reference number: DS Remarks: Manhole on site next to Cedar.	00:01:58		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

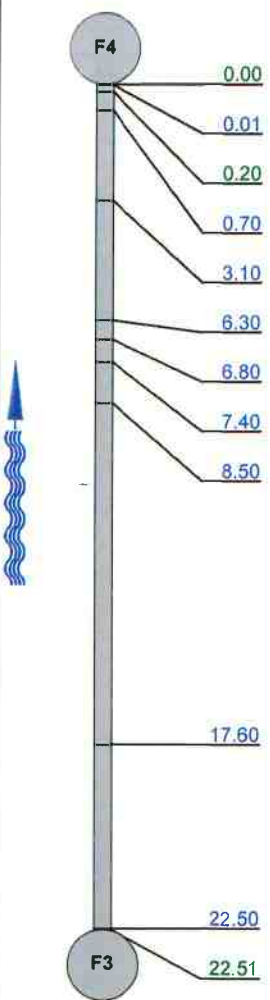
Inspection report / Inspection: 1

Date : 05/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 6	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings F4 (U/S) F3	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	F3 F4
---	---	---	----------	--	----------

Use: Year laid : Purpose : Total length :	Foul Routine inspection of condition 22.51 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 150.00 mm Concrete
--	--	--	-----------------------------------

Comment :

1:189	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : F4	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.20	CN	Connection other than junction, at 6 o'clock, diameter 150mm Remarks: Rodding Eye.	00:00:11		(Constr) 0
	0.70	WLC	Clear water level, 5% of the vertical dimension	00:00:24		(Serv) 0
	3.10	WL	Water level, 0% of the vertical dimension	00:00:46		(Serv) 0
	6.30	WL	Water level, 5% of the vertical dimension	00:01:19		(Serv) 0
	6.80	WL	Water level, 10% of the vertical dimension	00:01:24		(Serv) 0
	7.40	WL	Water level, 15% of the vertical dimension	00:01:32		(Serv) 0
	8.50	WL	Water level, 0% of the vertical dimension	00:01:45		(Serv) 0
	17.60	WL	Water level, 5% of the vertical dimension	00:03:36		(Serv) 0
	22.50	WL	Water level, 0% of the vertical dimension	00:04:09		(Serv) 0
	22.51	MHF	Finish node type, manhole reference number: F3	00:04:09		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 7	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : F6
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : F4
Inspection F4 (U/S) F6	Pipe Length	D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Concrete
Total length : 14.81 m	Lining :

Comment :

1:126	Position	Code	Observation	MPEG	Photo	Grade
	F4					
	<u>0.00</u>	MH	Start node type, manhole, reference number : F4	00:00:00		(Constr) 0
	<u>0.01</u>	WL	Water level, 15% of the vertical dimension	00:00:00		(Serv) 0
	<u>5.00</u>	WLC	Clear water level, 5% of the vertical dimension	00:00:49		(Serv) 0
	<u>6.80</u>	WL	Water level, 0% of the vertical dimension	00:01:14		(Serv) 0
	<u>8.30</u>	CM	Cracks, multiple, from 4 to 8 o'clock	00:01:22	7_5A	(Struct) 3
	<u>14.30</u>	DEC	Settled deposits, hard or compacted, 10% cross-sectional area loss Remarks: A lump of the concrete after building.	00:02:24	7_6A	(Serv) 3
	<u>14.60</u>	WL	Water level, 0% of the vertical dimension	00:02:33		(Serv) 0
	<u>14.80</u>	WL	Water level, 10% of the vertical dimension	00:02:33		(Serv) 0
	<u>14.81</u>	MH	Start node type, manhole, reference number : F4	00:02:33		(Constr) 0
	F6					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 06/12/2016	Section number : 7	PLR Suffix : X
-----------------------------	---	-----------------------------	------------------------------	--------------------------



Photo: 7_5A, MPEG #: 051216_1, 00:01:22
8.3m, Cracks, multiple, from 4 to 8 o'clock



Photo: 7_6A, MPEG #: 051216_1, 00:02:24
14.3m, Settled deposits, hard or compacted, 10% cross-sectional area loss

Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 8	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : F5
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Inspection	Property with buildings F5 (D/S) ST	Tape number : 051216_1
	Pipe Length	D/S MH : ST
		D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 8.01 m	Lining :

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
	F5					
	0.00	MH	Start node type, manhole, reference number : F5	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	7.40	REM	General remark Remarks: Dents	00:01:02	8_3A	(Misc) 0
	8.00	WL	Water level, 0% of the vertical dimension	00:01:25		(Serv) 0
	8.01	MHF	Finish node type, manhole reference number: ST Remarks: Silt Trap	00:01:25		(Constr) 0
	ST					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place :
Rathcoole

Road :
Greenoque Busniss Park

Date :
06/12/2016

Section number :
8

PLR Suffix :
X

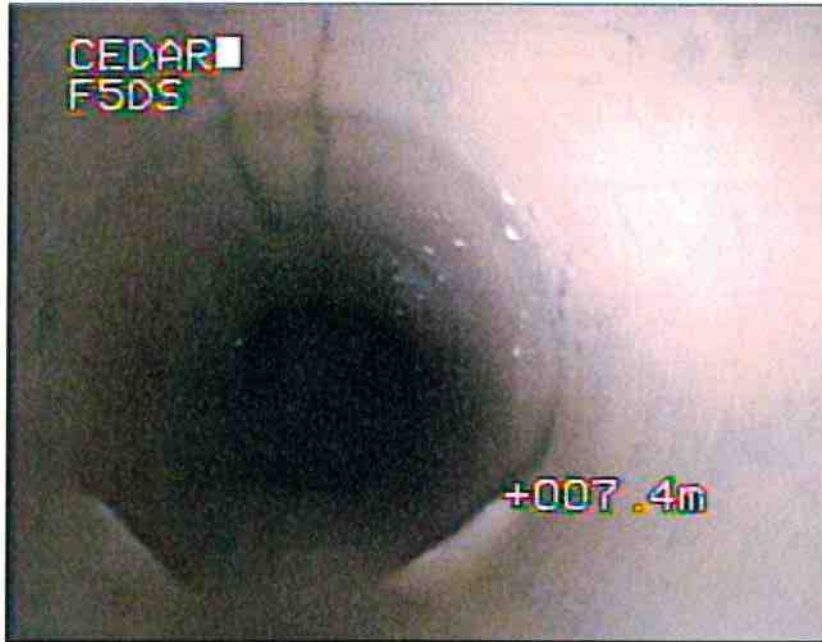


Photo: 8_3A, MPEG #: 051216_1, 00:01:02
7.4m, General remark

Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 9	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : US
Location Property with buildings	Property with buildings	Tape number : 051216_1	U/S Depth : F5
Inspection F5 (U/S) US	F5 (U/S) US	Pipe Length	D/S MH : F5
			D/S Depth :

Use: Foul	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 9.51 m	Lining :

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
	F5					
	<u>0.00</u>	MH	Start node type, manhole, reference number : F5	00:00:01		(Constr) 0
	<u>0.01</u>	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	<u>3.60</u>	WL	Water level, 5% of the vertical dimension	00:00:40		(Serv) 0
	<u>5.00</u>	WL	Water level, 0% of the vertical dimension	00:01:29		(Serv) 0
	<u>8.20</u>	REM	General remark Remarks: Dents	00:01:55	9_5A	(Misc) 0
	<u>9.40</u>	CN	Connection other than junction, at 12 o'clock, diameter 40mm Remarks: Connection from cabin inside of the buildi	00:02:06		(Constr) 0
	<u>9.50</u>	WL	Water level, 0% of the vertical dimension	00:02:07		(Serv) 0
	<u>9.51</u>	SA	Survey abandoned Remarks: Survey could not be completed due to a wavin pipe in the way.	00:02:07		(Misc) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 06/12/2016	Section number : 9	PLR Suffix : X
----------------------	----------------------------------	----------------------	-----------------------	-------------------



Photo: 9_5A, MPEG #: 051216_1, 00:01:55
8.2m, General remark

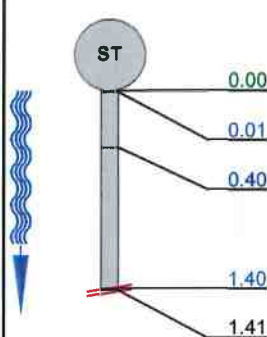
Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 10	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : ST
Location Inspection	Property with buildings ST (D/S) F6A	Tape number : 051216_1	U/S Depth : D/S MH : F6A
Use: Foul		Pipe shape : Circular	D/S Depth :

Year laid : Purpose : Total length : 1.41 m	Routine inspection of condition	Pipe size : 150.00 mm	Pipe material : Polyvinyl chloride
Lining :			

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	CP	Start node type, catchpit, reference number : ST	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.40	LL	Line deviates left Remarks: 90 deg.	00:00:25		(Serv) 0
	1.40	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	1.41	SA	Survey abandoned Remarks: Survey could not be completed due to a bend on the pipe and bad access to thi	00:00:00		(Misc) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 11	PLR SUFFIX: X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings AJ3 (D/S) DS	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	AJ3 DS


Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 11.90 m	Lining :

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
	AJ3					
	0.00	IC	Start node type, inspection chamber, reference number : AJ3	00:00:02		(Constr) 0
	0.01	WL	Water level, 5% of the vertical dimension	00:00:01		(Serv) 0
	5.40	WL	Water level, 10% of the vertical dimension	00:03:17		(Serv) 0
	5.80	WL	Water level, 30% of the vertical dimension	00:00:49		(Serv) 0
	6.60	CUW	Loss of vision, camera under water	00:00:57		(Misc) 0
	8.20	LR	Line deviates right Remarks: 45 deg.	00:01:18		(Serv) 0
	8.30	WL	Water level, 30% of the vertical dimension	00:01:20		(Serv) 0
	9.00	WL	Water level, 15% of the vertical dimension	00:01:35		(Serv) 0
	9.10	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:34		(Constr) 0

Inspection Report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : rain	Operator : Frantisek	Section number : 11	PLR : X
Weather rain	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Grade:

1:84	Position	Code	Observation	MPEG	Photo	Grade
						

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

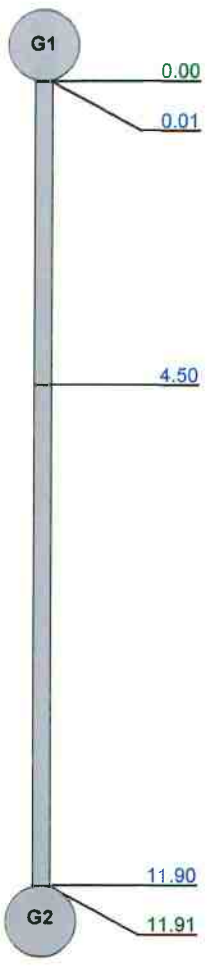
Inspection report / Inspection: 1

Date : 06/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 12	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenoque Busniss Park Property with buildings G1 (U/S) G2	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	G2 G1
---	---	---	-----------------	--	------------------------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 11.91 m	Lining :

Comment :

1:105	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G1	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	4.50	LR	Line deviates right Remarks: 90 deg.	00:01:33		(Serv) 0
	11.90	WL	Water level, 0% of the vertical dimension	00:03:46		(Serv) 0
	11.91	GYF	Finish node type, gully reference number: G2	00:03:46		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 14	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings AJ3 (U/S) US2	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	US2 AJ3

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 2.21 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 100.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	AJ3	IC	Start node type, inspection chamber, reference number : AJ3	00:00:02		(Constr) 0
	0.00					
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	1.90	LU	Line deviates up	00:00:18		(Serv) 0
	2.20	WL	Water level, 0% of the vertical dimension	00:00:20		(Serv) 0
	2.21	GYF	Finish node type, gully reference number: US2 Remarks: Gully under the weightbridge.	00:00:20		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

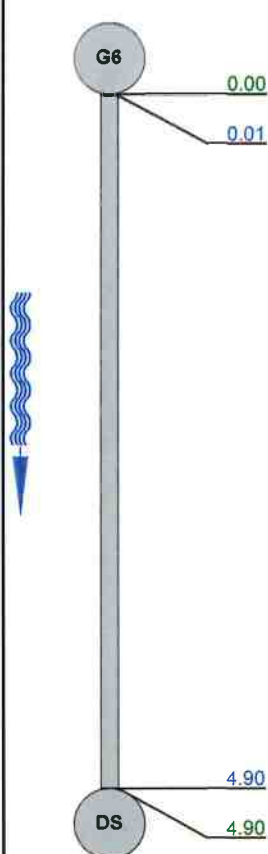
Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 15	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G6
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : DS
Inspection G6 (D/S) DS	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.90 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G6	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	4.90	WL	Water level, 0% of the vertical dimension	00:01:35		(Serv) 0
	4.90	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:35		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

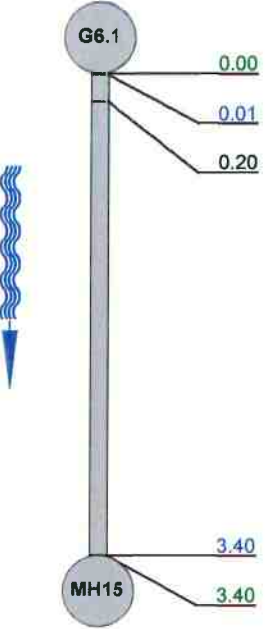
Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 16	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : G6.1
Location Inspection	Property with buildings G6.1 (D/S) MH15	Tape number : 051216_1	U/S Depth : D/S MH : MH15
		Pipe Length	D/S Depth :

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 3.40 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 150.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G6.1	00:01:21		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.20	REM	General remark Remarks: Socket are connected up side down.	00:00:05		(Misc) 0
	3.40	WL	Water level, 0% of the vertical dimension	00:00:34		(Serv) 0
	3.40	MHF	Finish node type, manhole reference number: MH15	00:00:34		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 17	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G7.1
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Inspection	Tape number : 051216_1	D/S MH : DS
Property with buildings G7.1 (D/S) DS	Pipe Length	D/S Depth :

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 9.81 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 150.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
	0.00	GY	Start node type, gully, reference number : G7.1	00:01:41		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	3.60	WLC	Clear water level, 5% of the vertical dimension	00:00:42		(Serv) 0
	4.40	WLC	Clear water level, 0% of the vertical dimension	00:00:51		(Serv) 0
	9.80	WL	Water level, 0% of the vertical dimension	00:01:41		(Serv) 0
	9.81	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:41		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

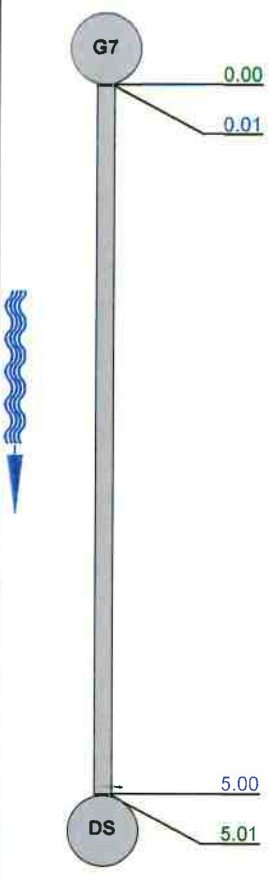
Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 18	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings G7 (D/S) DS	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	G7 DS
---	---	---	----------	--	--------------

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 5.01 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 100.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
		GY	Start node type, gully, reference number : G7	00:00:00		(Constr) 0
		WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
		WL	Water level, 0% of the vertical dimension	00:00:50		(Serv) 0
		BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:00:50		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

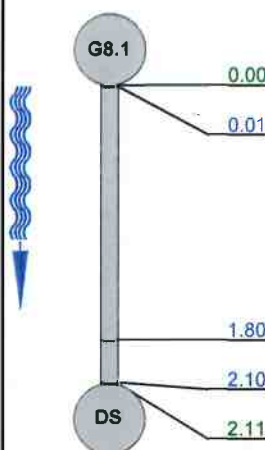
Inspection report / Inspection: 1

Date : 22/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 19	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G8.1	D/S MH : DS
Road : Greenogue Busniss Park	Catchment:	U/S Depth :	D/S Depth :
Location Inspection	Property with buildings G8.1 (D/S) DS	Tape number : 051216_1	Pipe Length

Use: Year laid : Purpose : Total length :	Surface water Routlne inspection of condition 2.11 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 100.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G8.1	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	1.80	LR	Line deviates right	00:00:15		(Serv) 0
	2.10	WL	Water level, 0% of the vertical dimension	00:00:20		(Serv) 0
	2.11	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:00:20		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

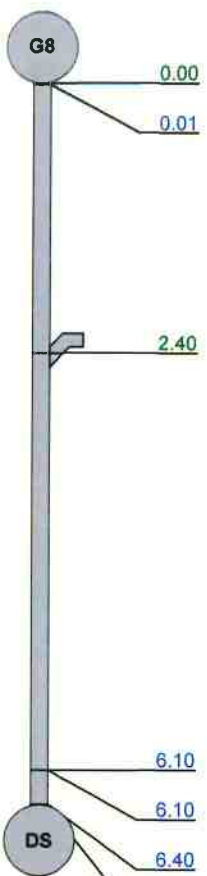
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 20	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings G8 (D/S) DS	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	G8 DS

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 6.41 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G8	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	2.40	CN	Connection other than junction, at 9 o'clock, diameter 100mm	00:00:35		(Constr) 0
	6.10	LR	Line deviates right Remarks: 45 deg.	00:01:18		(Serv) 0
	6.10	WL	Water level, 0% of the vertical dimension	00:01:21		(Serv) 0
	6.40	WL	Water level, 5% of the vertical dimension	00:01:21		(Serv) 0
	6.41	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:21		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

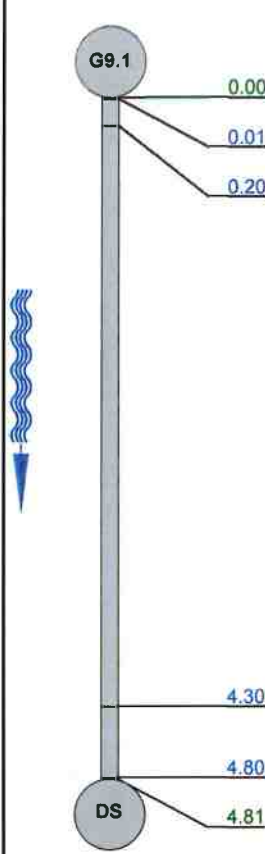
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 21	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G9.1
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Inspection G9.1 (D/S) DS	Tape number : 051216_1 Pipe Length	D/S MH : DS D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.81 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G9.1	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.20	LL	Line deviates left Remarks: 45 deg.	00:00:01		(Serv) 0
	4.30	LD	Line deviates down	00:00:42		(Serv) 0
	4.80	WL	Water level, 0% of the vertical dimension	00:01:03		(Serv) 0
	4.81	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:03		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 22	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G9
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : DS
Inspection G9 (D/S) DS	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 7.41 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
	0.00	GY	Start node type, gully, reference number : G9	00:00:01		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	0.90	SR	Sealing ring intruding, from 5 to 7 o'clock	00:00:12	22_3A	(Constr) 1
	6.30	REM	General remark Remarks: Socket on this pipe are connected against the stream.	00:01:12		(Misc) 0
	7.40	WL	Water level, 0% of the vertical dimension	00:01:25		(Serv) 0
	7.41	BRF	Finish node type, major connection without manhole reference number: DS Remarks: This pipe is connected to	00:01:25		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.67	5	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 22	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 22_3A, MPEG #: 051216_1, 00:00:12
0.9m, Sealing ring intruding, from 5 to 7 o'clock



Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 23	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S2 (D/S) S3	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S2 S3
---	---	---	----------	--	--------------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 31.10 m	Lining :

Comment :

1:252	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S2	00:00:00		(Constr) 0
		WLC	Clear water level, 0% of the vertical dimension	00:00:00		(Serv) 0
		SR	Sealing ring intruding, from 11 to 3 o'clock	00:04:31	23_3A	(Constr) 1
		LR	Line deviates right Remarks: 45 deg.	00:05:02		(Serv) 0
		WL	Water level, 0% of the vertical dimension	00:05:15		(Serv) 0
		MHF	Finish node type, manhole reference number: S3	00:05:15		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.16	5	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 23	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 23_3A, MPEG #: 051216_1, 00:04:31
30m, Sealing ring intruding, from 11 to 3 o'clock

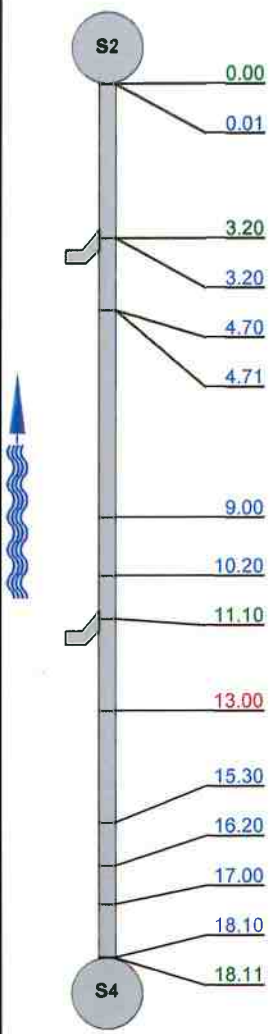
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 24	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S2 (U/S) S4	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S4 S2
---	---	---	-----------------	--	------------------------

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 18.11 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 225.00 mm Polyvinyl chloride
--	--	--	--

Comment :

1:147	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S2	00:00:00		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	3.20	CN	Connection other than junction, at 2 o'clock, diameter 100mm	00:00:27		(Constr) 0
	3.20	WL	Water level, 5% of the vertical dimension	00:00:29		(Serv) 0
	4.70	WL	Water level, 0% of the vertical dimension	00:00:43		(Serv) 0
	4.71	LL	Line deviates left Remarks: 45 deg.	00:00:43		(Serv) 0
	9.00	WL	Water level, 5% of the vertical dimension	00:01:23		(Serv) 0
	10.20	WL	Water level, 0% of the vertical dimension	00:01:34		(Serv) 0
	11.10	CN	Connection other than junction, at 3 o'clock, diameter 100mm	00:01:41		(Constr) 0
	13.00	SZ	Surface damage, other, from 8 to 9 o'clock Remarks: A piece of wire damaged surface of this pipe .	00:02:35	24_10A	(Struct) 0
	15.30	WL	Water level, 5% of the vertical dimension	00:03:03		(Serv) 0
	16.20	WL	Water level, 10% of the vertical dimension	00:03:10		(Serv) 0
	17.00	WL	Water level, 0% of the vertical dimension	00:03:43		(Serv) 0
	18.10	WL	Water level, 0% of the vertical dimension	00:03:53		(Serv) 0
	18.11	MHF	Finish node type, manhole reference number: S4	00:03:53		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 24	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 24_10A, MPEG #: 051216_1, 00:02:35
13m, Surface damage, other, from 8 to 9 o'clock

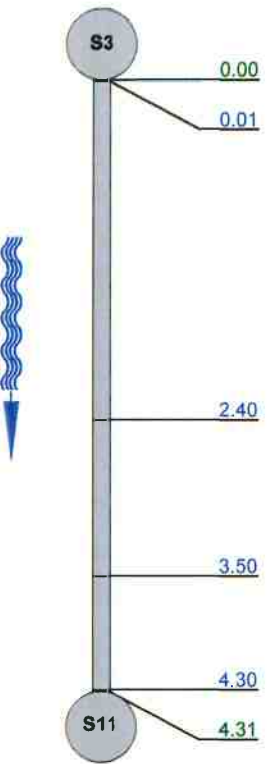
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 25	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : S3
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : S11
Inspection S3 (D/S) S11	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.31 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S3	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	2.40	WLC	Clear water level, 5% of the vertical dimension	00:00:25		(Serv) 0
	3.50	LL	Line deviates left Remarks: 45 deg.	00:00:33		(Serv) 0
	4.30	WL	Water level, 0% of the vertical dimension	00:00:44		(Serv) 0
	4.31	MHF	Finish node type, manhole reference number: S11	00:00:44		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 26	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : US	U/S Depth :
Road : Greenogue Busniss Park	Catchment:	D/S MH : S4	D/S Depth :
Location Property with buildings	Tape number : 051216_1		
Inspection S4 (U/S) US	Pipe Length		

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.10 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S4	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	3.00	WL	Water level, 0% of the vertical dimension	00:00:19		(Serv) 0
	3.01	BRF	Finish node type, major connection without manhole reference number: US Remarks: Retention Tank.	00:00:19		(Constr) 0
	4.10	LD	Line deviates down Remarks: 45 deg.	00:00:20		(Serv) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 27	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S5 (U/S) DP	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	DP S5

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 15.91 m	Lining :

Comment :

1:126	Position	Code	Observation	MPEG	Photo	Grade
	S5					
	0.00	MH	Start node type, manhole , reference number : S5	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.40	LL	Line deviates left Remarks: 45 deg.	00:00:03		(Serv) 0
	1.10	LL	Line deviates left Remarks: 15-30 deg.	00:00:07		(Serv) 0
	4.40	WLC	Clear water level, 5% of the vertical dimension	00:00:32		(Serv) 0
	4.90	WL	Water level, 10% of the vertical dimension	00:00:36		(Serv) 0
	6.30	WL	Water level, 5% of the vertical dimension	00:00:45		(Serv) 0
	8.50	WL	Water level, 0% of the vertical dimension	00:01:09		(Serv) 0
	11.10	OJM	Open joint, medium Remarks: Pipes are not connected fully.	00:01:44	27_9A	(Struct) 1
	11.60	WL	Water level, 5% of the vertical dimension	00:01:47		(Serv) 0
	13.70	WL	Water level, 0% of the vertical dimension	00:02:05		(Serv) 0
	15.40	LR	Line deviates right Remarks: 90 deg.	00:02:23		(Serv) 0
	15.90	WL	Water level, 0% of the vertical dimension	00:02:29		(Serv) 0
	15.91	BRF	Finish node type, major connection without manhole reference number: DP Remarks: Discharging Point of aco	00:02:29		(Constr) 0
	DP					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	1	0.06	1	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 27	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 27_9A, MPEG #: 051216_1, 00:01:44
11.1m, Open joint, medium

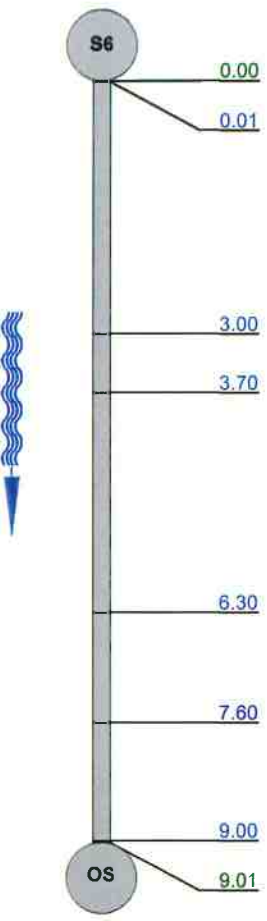
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 28	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : S6
Location Inspection	Property with buildings S6 (D/S) OS	Tape number : 051216_1	U/S Depth : OS
		Pipe Length	D/S MH : OS
			D/S Depth :

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 9.01 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 225.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number ; S6	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	3.00	WL	Water level, 5% of the vertical dimension	00:00:31		(Serv) 0
	3.70	WL	Water level, 10% of the vertical dimension	00:00:37		(Serv) 0
	6.30	WL	Water level, 15% of the vertical dimension	00:00:59		(Serv) 0
	7.60	WL	Water level, 10% of the vertical dimension	00:01:10		(Serv) 0
	9.00	WL	Water level, 10% of the vertical dimension	00:01:22		(Serv) 0
	9.01	BRF	Finish node type, major connection without manhole reference number: OS Remarks: This pipe is connected to	00:01:22		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1



Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 29	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : S5
Location Property with buildings	Inspection S6 (U/S) S5	Tape number : 051216_1	U/S Depth :
		Pipe Length	D/S MH : S6
			D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 7.61 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S6	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
						
	7.60	WL	Water level, 0% of the vertical dimension	00:01:51		(Serv) 0
	7.61	MHF	Finish node type, manhole reference number: S5	00:01:51		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1





Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 30	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S6 (U/S) S7	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S7 S6
---	---	---	----------	--	----------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 8.11 m	Lining :

Comment :

1:84	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S6	00:00:00		(Constr) 0
		WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
		WLC	Clear water level, 0% of the vertical dimension	00:01:05		(Serv) 0
		MHF	Finish node type, manhole reference number: S7	00:01:05		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

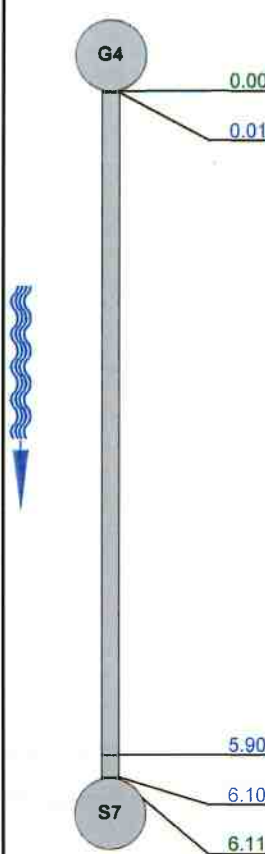
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 31	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings G4 (D/S) S7	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	G4 S7

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 6.11 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	GY	Start node type, gully, reference number : G4	00:00:58		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:58		(Serv) 0
	5.90	LR	Line deviates right Remarks: 45 deg.	00:00:58		(Serv) 0
	6.10	WL	Water level, 0% of the vertical dimension	00:01:03		(Serv) 0
	6.11	MHF	Finish node type, manhole reference number: S7	00:01:03		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 32	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenoque Busniss Park Property with buildings S8 (U/S) S9	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	S9 S8 S8

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 37.71 m	Lining :

Comment :

1:315	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S8	00:00:03		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:03		(Serv) 0
	2.90	CN	Connection other than junction, at 2 o'clock, diameter 100mm	00:00:32		(Constr) 0
	4.50	WL	Water level, 5% of the vertical dimension	00:00:49		(Serv) 0
	7.20	CN	Connection other than junction, at 10 o'clock, diameter 100mm	00:01:09		(Constr) 0
	16.30	CN	Connection other than junction, at 2 o'clock, diameter 100mm	00:02:27		(Constr) 0
	25.50	WL	Water level, 0% of the vertical dimension	00:03:57		(Serv) 0
	28.40	CN	Connection other than junction, at 2 o'clock, diameter 100mm	00:03:55		(Constr) 0
	37.70	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	37.71	MHF	Finish node type, manhole reference number: S9	00:00:00		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 33	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S8 (D/S) S10	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S8 S10
---	--	---	----------	--	-----------

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 37.41 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 225.00 mm Polyvinyl chloride
--	---	--	---

Comment :

1:315	Position	Code	Observation	MPEG	Photo	Grade
	S8					
	0.00	MH	Start node type, manhole, reference number : S8	00:00:01		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	30.60	WL	Water level, 5% of the vertical dimension	00:04:41		(Serv) 0
	31.70	LL	Line deviates left Remarks: 15	00:04:20		(Serv) 0
	31.90	WL	Water level, 0% of the vertical dimension	00:04:26		(Serv) 0
	37.40	WL	Water level, 5% of the vertical dimension	00:04:46		(Serv) 0
	37.41	MHF	Finish node type, manhole reference number: S10	00:04:46		(Constr) 0
	S10					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1




Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 34	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S9 (U/S) G1	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	G1 S9
---	---	---	----------	--	--------------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 5.61 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S9	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
						
	5.60	WLC	Clear water level, 0% of the vertical dimension	00:00:57		(Serv) 0
						
	5.61	GYF	Finish node type, gully reference number: G1	00:00:57		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 35	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : no	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G3
Road : Greenogue Busniss Park	Catchment:	U/S Depth : S9
Location Inspection S9 (U/S) G3	Tape number : 051216_1 Pipe Length	D/S MH : S9 D/S Depth :

Use: Year laid : Purpose : Total length : Surface water Routine inspection of condition 10.81 m	Pipe shape : Pipe size : Pipe material : Lining : Circular 150.00 mm Polyvinyl chloride
---	---

Comment :

1:105	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S9	00:00:01		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	3.00	DES	Settled deposits, fine, 5% cross-sectional area loss	00:00:27		(Serv) 2
	5.20	WL	Water level, 10% of the vertical dimension	00:00:38		(Serv) 0
	8.50	WL	Water level, 0% of the vertical dimension	00:00:58		(Serv) 0
	10.80	WL	Water level, 0% of the vertical dimension	00:01:12		(Serv) 0
	10.81	GYF	Finish node type, gully reference number: G3	00:01:12		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	1	1	0.09	1	2

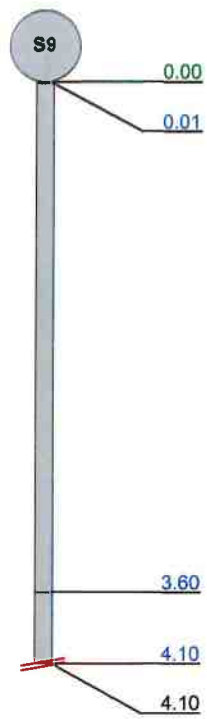
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 36	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : no	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : US2
Road : Greenoque Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : S9
Inspection S9 (U/S) US2	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 4.10 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S9	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	3.60	LU	Line deviates up	00:00:30		(Serv) 0
	4.10	WL	Water level, 0% of the vertical dimension	00:00:41		(Serv) 0
	4.10	SA	Survey abandoned Remarks: Survey could not be completed due to Length of this pipe. This pipe is a water s	00:00:41		(Misc) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 37	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : S10
Road : Greenogue Busniss Park	Catchment:	U/S Depth : S11
Location Property with buildings	Tape number : 051216_1	D/S MH : S11
Inspection S10 (D/S) S11	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 26.61 m	Lining :

Comment :

1:210	Position	Code	Observation	MPEG	Photo	Grade
	S10					
	0.00	MH	Start node type, manhole, reference number : S10	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	6.00	CN	Connection other than junction, at 10 o'clock, diameter 100mm	00:00:43		(Constr) 0
	26.60	WL	Water level, 0% of the vertical dimension	00:03:04		(Serv) 0
	26.61	MHF	Finish node type, manhole reference number: S11	00:03:04		(Constr) 0
	S11					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

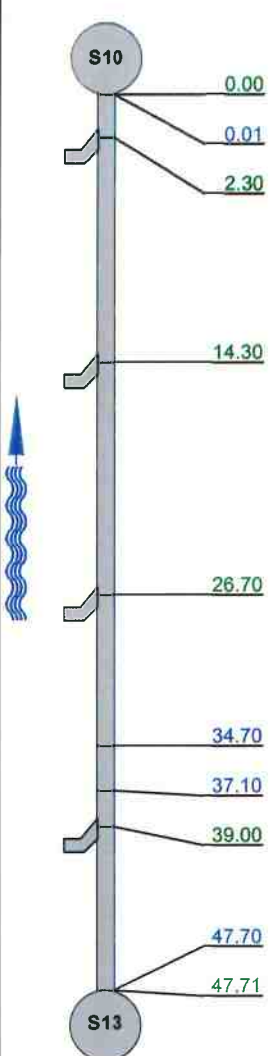
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 38	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details: Catchment:	U/S MH : S13
Road : Greenoque Busniss Park	Tape number : 051216_1	U/S Depth :
Location Property with buildings	Pipe Length	D/S MH : S10
Inspection S10 (U/S) S13		D/S Depth :

Use: Year laid ; Purpose : Total length :	Surface water Routine inspection of condition 47.71 m	Pipe shape : Pipe size ; Pipe material : Lining :	Circular 225.00 mm Polyvinyl chloride
--	---	--	---

Comment :

1:378	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S10	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	2.30	CN	Connection other than junction, at 1 o'clock, diameter 100mm Remarks: Possibly a water spout.	00:00:21		(Constr) 0
	14.30	CN	Connection other than junction, at 1 o'clock, diameter 100mm Remarks: A water spout.	00:01:46		(Constr) 0
	26.70	CN	Connection other than junction, at 2 o'clock, diameter 100mm Remarks: A water spout.	00:03:15		(Constr) 0
	34.70	WL	Water level, 5% of the vertical dimension	00:05:49		(Serv) 0
	37.10	WL	Water level, 0% of the vertical dimension	00:06:39		(Serv) 0
	39.00	CN	Connection other than junction, at 2 o'clock, diameter 100mm Remarks: A water spout.	00:07:27		(Constr) 0
	47.70	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	47.71	MHF	Finish node type, manhole reference number: S13	00:00:00		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1




Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 39	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : OS
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : S11
Inspection S11 (U/S) OS	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 6.21 m	Lining :

Comment:

1:63	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S11	00:00:00		(Constr) 0
		WLC	Clear water level, 5% of the vertical dimension	00:00:00		(Serv) 0
		WL	Water level, 0% of the vertical dimension	00:00:40		(Serv) 0
		WL	Water level, 0% of the vertical dimension	00:00:46		(Serv) 0
		OSF	Finish node type, oil separator reference number: OS Remarks: Oil Separator.	00:00:46		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 40	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S11 (U/S) S3	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S3 S11 S11
---	--	---	----------	--	------------------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 3.81 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole , reference number : S11	00:00:01		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	0.10	LR	Line deviates right Remarks: 45 deg.	00:00:04		(Serv) 0
	1.00	WL	Water level, 5% of the vertical dimension	00:00:11		(Serv) 0
	3.80	WLC	Clear water level, 0% of the vertical dimension	00:00:29		(Serv) 0
	3.81	MHF	Finish node type, manhole reference number: S3	00:00:29		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

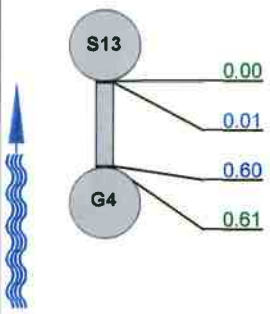
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 41	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : G4
Road : Greenogue Busniss Park	Catchment:	U/S Depth : S13
Location Property with buildings	Tape number : 051216_1	D/S MH : S13
Inspection S13 (U/S) G4	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 0.61 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S13	00:00:01		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	0.60	WL	Water level, 0% of the vertical dimension	00:00:11		(Serv) 0
	0.61	GYF	Finish node type, gully reference number: G4	00:00:11		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 42	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S13 (U/S) US	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	US US S13 US

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 26.51 m	Lining :

Comment :

1:210	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S13	00:00:00		(Constr) 0
	0.01	WLC	Clear water level, 5% of the vertical dimension	00:00:00		(Serv) 0
	4.10	WL	Water level, 0% of the vertical dimension	00:00:40		(Serv) 0
	7.10	CN	Connection other than junction, at 2 o'clock, diameter 100mm Remarks: A water spout.	00:01:04		(Constr) 0
	14.20	CN	Connection other than junction, at 12 o'clock, diameter 100mm Remarks: A water spout.	00:02:08		(Constr) 0
	14.50	WLC	Clear water level, 5% of the vertical dimension	00:02:12		(Serv) 0
	15.00	WL	Water level, 0% of the vertical dimension	00:02:16		(Serv) 0
	17.50	CN	Connection other than junction, at 12 o'clock, diameter 100mm Remarks: A water spout.	00:02:37		(Constr) 0
	19.80	WL	Water level, 5% of the vertical dimension	00:02:54		(Serv) 0
	21.10	CN	Connection other than junction, at 12 o'clock, diameter 100mm Remarks: A water spout.	00:03:03		(Constr) 0
	22.70	WL	Water level, 0% of the vertical dimension	00:03:16		(Serv) 0
	26.50	WL	Water level, 0% of the vertical dimension	00:03:43		(Serv) 0
	26.51	BRF	Finish node type, major connection without manhole reference number: US Remarks: The end of the pipe.	00:03:43		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

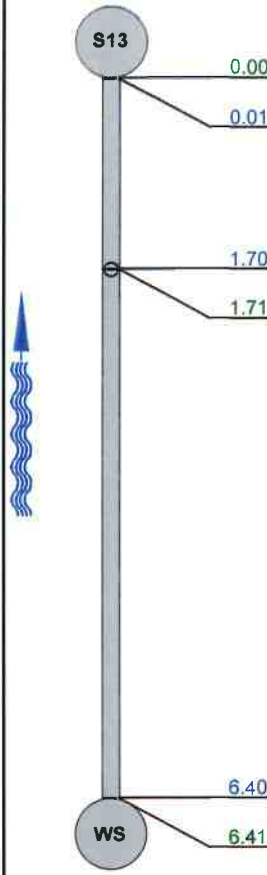
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 43	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : WS
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : S13
Inspection S13 (U/S) WS	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 6.41 m	Lining :

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S13	00:00:02		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
	1.70	LL	Line deviates left Remarks: 45 deg.	00:00:15		(Serv) 0
	1.71	CN	Connection other than junction, at 12 o'clock, diameter 100mm Remarks: A water spout.	00:00:15		(Constr) 0
	6.40	WL	Water level, 0% of the vertical dimension	00:00:41		(Serv) 0
	6.41	BRF	Finish node type, major connection without manhole reference number: WS Remarks: A water spout.	00:00:41		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 44	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenoque Busniss Park Property with buildings S14 (U/S) G10	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	G10 S14

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 4.61 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 100.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S14	00:00:01		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:01		(Serv) 0
	4.60	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	4.61	GYF	Finish node type, gully reference number: G10	00:00:00		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

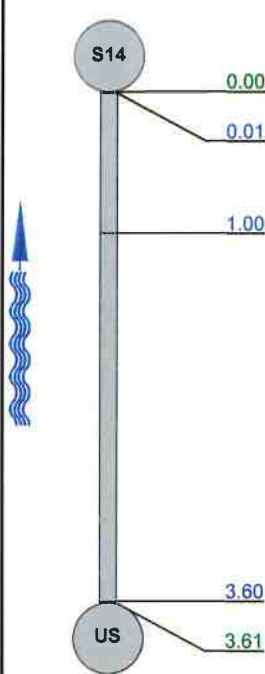
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 45	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : US
Road : Greenogue Busniss Park	Catchment:	U/S Depth : S14
Location Property with buildings	Tape number : 051216_1	D/S MH : S14
Inspection S14 (U/S) US	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 3.61 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
	0.00	MH	Start node type, manhole, reference number : S14	00:00:00		(Constr) 0
	0.01	WL	Water level, 5% of the vertical dimension	00:00:00		(Serv) 0
	1.00	WLC	Clear water level, 0% of the vertical dimension	00:00:09		(Serv) 0
	3.60	WL	Water level, 0% of the vertical dimension	00:00:29		(Serv) 0
	3.61	BRF	Finish node type, major connection without manhole reference number: US Remarks: dead End.	00:00:29		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

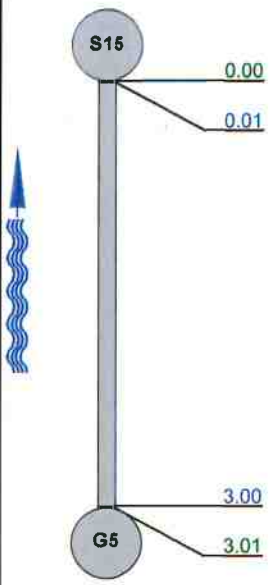
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 46	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenoque Busniss Park Property with buildings S15 (U/S) G5	Location details: Catchment: Tape number : Pipe Length	U/S MH : U/S Depth : D/S MH : D/S Depth :
		051216_1	G5 S15 S15

Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 3.01 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 150.00 mm Polyvinyl chloride
--	--	--	---

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S15	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	3.00	WL	Water level, 0% of the vertical dimension	00:00:26		(Serv) 0
	3.01	GYF	Finish node type, gully reference number: G5	00:00:26		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 47	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Road : Greenogue Busniss Park	Location details: Catchment:	U/S MH : S14
Location Property with buildings	Property with buildings	Tape number : 051216_1	U/S Depth : S15
Inspection S15 (U/S) S14		Pipe Length	D/S MH : S15
			D/S Depth :

Use: Surface water	Year laid :	Pipe shape : Circular	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Total length : 42.51 m	Pipe material : Polyvinyl chloride	Lining :

Comment :

1:336	Position	Code	Observation	MPEG	Photo	Grade
	S15					
	0.00	MH	Start node type, manhole, reference number : S15	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	6.70	CN	Connection other than junction, at 3 o'clock, diameter 150mm Remarks: Connection from G7.1	00:00:43		(Constr) 0
	16.80	CN	Connection other than junction, at 10 o'clock, diameter 100mm Remarks: Connection from G8.1	00:01:43		(Constr) 0
	19.40	CN	Connection other than junction, at 9 o'clock, diameter 100mm Remarks: Connection from G9.1	00:02:03		(Constr) 0
	24.30	SR	Sealing ring intruding, from 10 to 6 o'clock	00:02:39	47_6A	(Constr) 1
	25.20	CN	Connection other than junction, at 2 o'clock, diameter 80mm Remarks: Connection from Pump beside loading de	00:02:48		(Constr) 0
	42.50	WLC	Clear water level, 0% of the vertical dimension	00:06:44		(Serv) 0
	42.51	MHF	Finish node type, manhole reference number: S14	00:06:44		(Constr) 0
	S14					

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.12	5	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place :
Rathcoole

Road :
Greenoque Busniss Park

Date :
23/12/2016

Section number :
47

PLR Suffix :
X



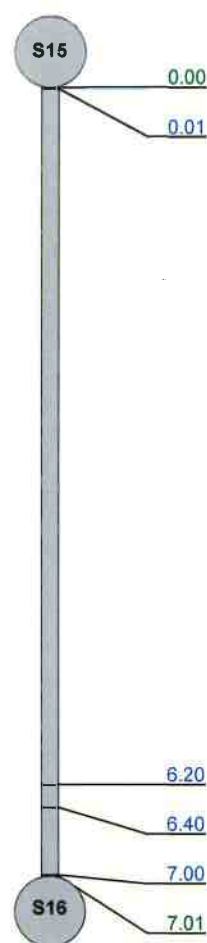
Photo: 47_6A, MPEG #: 051216_1, 00:02:39
24.3m, Sealing ring intruding, from 10 to 6 o'clock

Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 48	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings S15 (D/S) S16	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	S15 S16
Use: Year laid : Purpose : Total length :	Surface water Routine inspection of condition 7.01 m	Pipe shape : Pipe size : Pipe material : Lining :	Circular 225.00 mm Polyvinyl chloride		

Comment :

1:63	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S15	00:00:00		(Constr) 0
	0.01	WLC	Clear water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	6.20	LR	Line deviates right	00:00:52		(Serv) 0
	6.40	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	7.00	WL	Water level, 5% of the vertical dimension	00:00:00		(Serv) 0
	7.01	MHF	Finish node type, manhole reference number: S16	00:00:00		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1


Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 49	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : S16
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : S7
Inspection S16 (D/S) S7	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 15.51 m	Lining :

Comment :

1:126	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : S16	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	13.10	WLC	Clear water level, 5% of the vertical dimension	00:01:52		(Serv) 0
	14.10	WLC	Clear water level, 10% of the vertical dimension	00:02:00		(Serv) 0
	15.00	LL	Line deviates left Remarks: 90 deg.	00:02:07		(Serv) 0
	15.40	JDL	Joint displaced, large Remarks: Poor workmanship.	00:02:41	49_6A	(Struct) 1
	15.50	WL	Water level, 5% of the vertical dimension	00:00:00		(Serv) 0
	15.51	MHF	Finish node type, manhole reference number: S7	00:00:00		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 49	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 49_6A, MPEG #: 051216_1, 00:02:41
15.4m, Joint displaced, large

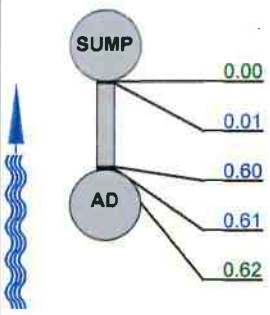
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 50	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Road : Location Inspection	Rathcoole Greenogue Busniss Park Property with buildings SUMP (U/S) AD	Location details: Catchment: Tape number : Pipe Length	051216_1	U/S MH : U/S Depth : D/S MH : D/S Depth :	AD SUMP
---	---	---	-----------------	--	--------------------

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 100.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 0.62 m	Lining :

Comment :

1:50	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	CP	Start node type, catchpit, reference number : SUMP	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	0.60	RF	Roots, fine Remarks: These roots come from gap between the end of this pipe and ACCO Drain.	00:00:12	50_3A	(Serv) 2
	0.61	WL	Water level, 0% of the vertical dimension	00:01:15		(Serv) 0
	0.62	BRF	Finish node type, major connection without manhole reference number: AD Remarks: ACCO Drain.	00:01:15		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	1	1	1.61	1	3

Place :



Rilta Environmental Ltd
Greenogue Business Park
Rathcoole
Tel: 01 4018000
Fax:
Email: info@rilta.ie

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 50	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 50_3A, MPEG #: 051216_1, 00:00:12
0.6m, Roots, fine




Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 51	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : SW1
Road : Greenogue Busniss Park	Catchment:	U/S Depth : S17
Location Property with buildings	Tape number : 051216_1	D/S MH : S17
Inspection SW1 (D/S) S17	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 150.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 12.31 m	Lining :

Comment :

1:105	Position	Code	Observation	MPEG	Photo	Grade
		MH	Start node type, manhole, reference number : SW1 Remarks: Surface water valve.	00:00:02		(Constr) 0
		WL	Water level, 0% of the vertical dimension	00:00:02		(Serv) 0
		REM	General remark Remarks: Socket connection against the stream	00:01:15		(Misc) 0
		WL	Water level, 0% of the vertical dimension	00:01:49		(Serv) 0
		MHF	Finish node type, manhole reference number: S17	00:01:49		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
0	0	0	0	1	0	0	0	0	1

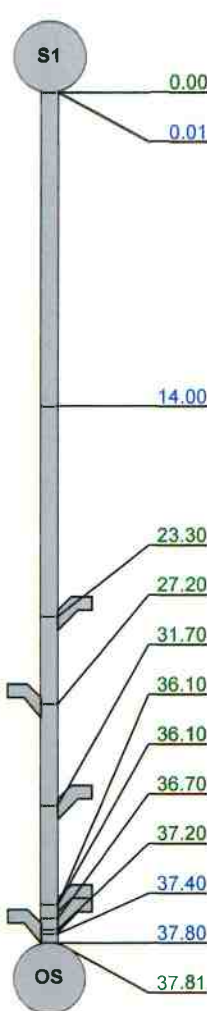
Inspection report / Inspection: 1

Date : 23/12/2016	Job number :	Weather : no rain or snow	Operator : Frantisek	Section number : 52	PLR SUFFIX: X
Weather no rain or snow	Vehicle : VEHICLE 1	Camera : camera 1	Preset :	Cleaned : yes	Operator : Frantisek

Place : Rathcoole	Location details:	U/S MH : S1
Road : Greenogue Busniss Park	Catchment:	U/S Depth :
Location Property with buildings	Tape number : 051216_1	D/S MH : OS
Inspection S1 (D/S) OS	Pipe Length	D/S Depth :

Use: Surface water	Pipe shape : Circular
Year laid :	Pipe size : 225.00 mm
Purpose : Routine inspection of condition	Pipe material : Polyvinyl chloride
Total length : 37.81 m	Lining :

Comment :

1:315	Position	Code	Observation	MPEG	Photo	Grade
						
	0.00	MH	Start node type, manhole, reference number : S1	00:00:00		(Constr) 0
	0.01	WL	Water level, 0% of the vertical dimension	00:00:00		(Serv) 0
	14.00	OBI	Other obstacles protuding through wall, from 12 to 6 o'clock, 5% cross-sectional area loss Remarks: A steel bar	00:01:52	52_3A	(Serv) 5
	23.30	CN	Connection other than junction, at 10 o'clock, diameter 100mm Remarks: Connection from G9	00:03:09		(Constr) 0
	27.20	CN	Connection other than junction, at 2 o'clock, diameter 100mm Remarks: Connection from G6	00:03:35		(Constr) 0
	31.70	CN	Connection other than junction, at 10 o'clock, diameter 100mm Remarks: Connection from G8.	00:04:01		(Constr) 0
	36.10	SR	Sealing ring intruding, from 11 to 1 o'clock	00:05:24		(Constr) 1
	36.10	CN	Connection other than junction, at 10 o'clock, diameter 100mm Remarks: Connection from G7	00:05:26	52_8A	(Constr) 0
	36.70	CN	Connection other than junction, at 9 o'clock, diameter 100mm Remarks: Connection from AJ3.	00:05:38		(Constr) 0
	37.20	CN	Connection other than junction, at 3 o'clock, diameter 150mm Remarks: Connection from S6.	00:05:58		(Constr) 0
	37.40	WL	Water level, 0% of the vertical dimension	00:06:05		(Serv) 0
	37.80	WL	Water level, 10% of the vertical dimension	00:06:05		(Serv) 0
	37.81	BRF	Finish node type, major connection without manhole reference number: OS Remarks: Survey stopped just befor	00:06:05		(Constr) 0

Structural Defects					Constructional Features				
Service Defects					Miscellaneous Features				
STR no def	STR peak	STR mean	STR total	STR grade	SER no def	SER peak	SER mean	SER total	SER grade
1	5	0.13	5	1	1	10	0.26	10	5

Inspection pictures / Inspection: 1

Place : Rathcoole	Road : Greenoque Busniss Park	Date : 23/12/2016	Section number : 52	PLR Suffix : X
----------------------	----------------------------------	----------------------	------------------------	-------------------



Photo: 52_3A, MPEG #: 051216_1, 00:01:52
 14m, Other obstacles protuding through wall, from 12 to 6 o'clock, 5% cross-sectional area loss



Photo: 52_8A, MPEG #: 051216_1, 00:05:26
 36.1m, Connection other than junction, at 10 o'clock, diameter 100mm



ONSITE DRAINAGE – SUMMARY OF DEFECTS

**PLEASE REFER TO THE SITE PLAN OVERLEAF*

It was apparent from the CCTV camera inspection that the drainage system is generally in good condition, with some area requiring attention.

For any of the places where a seal ring was found to be intruding, a structural patch lining of all defective sections is recommended in order to reinstate the drainage lines to a watertight condition. Other drainage line defects have been itemised below.

Foul Line

Drainage line: F6 – F4

<i>Location</i>	<i>Defect</i>
8.30m	Multiple cracks in the line. Recommendation repair by installation of liner.
14.30m	Settled deposits in the line. Assumed to be a lump of concrete from the building manufacture. Recommend robotic cutter to break up concrete and the line be flushed.

Surface Water Line

Drainage Line: AD – Sump

<i>Location</i>	<i>Defect</i>
0.60m	Roots located at the end of the pipe at the ACO Drain. Recommend root cutter to dislodge roots and liner to repair line.

Drainage Line: S1 – OS

<i>Location</i>	<i>Defect</i>
14.00m	A steel bar is protruding through the drain wall. Recommend that a robotic cutter cuts the steel bar and that the line is repaired by installation of a liner.

Drainage Line: S16 – S7

<i>Location</i>	<i>Defect</i>
15.40m	Joint displacement. A structural patch liner is required on this defective section in order to bring it to a watertight condition.