

Environmental Licensing Programme
Office of Environmental Sustainability
Environmental Protection Agency
PO Box 3000
Johnstown Castle Estate
Wexford

01/09/2021

IW ref: LT0523

Uisce Éireann
Teach Colvill
24-26 Sráid Thalbóid
Baile Átha Cliath 1
D01 NP86
Éire

Irish Water
Colvill House
24-26 Talbot Street
Dublin 1
D01 NP86
Ireland

T: +353 1 89 25000
F: +353 1 89 25001
www.water.ie

Re: Youghal Waste Water Discharge Licence Application D0139-02

Dear Inspector,

In response to the Regulation 12 request for information notice dated 10th August 2021, regarding the site and newspaper notices, please see below for relevant information.

The Newspaper notice in accordance with Regulation 10 of the Waste Water Discharge (Authorisation) Regulations 2007, as amended, was published on 17 August 2021 in the Irish Examiner. Please refer to the newspaper notice enclosed as attachment 1.

The site notice in accordance with Regulation 11 of the same regulations referenced above, was erected on 27 August 2021. Please refer to attachment 2 for a photographs of the site notice and attachment 3 for the site notice location.

Please find enclosed:

- 1 Newspaper Notice
- 2 Site Notice photographs
- 3 Site Notice Location

Yours sincerely,

Sheelagh Flanagan

Sheelagh Flanagan

Environmental Strategy

For inspection purposes only.
Consent of copyright owner required for any other use.

PUBLIC NOTICE



Application to the Environmental Protection Agency for the Review of a Waste Water Discharge Licence

Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0139-01) for the Youghal, Co. Cork Waste Water Works. The waste water works consists of an existing waste water treatment plant at Youghal Mudlands Townland, 209846E, 079157N; an existing Primary Discharge (SW000) and existing Storm Water and Emergency Overflows, which discharge into the Lower Blackwater Estuary / Youghal Harbour and into Youghal Bay.

Details of the location of these works and associated discharges are as follows: -

Waste Water Works Item	Location of Waste Water Works	Irish National Grid References
Waste Water Treatment Plant	Youghal Mudlands Townland	209846E, 079157N
Primary Discharge (SW000)	Lower Blackwater Estuary / Youghal Harbour	210513E, 078480N
Storm Water Overflow (SW011)	Lower Blackwater Estuary / Youghal Harbour	210513E, 078480N
Storm Water Overflow (SW002)	Lower Blackwater Estuary / Youghal Harbour	210996E, 077419N
Storm Water Overflow (SW005)	Youghal Bay	210527E, 076075N
Storm Water Overflow (SW006)	Youghal-Lands Townland	210971E, 077130N
Storm Water Overflow (SW007)	Youghal Mudlands Townland	210298E, 078444N
Emergency Overflow (SW008)	Foxhole Townland	209687E, 079880N
Storm Water Overflow (SW010)	Summerfield Townland	209412E, 076168N

A copy of -

- (i) The application for a waste water discharge licence
- (ii) The environmental impact assessment report (EIAR), and
- (iii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application

shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford; at Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1 and at; Cork County Council Offices, Water Services South, County Hall, Carrigrohane Road, Co. Cork. The EIAR will be available on the Agency's website for inspection.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.

PUBLIC NOTICE



Application to the Environmental Protection Agency for the Review of a Waste Water Discharge Licence

Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0139-01) for the Youghal, Co. Cork Waste Water Works. The waste water works consists of an existing waste water treatment plant at Youghal Mudlands Townland, 209846E, 079157N; an existing Primary Discharge (SW000) and existing Storm Water and Emergency Overflows, which discharge into the Lower Blackwater Estuary / Youghal Harbour and into Youghal Bay.

Details of the location of these works and associated discharges are as follows: -

Waste Water Works Item	Location of Waste Water Works	Irish National Grid References
Waste Water Treatment Plant	Youghal Mudlands Townland	209846E, 079157N
Primary Discharge (SW000)	Lower Blackwater Estuary / Youghal Harbour	210513E, 078480N
Storm Water Overflow (SW011)	Lower Blackwater Estuary / Youghal Harbour	210513E, 078480N
Storm Water Overflow (SW002)	Lower Blackwater Estuary / Youghal Harbour	210996E, 077419N
Storm Water Overflow (SW005)	Youghal Bay	210527E, 076075N
Storm Water Overflow (SW006)	Youghal-Lands Townland	210971E, 077130N
Storm Water Overflow (SW007)	Youghal Mudlands Townland	210298E, 078444N
Emergency Overflow (SW008)	Foxhole Townland	209687E, 079880N
Storm Water Overflow (SW010)	Summerfield Townland	209412E, 076168N


A copy of -

- (i) The application for a waste water discharge licence
- (ii) The environmental impact assessment report (EIAR), and
- (iii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application

shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford; at Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1 and at; Cork County Council Offices, Water Services South, County Hall, Carrigrohane Road, Co. Cork. The EIAR will be available on the Agency's website for inspection.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.

Reproduce
Permission
(B.G.E.) 3

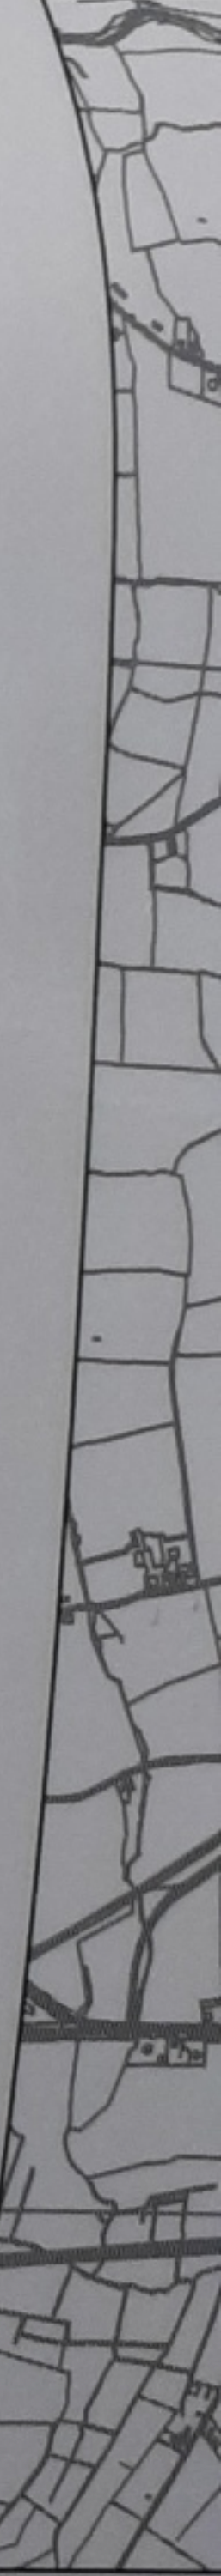

© Mott MacDonald
This document is issued
We accept no responsibility

M M
MOTT
MACDONALD

C:\users\gal38209\appdata\local\gal38209

PUBLIC NOTICE

Application to the Environmental Protection Agency for the Review of a Waste Water Discharge Licence



Pursuant to Regulation 4 of the European Union Waste Water Discharges Regulations 2007 to 2020, UISCE Water, Carfax House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence 000004910 for the Finghal, Co. Louth Waste Water Works. The waste water works consists of an existing waste water treatment plant at Finghal Mulhenny Townland, 209488, 0791376, an existing Primary Discharge (000000) and existing Storm Water and Emergency Overflows, which discharge into the Lower Blackwater Estuary / Finghal Harbour and into Finghal Bay.

Waste Water Works Name	Location of Waste Water Works	Irish National Grid Reference
Waste Water Treatment Plant	Finghal Mulhenny Townland	210966, 0791376
Primary Discharge (000000)	Lower Blackwater Estuary / Finghal Harbour	210732, 0794024
Storm Water Overflow (04071)	Lower Blackwater Estuary / Finghal Harbour	210518, 0796026
Storm Water Overflow (04052)	Lower Blackwater Estuary / Finghal Harbour	210966, 0791376
Storm Water Overflow (04053)	Finghal Bay	210237, 0792754
Storm Water Overflow (04054)	Finghal/Landis Townland	210970, 0791304
Storm Water Overflow (04057)	Finghal Mulhenny Townland	210266, 0794484
Emergency Overflow (04058)	Finghal Townland	209476, 0796026
Storm Water Overflow (04070)	Summerhill Townland	209470, 0791084

A copy of:
1) The application for a waste water discharge licence
2) The environmental impact assessment report (EIR), and
3) All such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application,
shall, as soon as practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the Headquarters of the Environmental Protection Agency, P.O. Box 9000, Johnsons Castle Estate, Co. Wicklow, at 100 Water, Carfax House, 24-26 Talbot Street, Dublin 1 and at Local County Council Offices, Water Services Team, County Wick, Carrigrohane Road, Co. Wick. The cost will be available on the Agency's website for inspection.
Submissions in relation to the waste application may be made to the Environmental Protection Agency at its Headquarters at P.O. Box 9000, Johnsons Castle Estate, Co. Wicklow, in writing within the period of 28 weeks beginning on the date of receipt by the Agency of the application.





For more information please contact
Consent Officer: 01793 248600 (available for only public use)



Project Name	Project Reference	Project Status	Project Type	Project Category
Finghal WWT, Review	000004910	Active	Waste Water Treatment	Waste Water Treatment

Reproduced from the Ordnance Survey Ireland by Permission of the Government. Licence no. (B.G.E.) 3-3-34

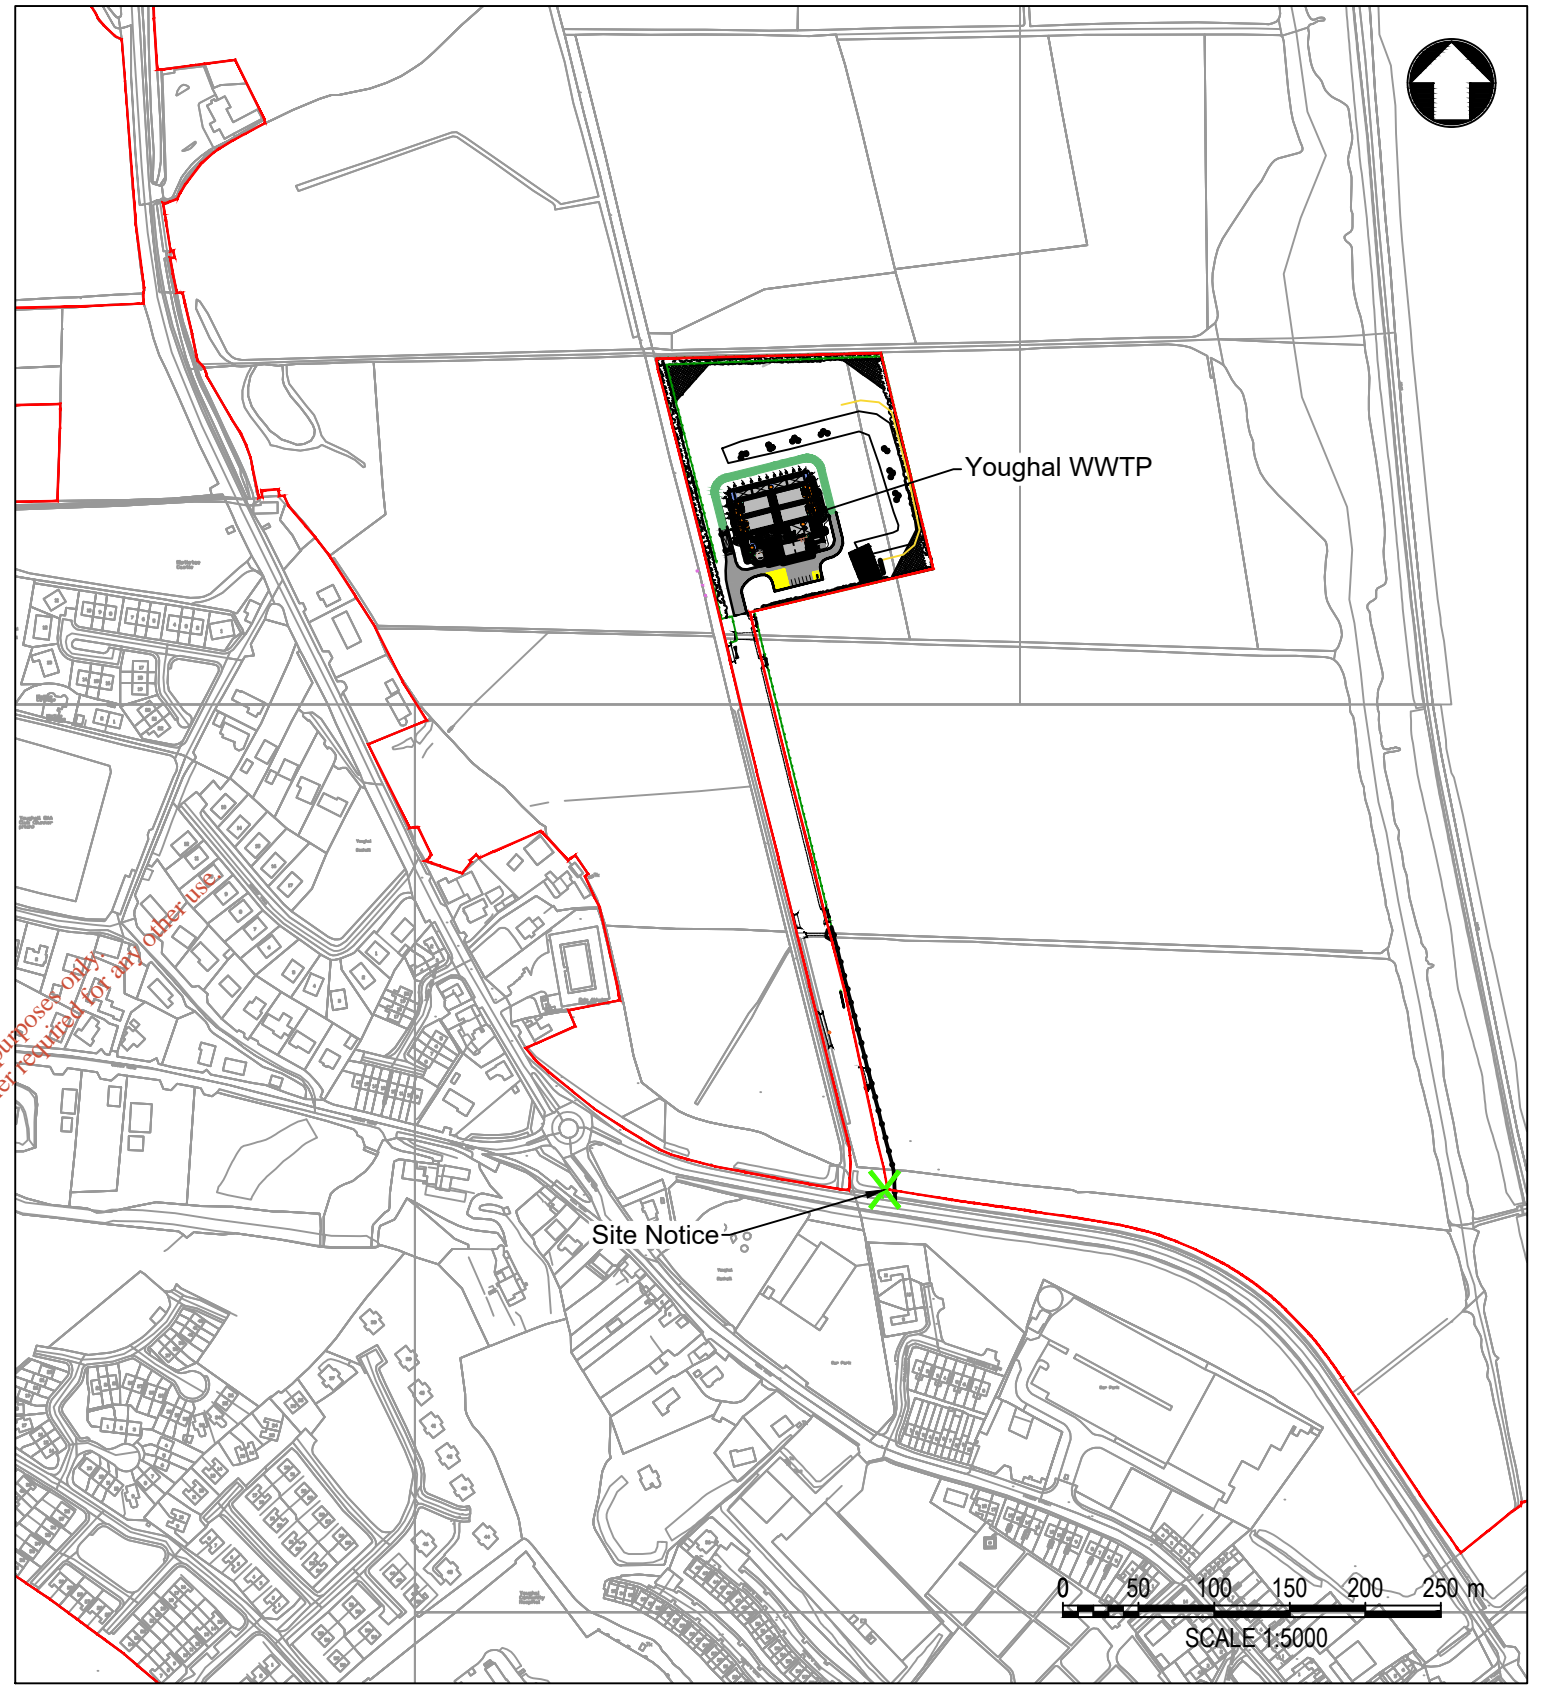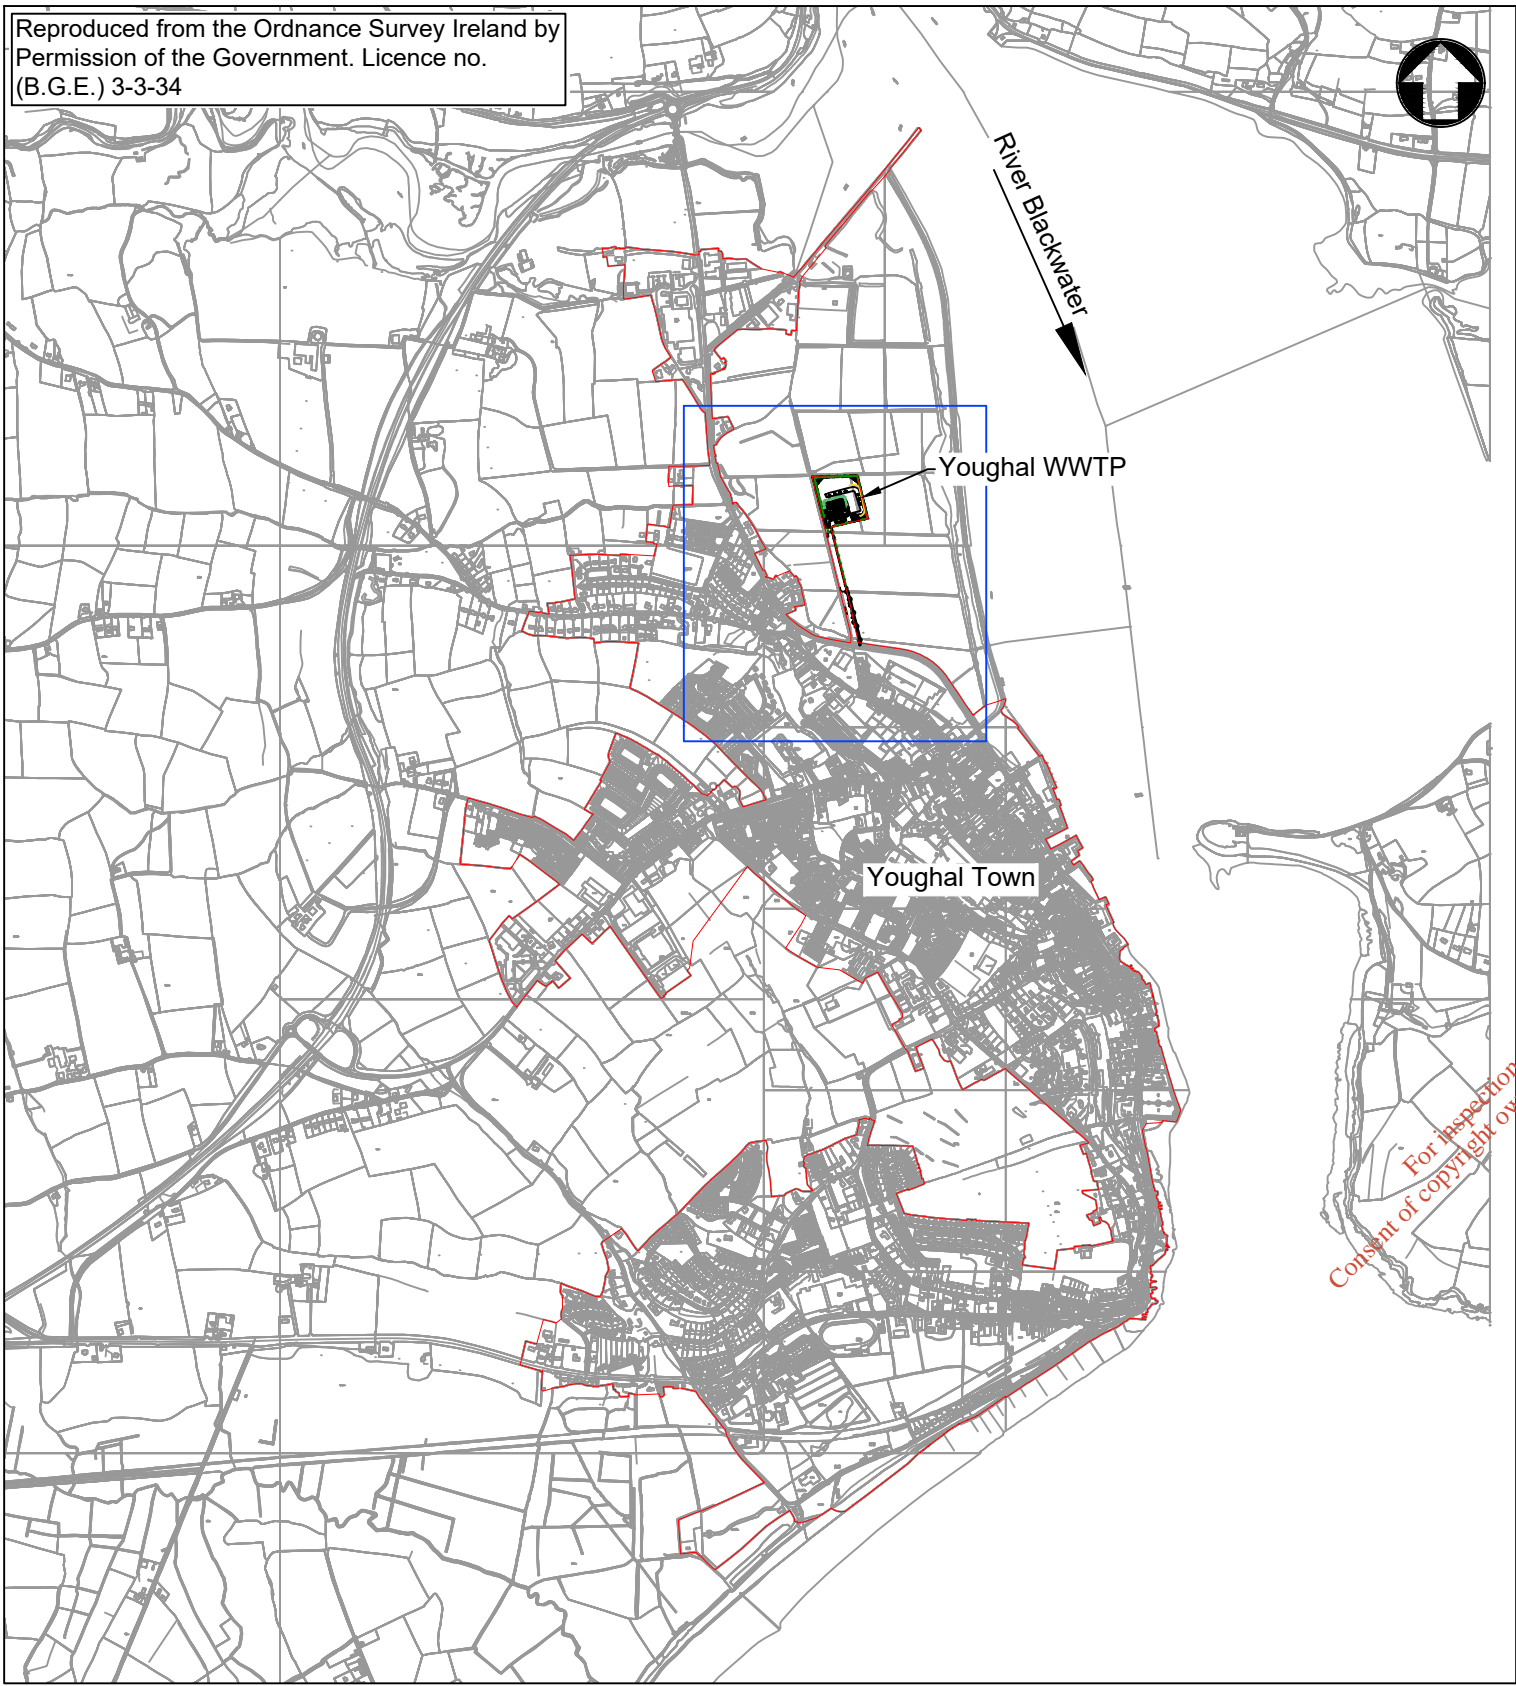

For inspection purposes only. Consent of copyright owner required for any other use.

© Mott MacDonald Ireland
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

M M
MOTT MACDONALD

5 Eastgate Avenue
 Eastgate
 Little Island
 Cork
 Ireland
 T +353 (0) 21 4809800
 F +353 (0) 21 4809801
 W www.mottmac.com

Client

Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	10.03.20	DGal	Issued for Information	PCha	RMan

Title
Youghal WWDL Review

Notice Location Attachment B.14 Map 6

 Drawing Number
229379472-MMD-00-XX-DR-C-0106

Drawn	D Gallagher
Checked	P Chambers
Approved	R Mansfield
Scale at A3	1:5,000
Security	STD
Status	INF
Rev	P01