

Administration Team
Environmental Licensing Programme
Office of Environmental Sustainability
Environmental Protection Agency
PO Box 3000
Johnstown Castle Estate
Wexford

Uisce Éireann Bosca OP 6000 Baile Átha Cliath 1 Éire

Irish Water PO Box 6000 Dublin 1 Ireland

T: +353 1 89 25000 F: +353 1 89 25001 www.water.ie

Date 17th October 2016

RE: Kinsale Waste Water Discharge Authorisation D0132-01: Technical Amendments

Further to Irish Water's request for a technical amendment to the Kinsale Waste Water Discharge Licence via EDNE on the 14th October 2016, please find enclosed a CDROM with an electronic copy of the digital drawings.

I trust the above is satisfactory,


Yours Sincerely,

Sheelagh Flanagan

Environmental Licensing Specialist

Environmental Protection Agency

1 8 OCT 2016

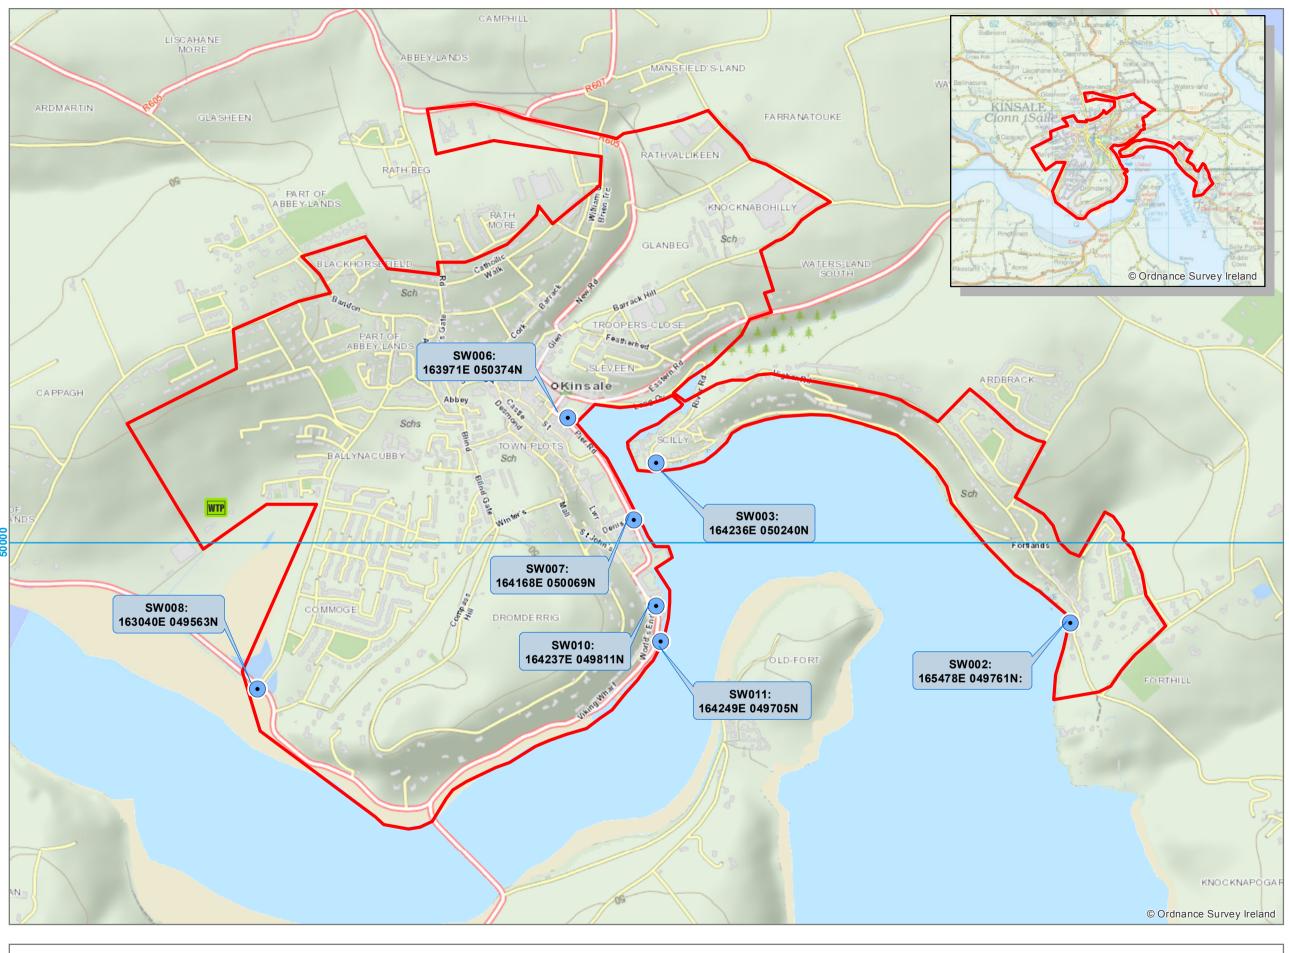



Legend



Emergency Overflow

Associated Pumping Station:

SW002 Summer Cove

SW003 Scilly SW006 Denis' Quay SW007 Denis' Quay

SW008 WWTP

SW010 Denis' Quay

SW011 World's End



Waste Water Treatment plant



IW Agglomeration

0 75 150	300 Meters
Coordinate System: TM65 Irish Grid Projection: Transverse Mercator	
Scale:	1:11,325 @ A3
Revision No.:	0
Attachment No.	C.1.2
Drawn By:	E.Laurinaviciut
Checked By:	M'OReilly
Approved By:	M'OReilly
Drawn Date	12/10/2016
Checked Date:	12/10/2016
Approved Date:	12/10/2016

1. No part of this drawing may be reproduced or transmitted in any form or stored in any retrieval system of any nature without the written permission of Irish Water as copyright holder except as agreed for use on the project for which the document was originally issued.

2. Whilst every care has been taken in its compilation, Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.

Reproduced from the Ordnance Survey Of Ireland by Permission of the Government. License No. 3-3-34

Map Template Design: kcarroll@water.ie

Kinsale

Emergency Overflows