






ATTACHMENT B.4:
NOTICES AND ADVERTISEMENTS

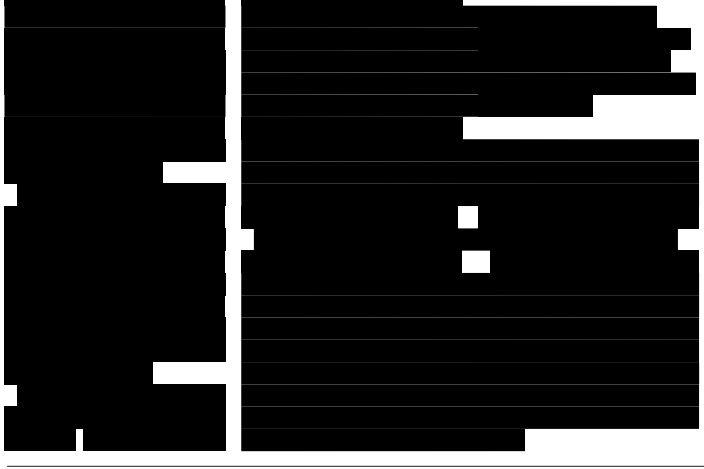

**ATTACHMENT B.4.1:
NEWSPAPER NOTICE**

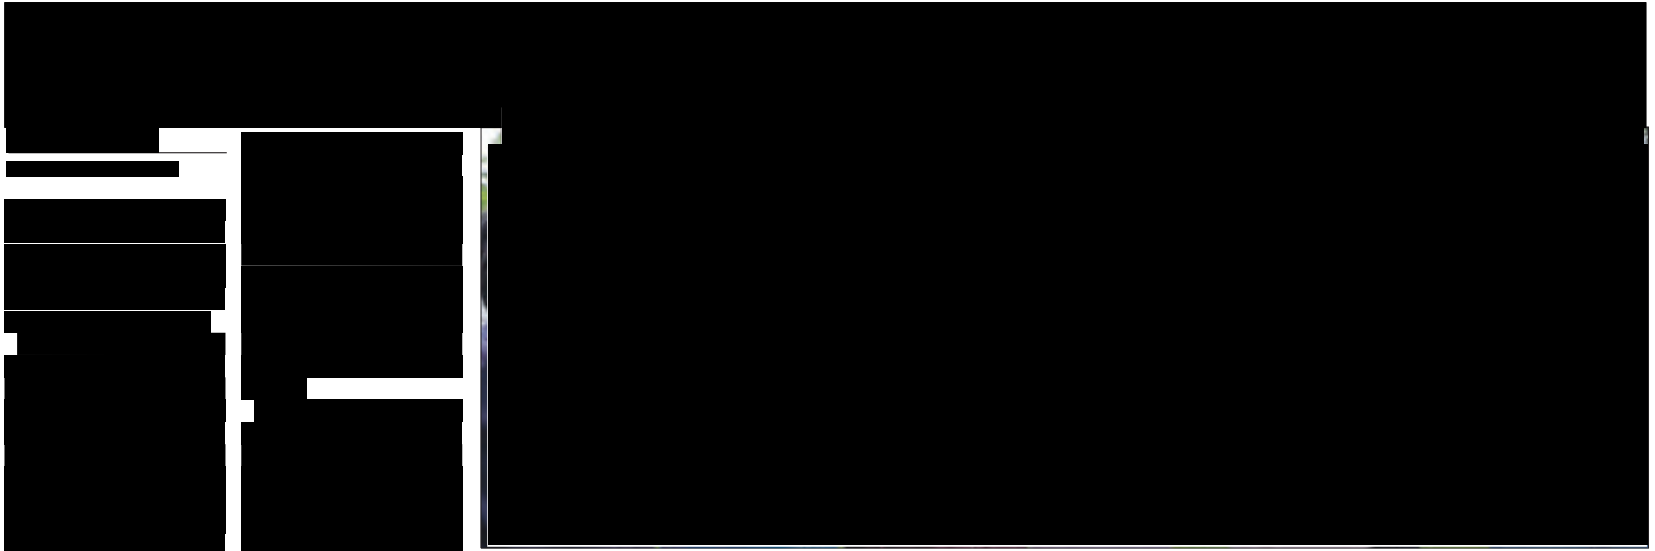

PUBLIC NOTICE

Application to the Environmental Protection Agency for a Review of a Waste Water Discharge Licence



Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0052-01) for the Mallow Waste Water Treatment Works, Co. Cork. The waste water works will consist of an upgraded Waste Water Treatment Plant at Ballyellis Townland (NGR 157318E, 097988N); an existing Primary Discharge (SW001) which discharges to the Blackwater River and a new Dual Function Overflow (i.e., SW010 which can act as a Storm Water Overflow or Emergency Overflow depending on the event) at the new Bridge Street Pumping Station, and associated sewer network.

Details of the location of these works and associated discharges are as follows:-

| Waste Water Works Item | Location | Irish National Grid Reference |
|---|------------------|-------------------------------|
| Mallow Wastewater Treatment Plant (WwTP) | Ballyellis | 157318E, 097988N |
| Primary Discharge Point (SW001) | Ballyellis | 157530E, 098140N |
| Dual Function Overflow from Pumping Station (SW010) | Bearforest Lower | 156636E, 097862N |

A copy of -

- (i) The application for a waste water discharge licence
- (ii) The Environmental Impact Assessment Report (EIAR)
- (iii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application

shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford; at Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1 and at Cork County Council, County Hall, Carrigrohane Rd, Cork.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.



ATTACHMENT B.4.2:
SITE NOTICE



PUBLIC NOTICE

APPLICATION TO THE ENVIRONMENTAL PROTECTION AGENCY FOR A REVIEW OF A WASTE WATER DISCHARGE LICENCE

Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0052-01) for the Mallow Waste Water Treatment Works, Co. Cork. The waste water works will consist of an upgraded Waste Water Treatment Plant at Ballyellis Townland (NGR 157318E, 097988N); an existing Primary Discharge (SW001) which discharges to the Blackwater River and a new Dual Function Overflow (*i.e.*, SW010 which can act as a Storm Water Overflow or Emergency Overflow depending on the event) at the new Bridge Street Pumping Station, and associated sewer network. Details of the location of these works and associated discharges are as follows:-

| Waste Water Works Item | Location | Irish National Grid Reference |
|---|------------------|--------------------------------------|
| Mallow Wastewater Treatment Plant (WwTP) | Ballyellis | 157318E, 097988N |
| Primary Discharge Point (SW001) | Ballyellis | 157530E, 098140N |
| Dual Function Overflow from Pumping Station (SW010) | Bearforest Lower | 156636E, 097862N |

A copy of –

- (i) The application for a waste water discharge licence
- (ii) The Environmental Impact Assessment Report (EIAR)
- (iii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application


shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford; at Irish Water, Colvill House, 24-26 Talbot Street, Dublin 1 and at Cork County Council, County Hall, Carrigrohane Rd, Cork.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.





ATTACHMENT B.4.3:

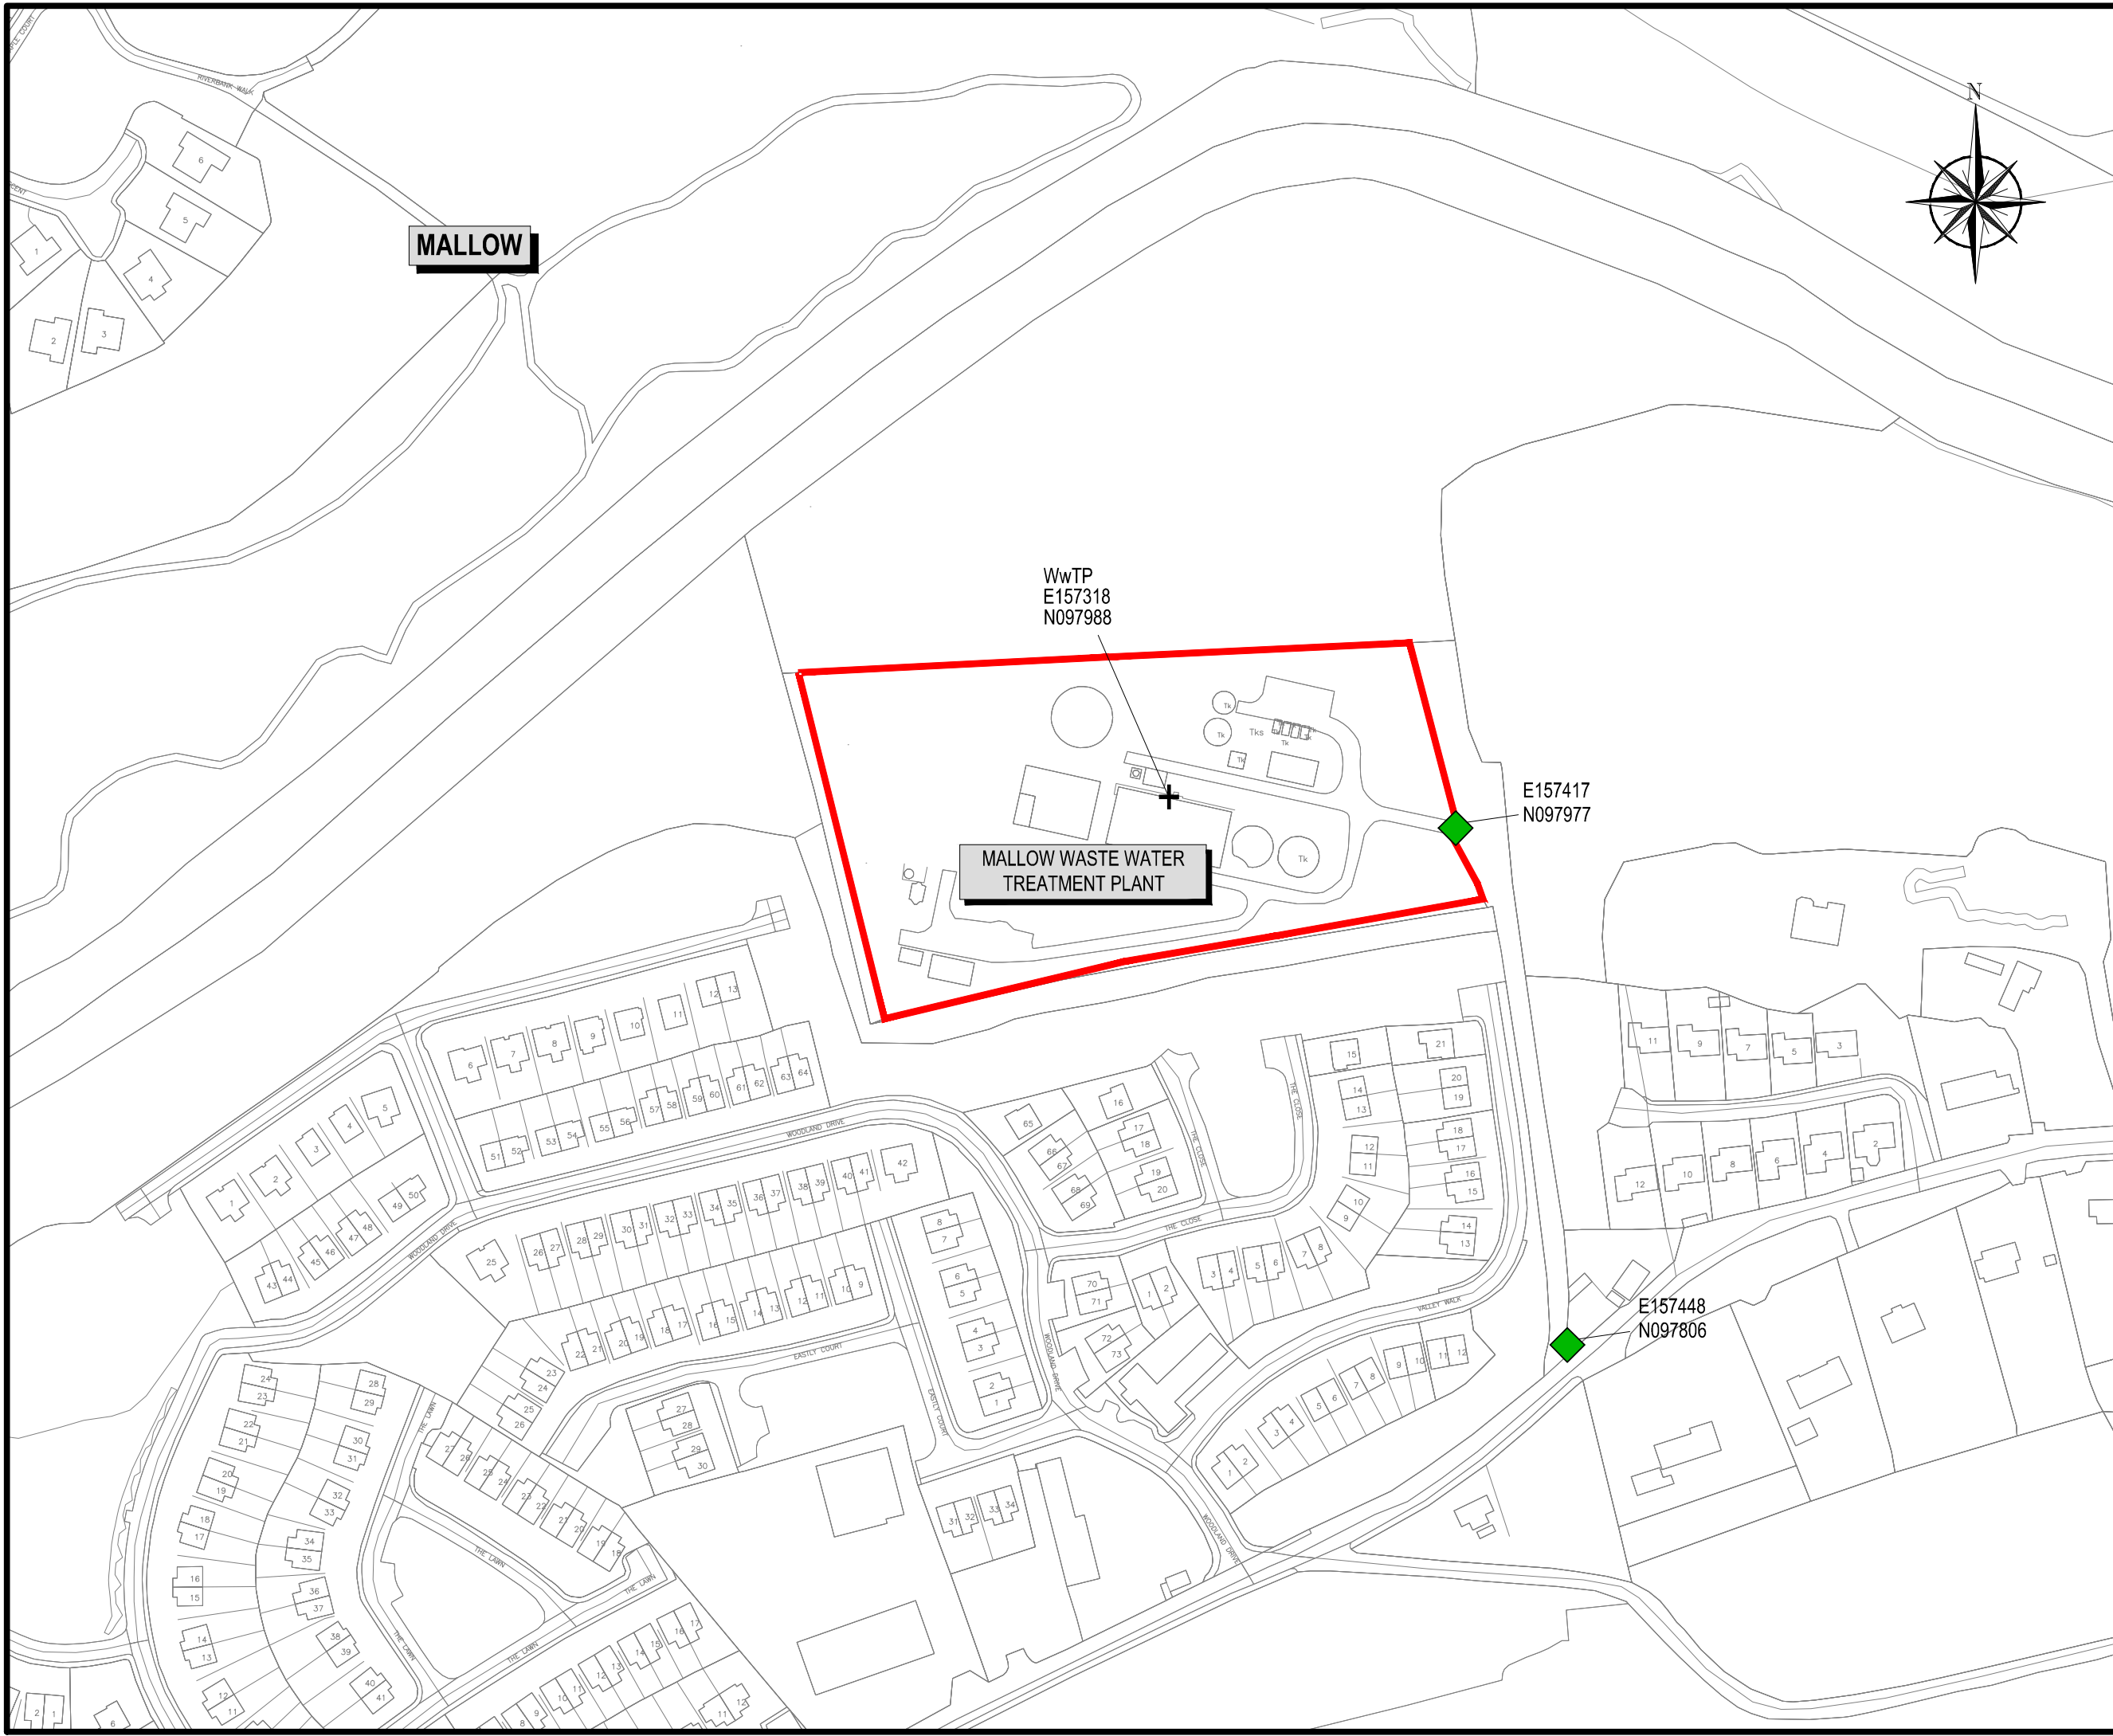MAP 7 – SITE NOTICE LOCATION



NOTES
 Ordnance Survey Ireland Licence No. EN0083316
 Copyright Ordnance Survey Ireland / Government of Ireland.

LEGEND

-  WWTP SITE BOUNDARY
-  SITE NOTICE LOCATION

SIGNED: _____

PRINT NAME: _____

POSITION: _____

DATE: _____

FOR IRISH WATER

| REV | DATE | DESCRIPTION | D | C | A |
|-----|------|-------------|---|---|---|
| | | | | | |

DISCHARGE LICENCE

CLIENT
 **IRISH WATER**
 Colville House,
 24-26 Talbot Street,
 Dublin 1.
 Tel. 1890 278 278 Web. www.water.ie

PROJECT
**MALLOW
 WASTE WATER DISCHARGE
 LICENCE APPLICATION**

TITLE
**MAP 7
 SITE NOTICE LOCATION**

| | | |
|------------------------------------|----------------------------|--------------------|
| SCALES 1:2,000 | DRAWN D. Smithers | DATE 11.10.2022 |
| CAD REFERENCE 20893-NOD-WWDL-06 | ATTACHMENT B.4.3 | REV - |



ATTACHMENT B.4.4:
EIA PORTAL CONFIRMATION NOTICE

From: [Housing Eiaportal](#)
To: [Sheelagh Flanagan](#)
Subject: EIA Portal Confirmation Notice Portal ID 2022231
Date: Monday 5 December 2022 10:12:59

CAUTION: This email originated from outside of your organisation. Do not click links or open attachments unless you recognise the sender and are sure that the content is safe.

Dear Sheelagh,

An EIA Portal notification was received on 05/12/2022 in respect of this proposed application. The information provided has been uploaded to the EIA Portal on 05/12/2022 under EIA Portal ID number 2022231 and is available to view at

<http://housinggovie.maps.arcgis.com/apps/webappviewer/index.html?id=d7d5a3d48f104ecbb206e7e5f84b71f1>.

Portal ID: 2022231

Competent Authority: Environmental Protection Agency

Applicant Name: Irish Water

Location: Mallow WwTP, Ballyellis, Mallow, Co Cork

Description: Following a Waste Water Discharge Authorisation examination by the EPA on 30th June 2021, it was recommended that a Waste Water Discharge Authorisation (WWDA) application was prepared and submitted to the EPA for determination.

Linear Development: No

Date Uploaded to Portal: 05/12/2022

Regards,

Hugh Wogan,

EIA Portal team

—

An Roinn Tithíochta, Rialtais Áitiúil agus Oidhreachta
Department of Housing, Local Government and Heritage

Teach an Chustaim, Baile Átha Cliath 1, D01 W6X0
Custom House, Dublin 1, D01 W6X0

—

T +353 (0) 1 888 2000

www.gov.ie/housing