




ATTACHMENT B.4:

NOTICES AND ADVERTISEMENTS



**ATTACHMENT B.4.1:
NEWSPAPER NOTICE**



PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICE



APPLICATION TO THE ENVIRONMENTAL PROTECTION AGENCY FOR THE REVIEW OF A WASTE WATER DISCHARGE LICENCE

Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Uisce Éireann, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0427-01) for the Coachford Waste Water Treatment Works, Co. Cork. The Waste Water Treatment Works consists of a new Waste Water Treatment Plant at Clontead Beg Townland (NGR 146003E, 073146N); a Primary Discharge (SW001) which discharges to the Inniscarra Reservoir; a Dual Function Overflow, SW006, (i.e., Overflow which can act as a Storm Water Overflow or Emergency Overflow depending on the event); 2 no. Storm Water Overflows (SW005 and SW007) and associated sewer network.

Details of the location of these works and associated discharges are as follows:

Waste Water Works Item	Location	Irish National Grid Reference
Waste Water Treatment Plant	Clontead Beg	146003E, 73146N
Primary Discharge (SW001)	Nadrid	145231E, 72297N
Dual Function Overflow (SW006) Inlet Pumping Station at WwTP	Nadrid	145231E, 72297N
Storm Water Overflow (SW005)	Nadrid	145257E, 72497N
Storm Water Overflow (SW007) from Storm Tank at WwTP	Nadrid	145231E, 72297N

A copy of -

- (i) The application for a waste water discharge licence
- (ii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application.

shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford and at Uisce Éireann, Colvill House, 24-26 Talbot Street, Dublin 1.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.



ATTACHMENT B.4.2:

SITE NOTICE

PUBLIC NOTICE

APPLICATION TO THE ENVIRONMENTAL PROTECTION AGENCY FOR THE REVIEW OF A WASTE WATER DISCHARGE LICENCE

Pursuant to Regulation 9 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, Uisce Éireann, Colvill House, 24-26 Talbot Street, Dublin 1, intend to apply to the Environmental Protection Agency for the review of the Waste Water Discharge Licence (D0427-01) for the Coachford Waste Water Treatment Works, Co. Cork. The Waste Water Treatment Works consists of a new Waste Water Treatment Plant at Clontead Beg Townland (NGR 146003E, 073146N); a Primary Discharge (SW001) which discharges to the Inniscarra Reservoir; a Dual Function Overflow, SW006, (*i.e.*, Overflow which can act as a Storm Water Overflow or Emergency Overflow depending on the event); 2 no. Storm Water Overflows (SW005 and SW007) and associated sewer network. Details of the location of these works and associated discharges are as follows:

Waste Water Works Item	Location	Irish National Grid Reference
Waste Water Treatment Plant	Clontead Beg	146003E, 73146N
Primary Discharge (SW001)	Nadrid	145231E, 72297N
Dual Function Overflow (SW006) Inlet Pumping Station at WwTP	Nadrid	145231E, 72297N
Storm Water Overflow (SW005)	Nadrid	145257E, 72497N
Storm Water Overflow (SW007) from Storm Tank at WwTP	Nadrid	145231E, 72297N

A copy of –

- (i) The application for a waste water discharge licence
- (ii) Such further information relating to the application as may be furnished to the Agency in the course of the Agency's consideration of the application.


shall, as soon as is practicable after receipt by the Agency, be available for inspection or purchase at a fee not exceeding the reasonable cost of making a copy at the headquarters of the Environmental Protection Agency, P.O. Box 3000, Johnstown Castle Estate, Co. Wexford and at Uisce Éireann, Colvill House, 24-26 Talbot Street, Dublin 1.

Submissions in relation to the review application may be made to the Environmental Protection Agency at its headquarters at P.O. Box 3000, Johnstown Castle Estate, Co. Wexford, in writing within the period of 5 weeks beginning on the date of receipt by the Agency of the application.



ATTACHMENT B.4.3:


MAP 7 – SITE NOTICE LOCATION

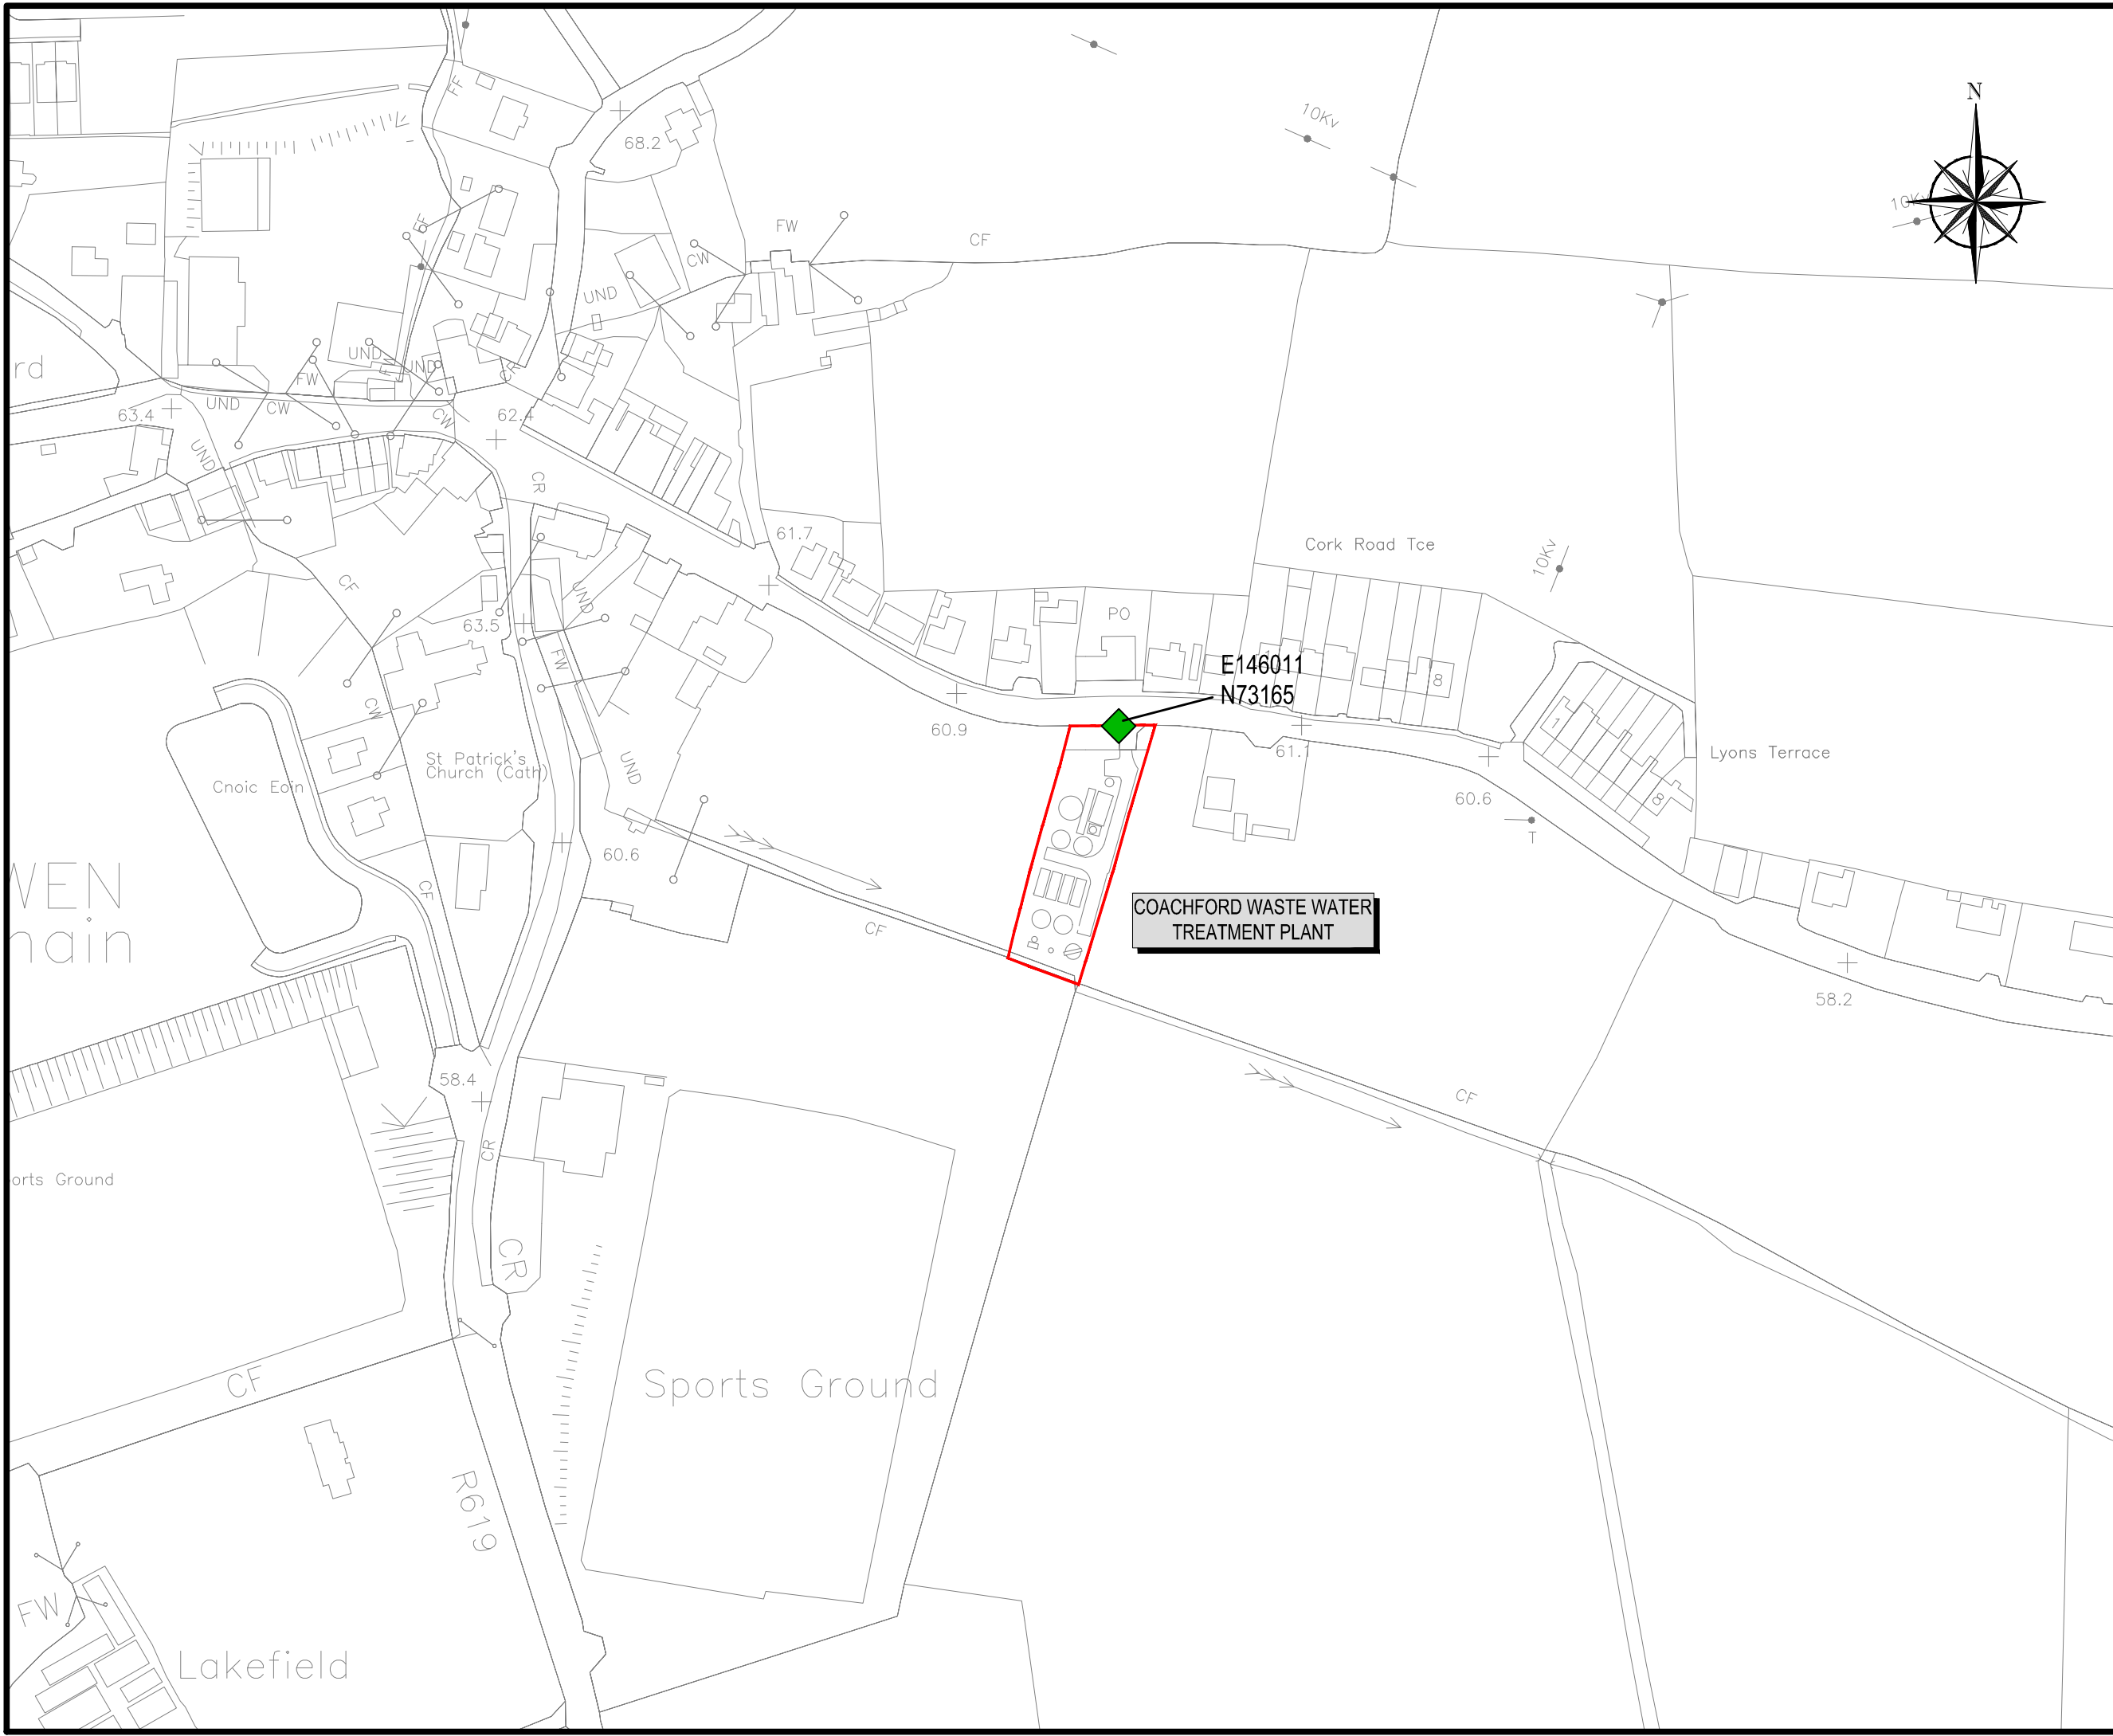

NOTES
 Ordnance Survey Ireland Licence No. EN0083316
 Copyright Ordnance Survey Ireland / Government of Ireland.

LEGEND

- ▭ WWTP SITE BOUNDARY
- ◆ SITE NOTICE LOCATION



SIGNED:
PRINT NAME:
POSITION:
DATE:
FOR UISCE ÉIREANN

REV	DATE	DESCRIPTION	D	C	A

DISCHARGE LICENCE

CLIENT
UISCE ÉIREANN
 Colville House,
 24-26 Talbot Street,
 Dublin 1.
 Tel. 1890 278 278 Web. www.water.ie

PROJECT
**COACHFORD
 WASTE WATER DISCHARGE
 LICENCE APPLICATION**

TITLE
**MAP 7
 SITE NOTICE LOCATION**

SCALES 1:2,000	DRAWN D.Rimdzius	DATE 27.09.2022
CAD REFERENCE 20919-NOD-WWDL	ATTACHMENT B.4.3	REV -



ATTACHMENT B.4.4:
WATER SERVICES AUTHORITY NOTICE

Cork County Council-Water Service Section
County Hall,
Carrigrohane Road,
Cork,
T12 R2NC.

Uisce Éireann
Teach Colvill
24-26 Sráid Thalbóid
Baile Átha Cliath 1
D01 NP86
Éire

Uisce Éireann
Colvill House
24-26 Talbot Street
Dublin 1
D01 NP86
Ireland

T: +353 1 89 25000
F: +353 1 89 25001
www.water.ie

8th December 2023

Dear Sir/Madam,

Re: Coachford Waste Water Discharge Authorisation Application D0427

In accordance with the provisions of Regulation 13 of the European Union (Waste Water Discharge) Regulations 2007 to 2020, you are being notified that an application for a review of a WWDA licence, details of which are set out below, will be submitted to the Agency in December 2023.

Licence Type:	Waste Water Discharge
Name and address of applicant:	Uisce Éireann, Colvill House, 24-26 Talbot Street, Dublin 1, Dublin
Location of agglomeration	Coachhford
Reference No	D0427
EIS/EIAR submitted	No

Please refer to the below table for the National Grid reference, description of any waste water treatment plant and location of the discharge point or points.

The application will be processed by the Agency and you will be notified of the decision in due course. In this regard any submissions in relation to this application should be forwarded to the Agency within 5 weeks from the date of receipt of the application. A copy of the application and associated correspondence are available for public inspection on the Agency's website www.epa.ie.

Waste Water Works Item	Location	Irish National Grid Reference
Waste Water Treatment Plant	Clontead Beg	146003E, 73146N
Primary Discharge (SW001)	Nadrid	145231E, 72297N
Dual Function Overflow (SW006) Inlet Pumping Station at WwTP	Nadrid	145231E, 72297N
Storm Water Overflow (SW005)	Nadrid	145257E, 72497N
Storm Water Overflow (SW007) from Storm Tank at WwTP	Nadrid	145231E, 72297N

Please note that there is no requirement for you to acknowledge receipt of this notice.

If you have no submission to make in relation to this application, there is no requirement for you to reply to the Agency

Yours faithfully,

Sheelagh Flanagan _____

Sheelagh Flanagan

Wastewater Strategy

Uisce Éireann